




PRODUCTION


Customer:	System Information	Sample Information
ERGON - GLOUCESTER CITY 201 WATER ST GLOUCESTER CITY, NJ 08030 US Attn: KEVIN HANSON Tel: E-Mail:	System Volume: 0 gal Bulk Operating Temp: 842F / 450C Heating Source: Blanket: Fluid: EASTMAN THERMINOL 55 Make:	Lab No: 05881508 Analyst: Sample Date: 06/14/23 Received Date: 06/22/23 Completed: 12/31/69

Recommendation:

Comments:

Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
06/14/23	06/22/23	0.0h			202.2	2976	0.63					
Baseline Data				351 / 177		19			655 / 346		790 / 421	3.40

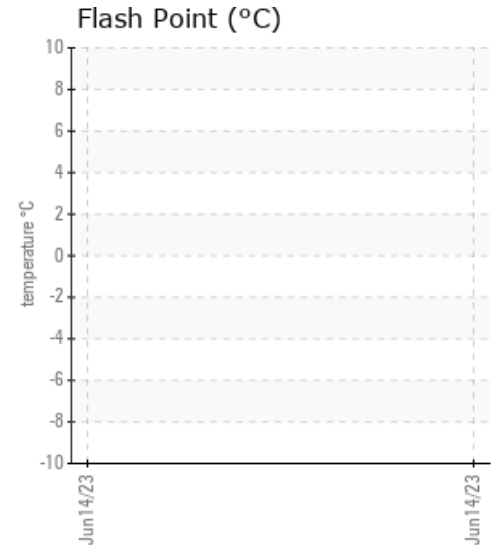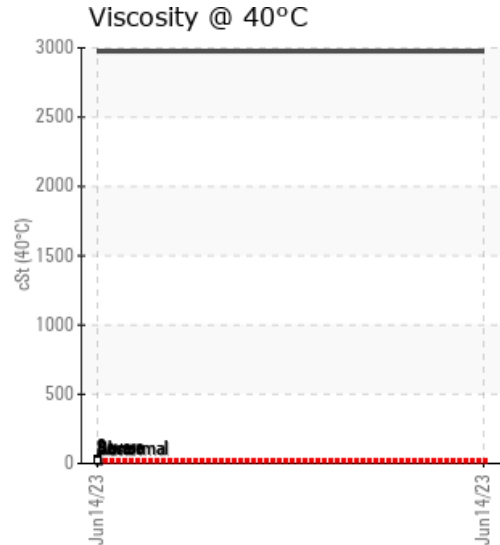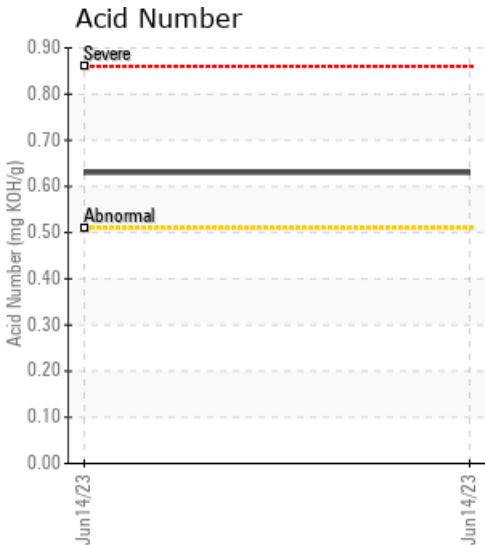

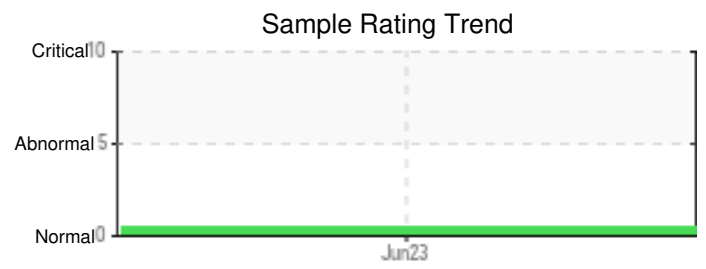

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
06/14/23	451	0	0	1	0	0	2	0	0	0	1	20	2	0	2		4		0	0	4	0	15	0
Baseline Data			0	0					0				0	0				0	0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

GCD Spectrum

Historical Comments	