

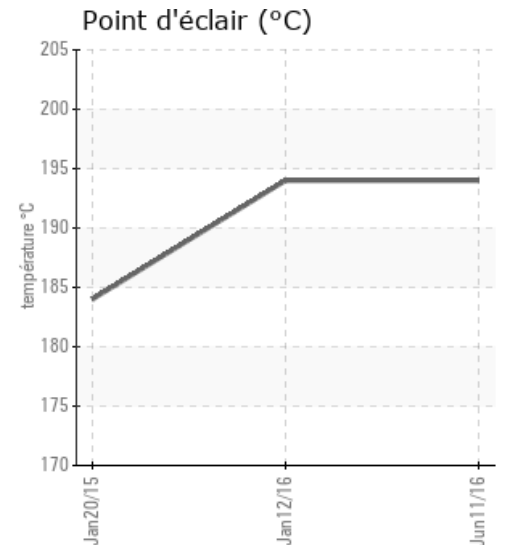
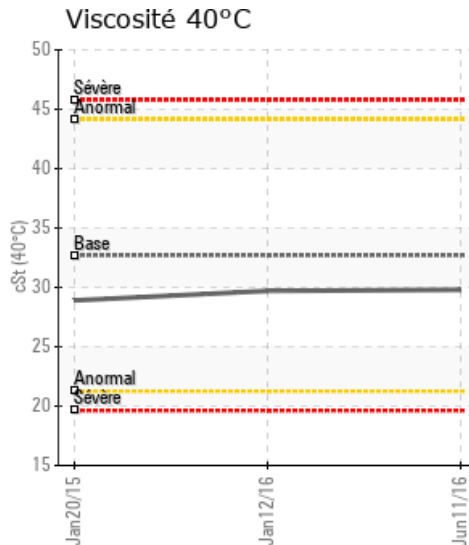
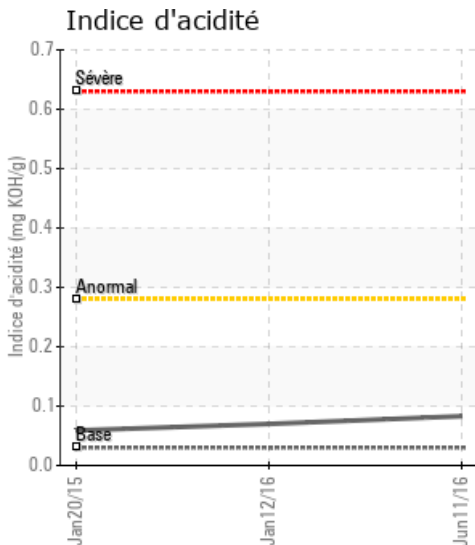


MISE EN CIRCULATION DU FLUIDE 2510812014

Customer: PTRHTF40115	System Information	Sample Information
Polyrey - Ussel Les Petites Bordes Ussel Correze, 19200 France Attn: Olivier Letrange Tel: (055)546-3735 E-Mail: olivier.letrange@polyrey.com	System Volume: 3000 ltr Bulk Operating Temp: 439F / 226C Heating Source: Blanket: Fluid: PETRO CANADA CALFLO AF Make: CHAUFFERIE ANNESCE	Lab No: 02087056 Analyst: John Cliff Sample Date: 06/11/16 Received Date: 07/25/16 Completed: 08/01/16 To discuss this report contact John Cliff at +44 (0) 121 781 7264
Recommendation: Oil appears to be in good condition and fit for further service. Suggest sample at next scheduled maintenance interval.		
Comments:		



Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
06/11/16	07/25/16	22m		381 / 194	44.2	29.8	0.083	0.035	685 / 363	798 / 425	915 / 491	4.46
01/12/16	01/13/16	0m		381 / 194	11.2	29.7	0.07	0.069	664 / 351	797 / 425	906 / 486	7.06
01/20/15	01/29/15	0m		363 / 184	19.4	28.9	0.059	0.034	658 / 348	801 / 427	913 / 489	7.71
Baseline Data				435 / 224		32.7	0.03		693 / 367	790 / 421	887 / 475	2.5

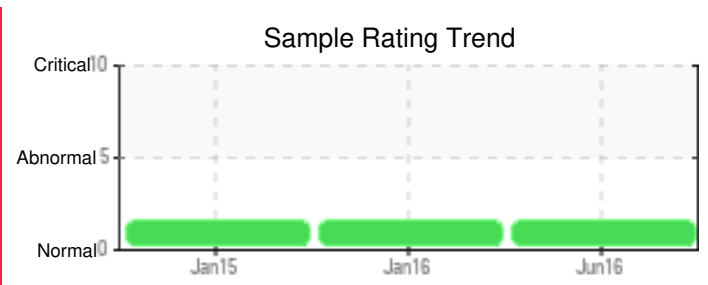

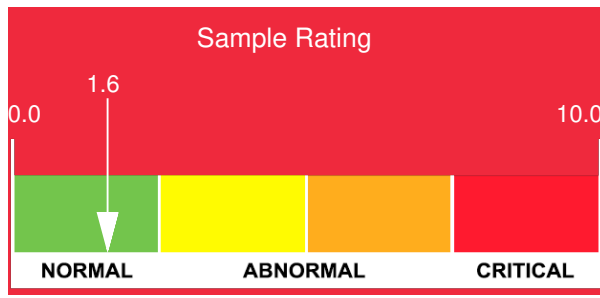

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc	
06/11/16	0	0	0	0	1	0	0	0	0	0	0	1	0	0	0	0	0	0	2	0	0	0	0	0	
01/12/16	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
01/20/15	2	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	1	0	1	0	
Baseline Data			0	0						0			0	0					0				270		

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

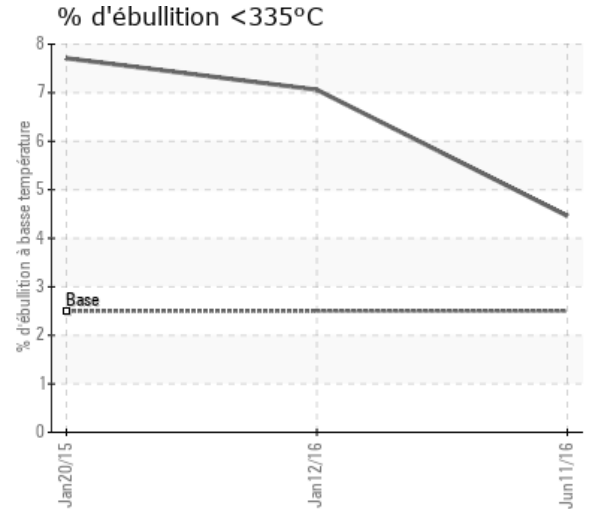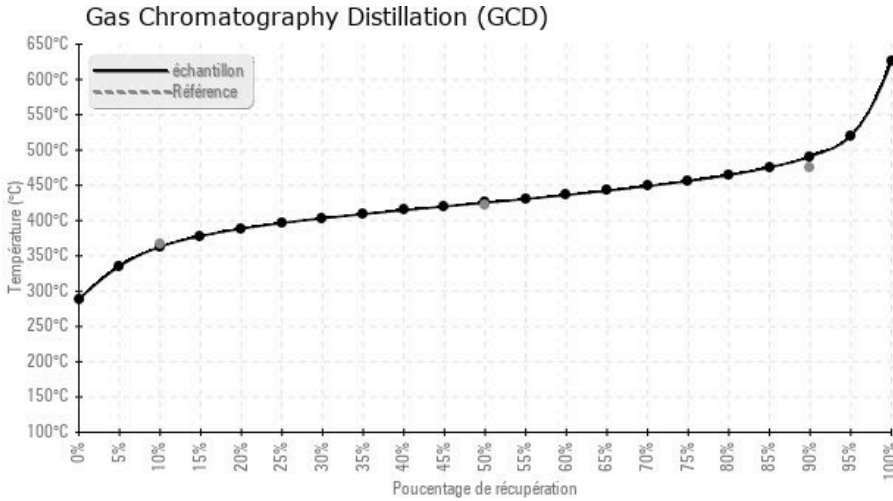

Historical Comments

01/12/16	Oil appears to be in good condition and is fit for further service. Recommend sample at next scheduled maintenance interval.
01/20/15	There are some low boilers present. Oil is fit for further service, sample at next scheduled maintenance interval.