




## MISE EN CIRCULATION DU FLUIDE 2510812014



Customer: PTRHTF40115	System Information	Sample Information
Polyrey - Ussel Les Petites Bordes Ussel Correze, 19200 France Attn: Olivier Letrange Tel: (055)546-3735 E-Mail: olivier.letrange@polyrey.com	System Volume: 3000 ltr Bulk Operating Temp: 439F / 226C Heating Source: Blanket: Fluid: PETRO CANADA CALFLO AF Make: CHAUFFERIE ANNESCE	Lab No: 02128795 Analyst: John Cliff Sample Date: 02/12/17 Received Date: 02/22/17 Completed: 02/27/17

Recommendation: Oil appears to be in good condition and fit for further service. Suggest sample at next scheduled maintenance interval.

Comments:



Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
02/12/17	02/22/17	30m		388 / 198	28.2	30.2	0.074	0.049	671 / 355	796 / 424	907 / 486	6.41
06/11/16	07/25/16	22m		381 / 194	44.2	29.8	0.083	0.035	685 / 363	798 / 425	915 / 491	4.46
01/12/16	01/13/16	0m		381 / 194	11.2	29.7	0.07	0.069	664 / 351	797 / 425	906 / 486	7.06
01/20/15	01/29/15	0m		363 / 184	19.4	28.9	0.059	0.034	658 / 348	801 / 427	913 / 489	7.71
Baseline Data				435 / 224		32.7	0.03		693 / 367	790 / 421	887 / 475	2.5

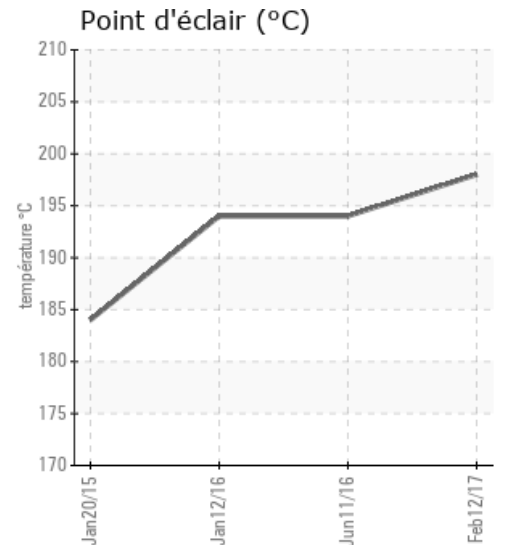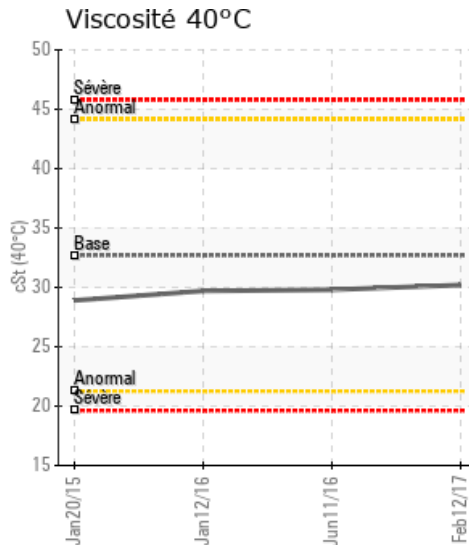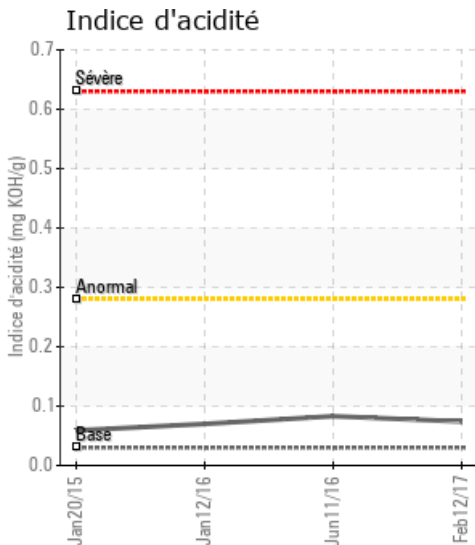

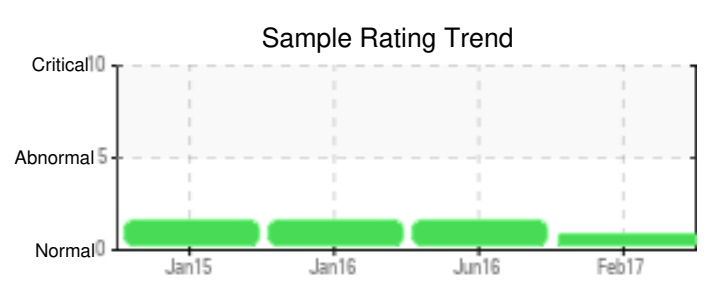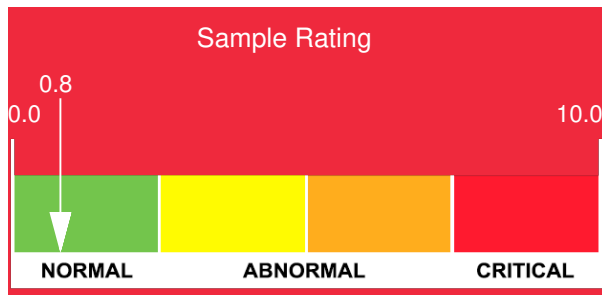

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc	
02/12/17	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0
06/11/16	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0
01/12/16	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
01/20/15	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0
<b>Baseline Data</b>			0	0						0			0	0					0					270	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

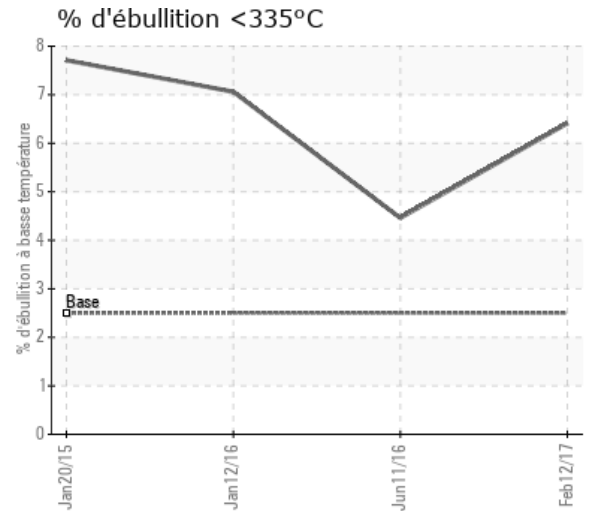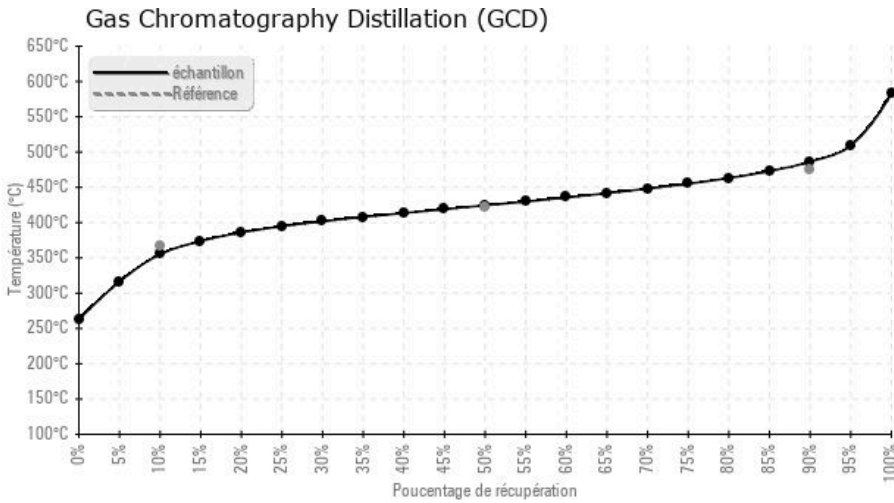

### Historical Comments

06/11/16	Oil appears to be in good condition and fit for further service. Suggest sample at next scheduled maintenance interval.
01/12/16	Oil appears to be in good condition and is fit for further service. Recommend sample at next scheduled maintenance interval.
01/20/15	There are some low boilers present. Oil is fit for further service, sample at next scheduled maintenance interval.

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.