




LAC MEGARTIE



Customer: PTRHTF30124	System Information	Sample Information
SINTRA INC. REGION ESTRIE 3650 CH. DUNANT NORTH HATLEY, QC J0B 2C0 Canada Attn: Luc Couture Tel: (819)569-6337 E-Mail: lcouture@sintra.ca	System Volume: 2500 ltr Bulk Operating Temp: 315F / 157C Heating Source: Blanket: Fluid: PETRO CANADA PETRO-THERM Make:	Lab No: 02258952 Analyst: Pierre Castagne Sample Date: 11/16/18 Received Date: 12/21/18 Completed: 01/16/19

Recommendation: La viscosité, les fractions légère (GCD @10%) ainsi que les fractions lourdes (GCD@90%) sont très élevées. Les fractions lourdes augmente la viscosité et favorise les dépôts de carbone. recommandation: vidanger le fluide, nettoyer et rincer le système et remplir avec une nouvelle charde de Petro-Therm 32

Comments:



Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
11/16/18	12/21/18	0y		482 / 250	21.3	77.1	0.14	0.307	784 / 418	862 / 461	979 / 526	0.00
Baseline Data				433 / 223		34.2	0.03		720 / 382	817 / 436	900 / 482	1.00

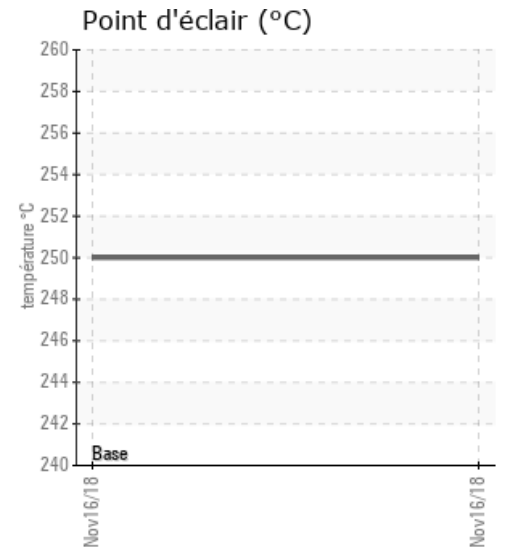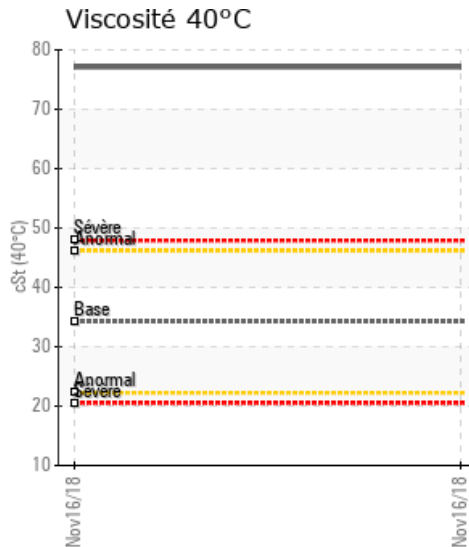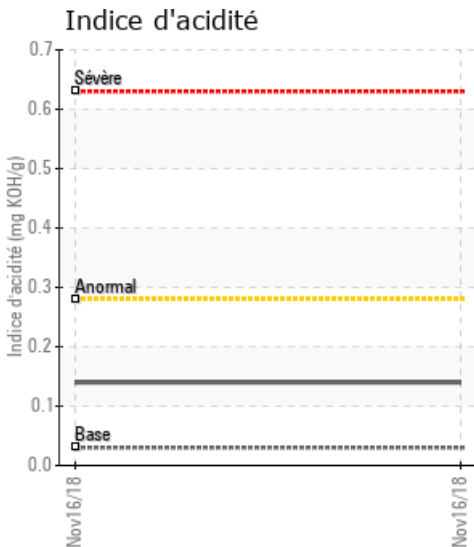

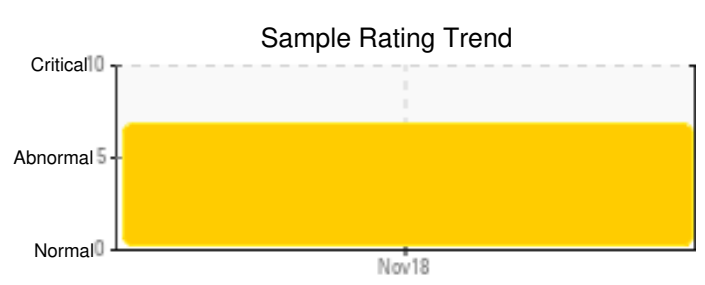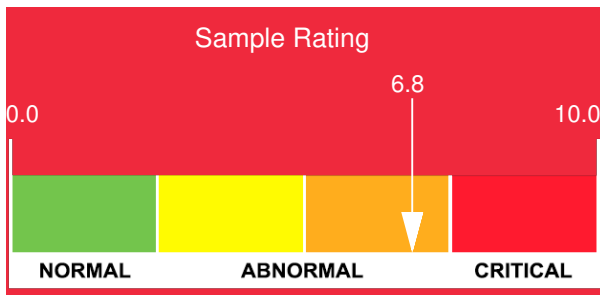

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc
11/16/18	28	0	0	0	7	2	0	0	0	0	4	19	0	0	0	0	0	0	0	0	0	0	2	5
Baseline Data			0	0						0			0	0					0				0	

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

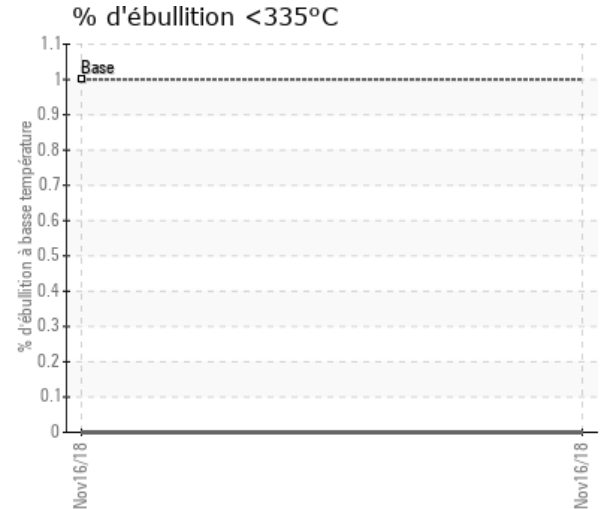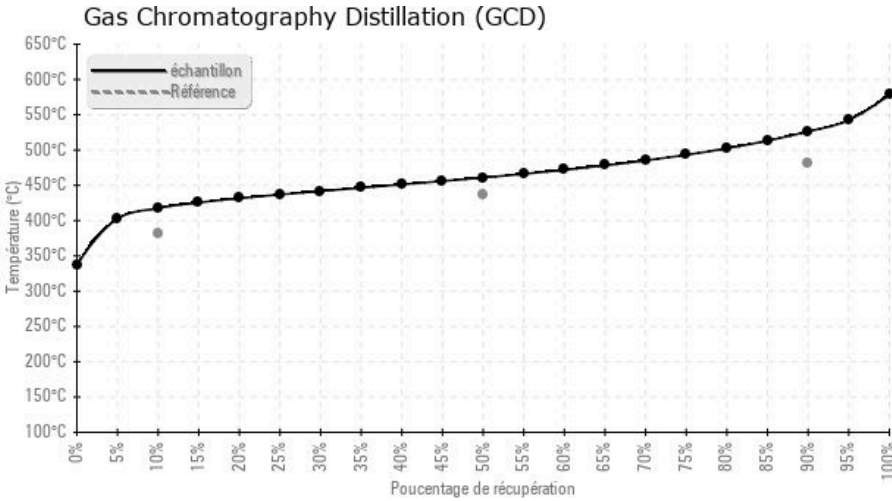

Historical Comments

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.