




HOT OIL


Customer: PTRHTF30159	System Information	Sample Information
EUROVIA 960 CH. EDELWEISS WAKEFIELD, QC S0X 3G0 Canada Attn: Sebastien Perreault Tel: E-Mail: sebastien.perrault@djc.ca	System Volume: 0 gal Bulk Operating Temp: 310F / 154C Heating Source: Blanket: Fluid: SHELL HEAT TRANSFER OIL S2 X Make:	Lab No: 02383240 Analyst: Pierre Castagne Sample Date: 10/07/20 Received Date: 10/23/20 Completed: 10/26/20 Pierre Castagne pierre.castagne@petrocanadalsp.com

Recommandation: L'huile est OK, pour usage continu. Ré-échantillonné dans six mois.

Comments:




Sample Date	Received Date	Fluid Age	Sample Location	Flash Point (COC)	Water (KF)	Viscosity (40°C)	Acid Number	Solids	GCD 10%	GCD 50%	GCD 90%	GCD % < 335°C
	mm/dd/yy			°F/°C	ppm	cSt	mg/KOH/g	%wt	°F/°C	°F/°C	°F/°C	%
10/07/20	10/23/20	0h	bouilloir électrique	460 / 238	75.8	52.6	0.28	0.253	744 / 396	862 / 461	969 / 521	1.29
Baseline Data				500 / 260		54	0.05		777 / 414	867 / 464	964 / 518	0.00

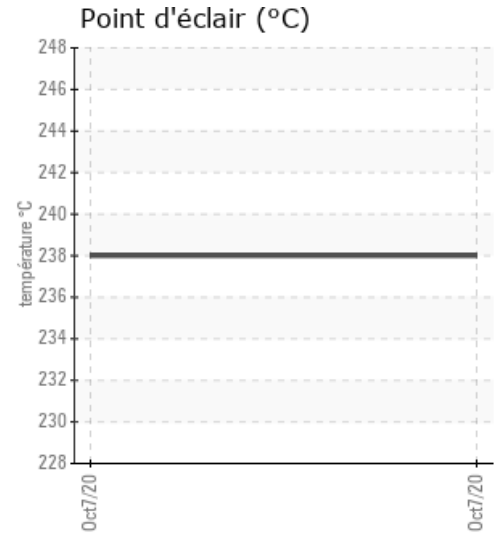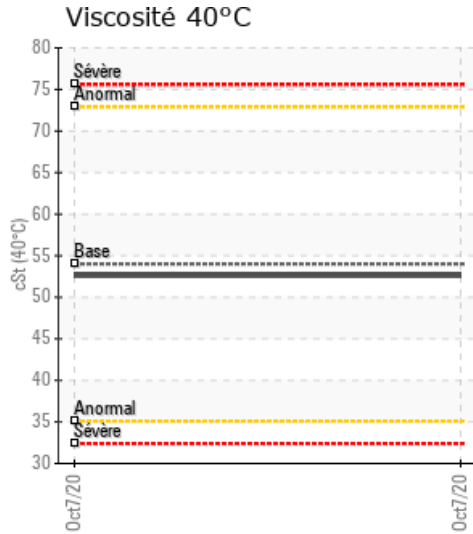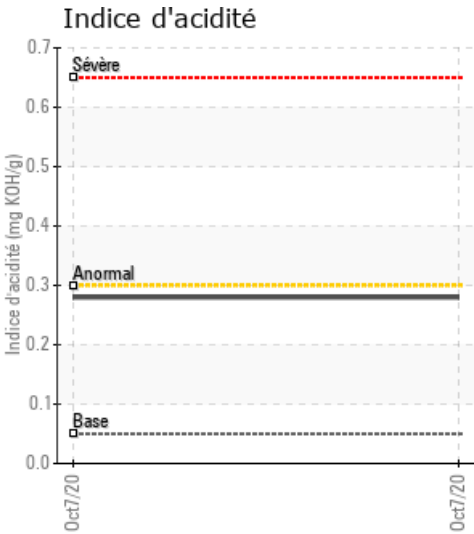

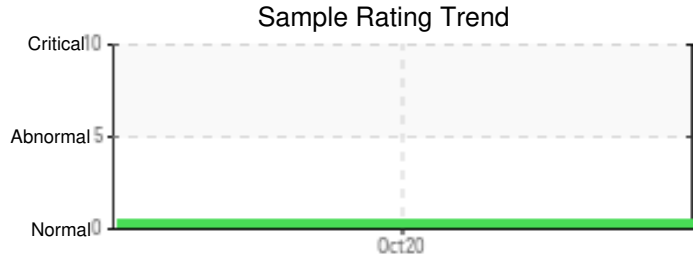

Sample Date	Iron	Chromium	Nickel	Aluminum	Copper	Lead	Tin	Cadmium	Silver	Vanadium	Silicon	Sodium	Potassium	Titanium	Molybdenum	Antimony	Manganese	Lithium	Boron	Magnesium	Calcium	Barium	Phosphorus	Zinc	
10/07/20	3	0	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	2	0	0	0	0	2	3
Baseline Data			0	0						0			0	0					0				0		

Elemental analysis results (above) in parts per million (ppm). [10,000 ppm = 1.0%]

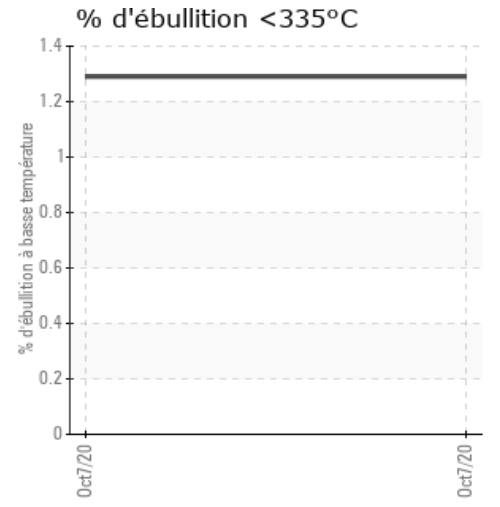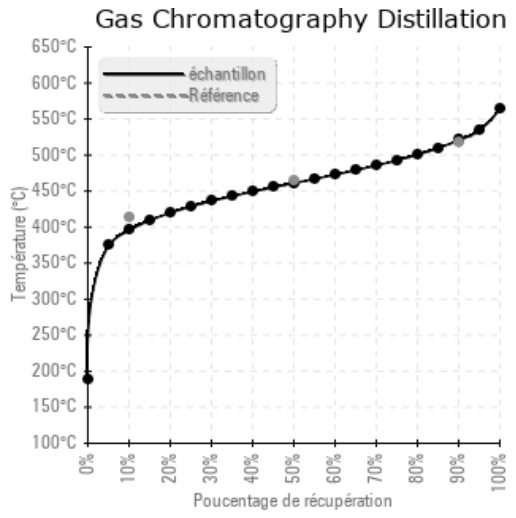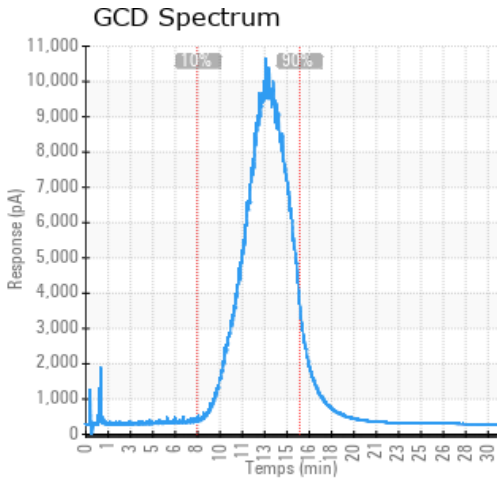

Historical Comments

Petro-Canada makes no representation or warranty of any kind, either express or implied, as to the accuracy or completeness of the analysis and assumes no responsibility and shall have no liability whatsoever with respect to such analysis, or a party's use of it. Petro-Canada is a division of HollyFrontier Corporation.