


OIL ANALYSIS REPORT



Area
[WO#49346]
Machine Id
PUD G DIESEL
Component
Diesel Engine
Fluid
SAE 15W40 (50 GAL)

Sample Rating Trend

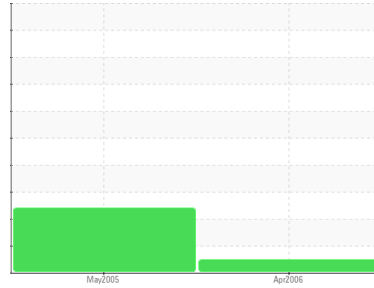

NORMAL

DIAGNOSIS

- Recommendation**
Resample at the next service interval to monitor.
- Wear**
All component wear rates are normal.
- Contamination**
There is no indication of any contamination in the component.
- Fluid Condition**
The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PC293271	WC651215	---
Sample Date	Client Info		26 Apr 2006	02 May 2005	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			NORMAL	ABNORMAL	---

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method		<1.0	<1.0	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	41	37	---
Chromium	ppm	ASTM D5185(m)	8	6	---
Nickel	ppm	ASTM D5185(m)	0	<1	---
Titanium	ppm	ASTM D5185(m)	<1	<1	---
Silver	ppm	ASTM D5185(m)	0	<1	---
Aluminum	ppm	ASTM D5185(m)	2	3	---
Lead	ppm	ASTM D5185(m)	5	8	---
Copper	ppm	ASTM D5185(m)	4	82	---
Tin	ppm	ASTM D5185(m)	<1	<1	---
Vanadium	ppm	ASTM D5185(m)	0	<1	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	188	150	---
Barium	ppm	ASTM D5185(m)	34	49	---
Molybdenum	ppm	ASTM D5185(m)	10	10	---
Manganese	ppm	ASTM D5185(m)	<1	<1	---
Magnesium	ppm	ASTM D5185(m)	239	237	---
Calcium	ppm	ASTM D5185(m)	2280	1997	---
Phosphorus	ppm	ASTM D5185(m)	1115	899	---
Zinc	ppm	ASTM D5185(m)	1240	1002	---
Sulfur	ppm	ASTM D5185(m)	4299	3581	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	5	7	---
Sodium	ppm	ASTM D5185(m)	27	▲ 31	---
Potassium	ppm	ASTM D5185(m)	0	▲ 1	---
Glycol	%	ASTM D7922*	0.0	▲ 0.10	---


INFRA-RED

	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	0	0	---
Nitration	Abs/cm	ASTM D7624*	7	8	---
Sulfation	Abs/.1mm	ASTM D7415*	22	22	---


FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	15	14	---
Base Number (BN)	mg KOH/g	ASTM D2896*	7.58	6.23	---


OIL ANALYSIS REPORT

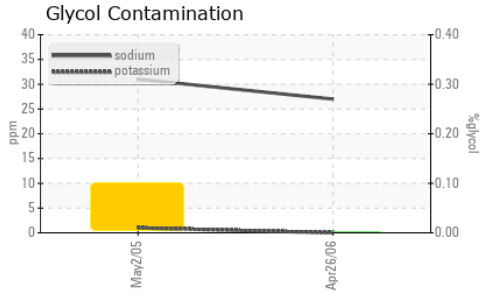


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	NEG	▲ 0.1%	---
Free Water	scalar	Visual*	NEG	▲ 0.1	---

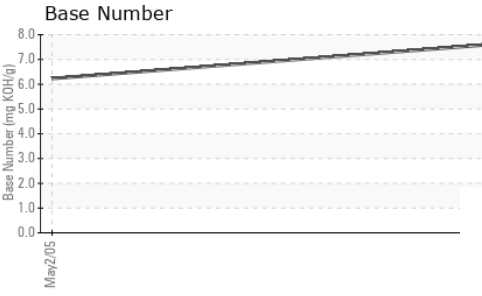

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	13.6	13.1	---

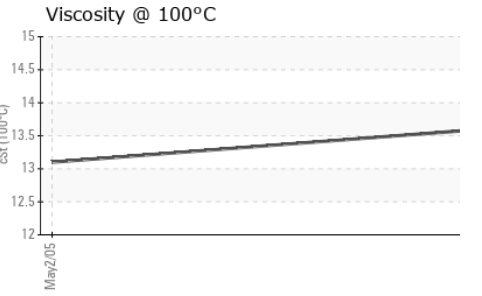

GRAPHS

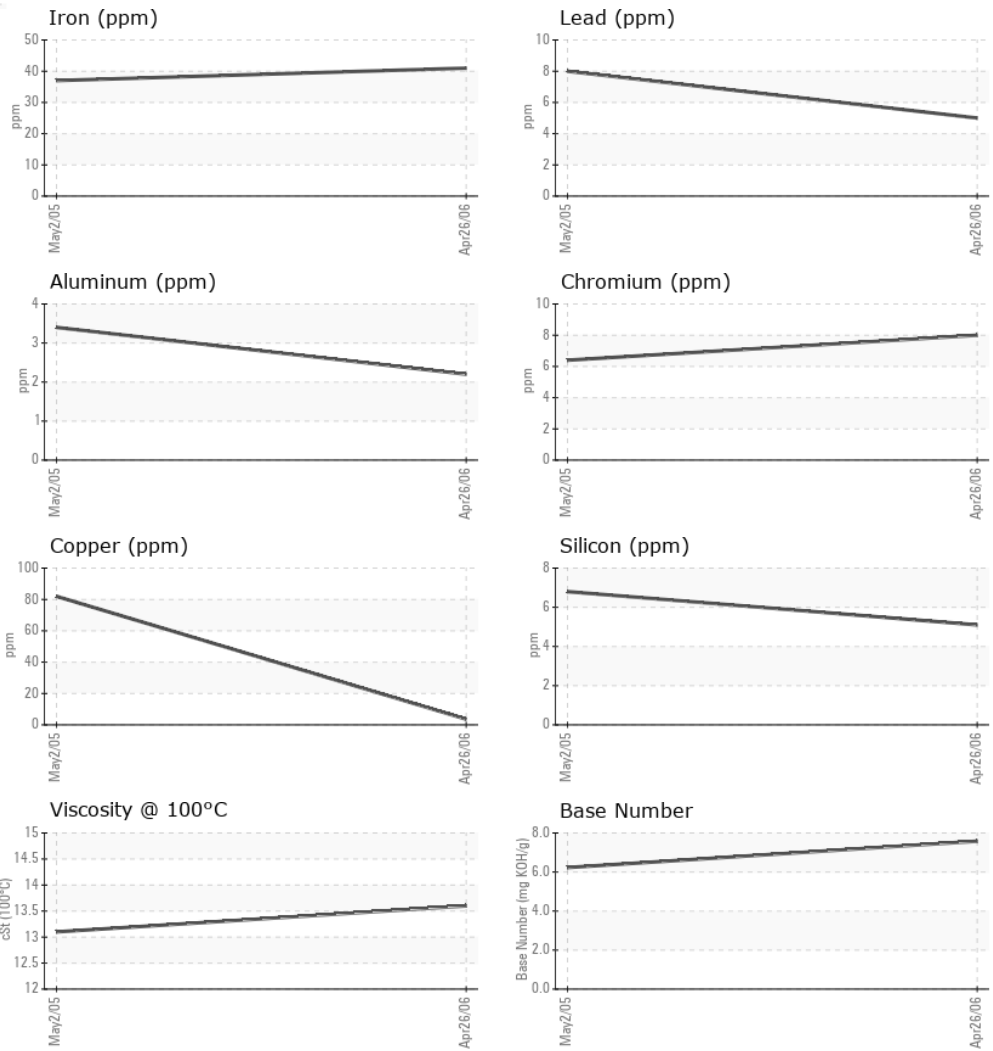

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC293271 **Received** : 17 May 2006
Lab Number : 01298403 **Diagnosed** : 18 May 2006
Unique Number : 2228719 **Diagnostician** :
Test Package : MOB 2 (Additional Tests: SCREEN)

NEWFOUNDLAND POWER INC.
 50 DUFFY PLACE, PO BOX 8910
 ST. JOHNS, NL
 CA A1B 3P6
 Contact: Shane Reid
 sreid@newfoundlandpower.com
 T: (709)737-5209
 F: (709)737-2926

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.