


Area  
**Main Power Generation [71129286]**  
Machine Id  
**Generator - MPG (Port) Lube Oil System (S/N Sample Tag XX-80201-S1)**  
Component  
**Turbine**  
Fluid  
**PETRO CANADA TURBOFLO 32 (8300 LTR)**

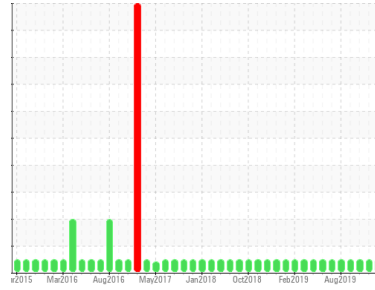

**DIAGNOSIS**

**Recommendation**  
Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using Advanced Oil Monitoring (AOM) kits for this system. The AOM test package includes advanced level testing to determine the suitability of turbine and large industrial compressor oils for continued use.

**Wear**  
All component wear rates are normal.

**Contamination**  
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

**Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service (unconfirmed).

**SAMPLE INFORMATION**

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PC0016330</b>	PC	PC0018556
Sample Date	Client Info	<b>06 Dec 2019</b>	03 Nov 2019	07 Oct 2019
Machine Age	hrs	<b>0</b>	0	0
Oil Age	hrs	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

**CONTAMINATION**

method	limit/base	current	history1	history2
Water	WC Method >0.03	<b>NEG</b>	NEG	NEG

**WEAR METALS**

method	limit/base	current	history1	history2
PQ	ASTM D8184*	<b>0</b>	7	5
Iron	ppm ASTM D5185(m) >15	<b>&lt;1</b>	<1	<1
Chromium	ppm ASTM D5185(m) >4	<b>0</b>	0	0
Nickel	ppm ASTM D5185(m) >2	<b>0</b>	0	0
Titanium	ppm ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm ASTM D5185(m)	<b>&lt;1</b>	0	0
Aluminum	ppm ASTM D5185(m) >10	<b>0</b>	0	0
Lead	ppm ASTM D5185(m)	<b>0</b>	0	0
Copper	ppm ASTM D5185(m) >5	<b>&lt;1</b>	<1	<1
Tin	ppm ASTM D5185(m) >5	<b>0</b>	0	0
Antimony	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Vanadium	ppm ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm ASTM D5185(m)	<b>0</b>	0	0






**ADDITIVES**

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Barium	ppm ASTM D5185(m) 0	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm ASTM D5185(m) 0	<b>1</b>	<1	0
Calcium	ppm ASTM D5185(m) 0	<b>&lt;1</b>	<1	<1
Phosphorus	ppm ASTM D5185(m) 120	<b>254</b>	266	265
Zinc	ppm ASTM D5185(m) 0.0	<b>2</b>	<1	<1
Sulfur	ppm ASTM D5185(m) 0	<b>495</b>	537	509
Lithium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1

**CONTAMINANTS**

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >15	<b>&lt;1</b>	<1	<1
Sodium	ppm ASTM D5185(m)	<b>0</b>	0	0
Potassium	ppm ASTM D5185(m) >20	<b>&lt;1</b>	<1	<1

# OIL ANALYSIS REPORT

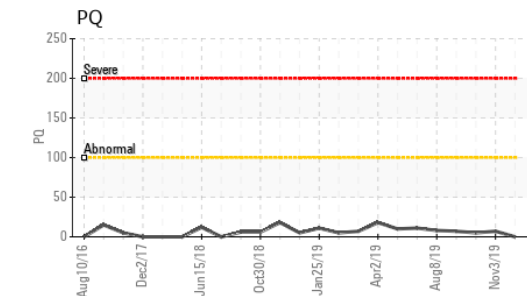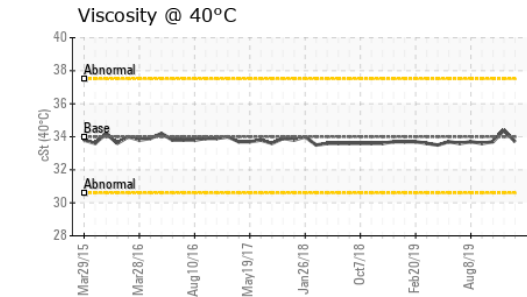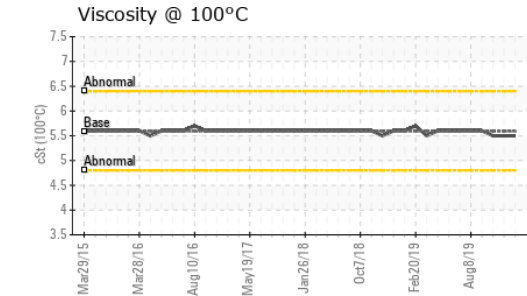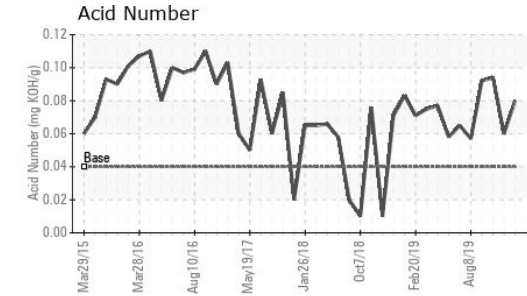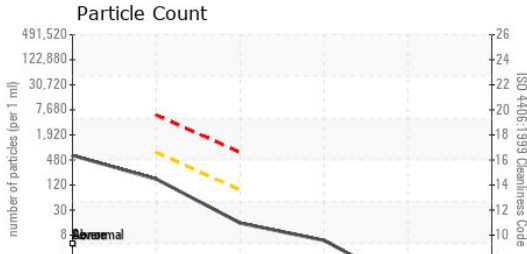

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647			<b>542</b>	792	627
Particles >6µm	ASTM D7647	>640		<b>147</b>	224	196
Particles >14µm	ASTM D7647	>80		<b>13</b>	18	22
Particles >21µm	ASTM D7647	>20		<b>5</b>	4	9
Particles >38µm	ASTM D7647	>4		<b>0</b>	0	0
Particles >71µm	ASTM D7647	>3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>--/16/13		<b>16/14/11</b>	17/15/11	16/15/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.04	<b>0.080</b>	0.060	0.094

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.03	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	34.0	<b>33.7</b>	34.4	33.7
Visc @ 100°C	cSt	ASTM D7279(m)	5.59	<b>5.5</b>	5.5	5.5
Viscosity Index (VI)	Scale	ASTM D2270*	110	<b>97</b>	93	97

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color					no image	
Bottom						
MPC				no image	no image	



**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0016330  
**Lab Number** : **02326909**  
**Unique Number** : 4978212  
**Test Package** : MAR 2 ( Additional Tests: KV100, PQ, TAN Man, VI )  
**Received** : 13 Dec 2019  
**Diagnosed** : 16 Dec 2019  
**Diagnostician** : Kevin Marson

**Suncor - Terra Nova Projects**  
 Scotia Centre, 235 Water Street  
 St. John's, NL  
 CA A1C 1B6  
 Contact: Josh Hynes  
 joshhynes@suncor.com  
 T: (709)778-3575  
 F: (709)724-2835

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.