


Machine Id
DRYER DEPT 3 (S/N 18029)
Component
Reciprocating Compressor
Fluid
FRIGOSPEC (16 LTR)

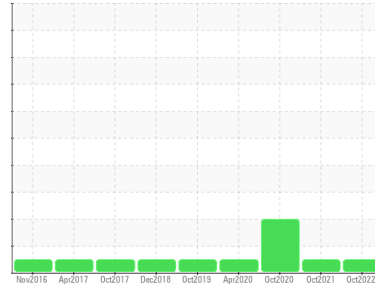

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PC0061765	PC0051877	PC0022577
Sample Date	Client Info			18 Oct 2022	27 Oct 2021	18 Oct 2020
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	ABNORMAL






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0	0	24
Iron	ppm	ASTM D5185(m)	>50	1	2	▲ 83
Chromium	ppm	ASTM D5185(m)	>10	0	<1	2
Nickel	ppm	ASTM D5185(m)		0	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	<1	<1
Aluminum	ppm	ASTM D5185(m)	>25	0	<1	1
Lead	ppm	ASTM D5185(m)	>25	0	0	6
Copper	ppm	ASTM D5185(m)	>50	<1	1	▲ 28
Tin	ppm	ASTM D5185(m)	>15	0	<1	4
Antimony	ppm	ASTM D5185(m)		<1	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		0	0	<1
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	<1
Magnesium	ppm	ASTM D5185(m)		<1	0	<1
Calcium	ppm	ASTM D5185(m)		0	0	65
Phosphorus	ppm	ASTM D5185(m)		0	0	24
Zinc	ppm	ASTM D5185(m)		<1	<1	11
Sulfur	ppm	ASTM D5185(m)		30	18	178
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	0	0	4
Sodium	ppm	ASTM D5185(m)		0	0	2
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Water	%	ASTM D6304*	>0.1	0.001	---	0.009
ppm Water	ppm	ASTM D6304*	>1000	10.3	---	91.7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.03	0.01	0.09

OIL ANALYSIS REPORT

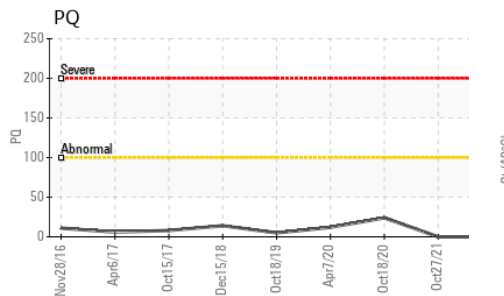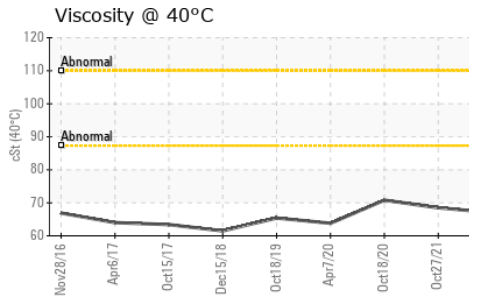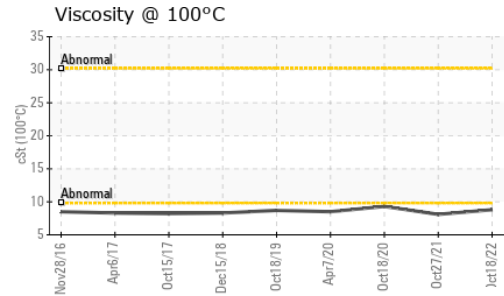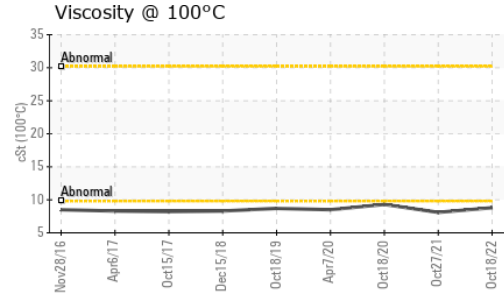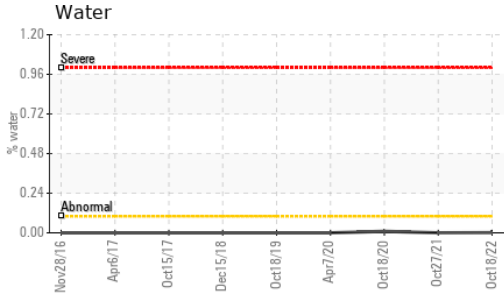

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	LIGHT
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	▲ LTMOD
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	AMMON
Emulsified Water	scalar	Visual*	>0.1	NEG	.2%
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	67.0	68.5	70.8
Visc @ 100°C	cSt	ASTM D7279(m)	8.8	8.1	9.3
Viscosity Index (VI)	Scale	ASTM D2270*	103	81	107

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS	
<p>Ferrous Alloys</p>	<p>PQ</p>
<p>Non-ferrous Metals</p>	<p>Acid Number</p>
<p>Viscosity @ 40°C</p>	



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0061765 **Received** : 19 Oct 2022
Lab Number : 02517159 **Diagnosed** : 20 Oct 2022
Unique Number : 5474139 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: KF, KV100, TAN Man, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

SAPUTO FOODS LTD
 284 HOPE STREET WEST
 TAVISTOCK, ON
 CA N0B 2R0
 Contact: Joseph Ross
 joseph.ross@saputo.com
 T: (519)655-2337
 F: (519)655-3449