


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

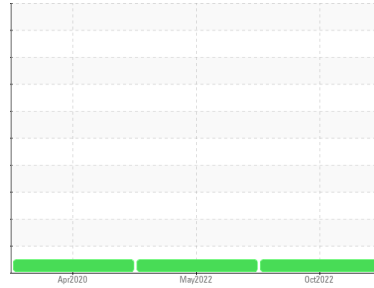

Machine Id  
**COMPRESSOR #4, PACKAGING, NH (S/N E0405)**  
Component  
**Reciprocating Compressor**  
Fluid  
**PETRO CANADA REFLO 68A AMMONIA OIL (35 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The water content is negligible. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>PC0061759</b>	PC0058456	PC0022585
Sample Date	Client Info	<b>17 Oct 2022</b>	04 May 2022	07 Apr 2020
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	<b>0</b>	0	5
Iron	ppm ASTM D5185(m) >50	<b>&lt;1</b>	5	3
Chromium	ppm ASTM D5185(m) >10	<b>0</b>	0	0
Nickel	ppm ASTM D5185(m)	<b>0</b>	0	<1
Titanium	ppm ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm ASTM D5185(m)	<b>0</b>	0	0
Aluminum	ppm ASTM D5185(m) >25	<b>0</b>	0	<1
Lead	ppm ASTM D5185(m) >25	<b>&lt;1</b>	0	0
Copper	ppm ASTM D5185(m) >50	<b>0</b>	<1	<1
Tin	ppm ASTM D5185(m) >15	<b>0</b>	<1	0
Antimony	ppm ASTM D5185(m)	<b>&lt;1</b>	0	<1
Vanadium	ppm ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 0	<b>&lt;1</b>	0	<1
Barium	ppm ASTM D5185(m) 0	<b>0</b>	0	<1
Molybdenum	ppm ASTM D5185(m) 0	<b>0</b>	0	0
Manganese	ppm ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm ASTM D5185(m) 0	<b>0</b>	0	0
Calcium	ppm ASTM D5185(m) 0	<b>1</b>	8	2
Phosphorus	ppm ASTM D5185(m) 0	<b>0</b>	0	0
Zinc	ppm ASTM D5185(m) 0	<b>&lt;1</b>	2	1
Sulfur	ppm ASTM D5185(m) 0	<b>32</b>	28	60
Lithium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1






## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	<b>&lt;1</b>	<1	<1
Sodium	ppm ASTM D5185(m)	<b>0</b>	0	0
Potassium	ppm ASTM D5185(m) >20	<b>&lt;1</b>	0	<1
Water	% ASTM D6304* >0.1	<b>0.001</b>	0.003	0.001
ppm Water	ppm ASTM D6304* >1000	<b>8.8</b>	30.7	7.5

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974* 0.05	<b>0.01</b>	0.05	0.04

# OIL ANALYSIS REPORT

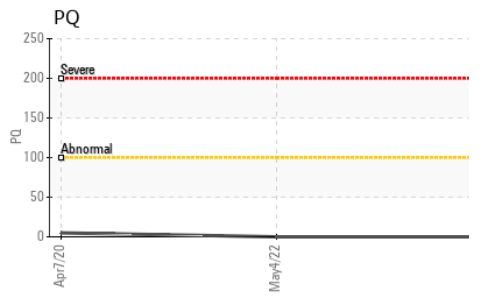
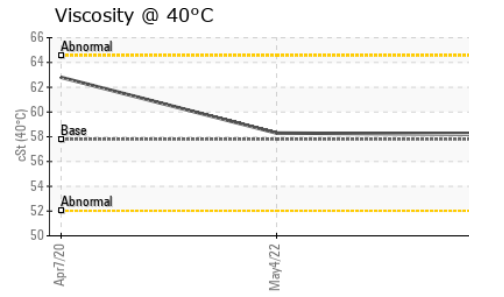
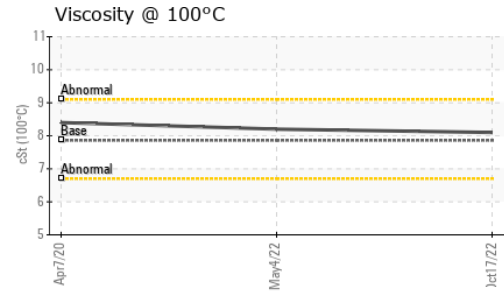
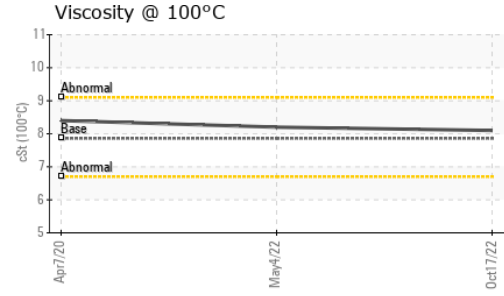
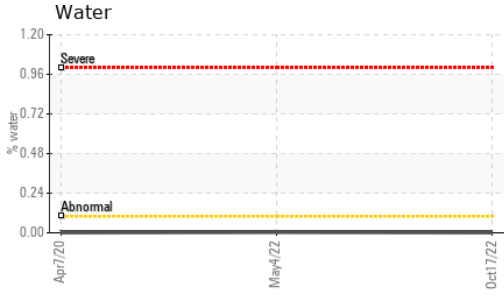


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	57.8	58.2	58.3
Visc @ 100°C	cSt	ASTM D7279(m)	7.86	8.1	8.2
Viscosity Index (VI)	Scale	ASTM D2270*	101	106	109

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

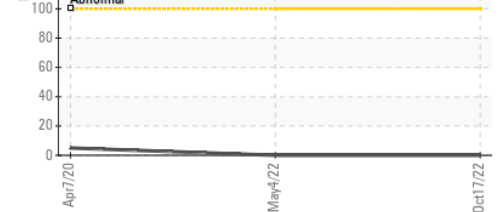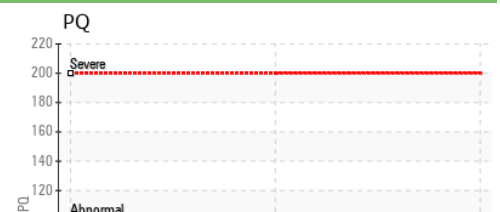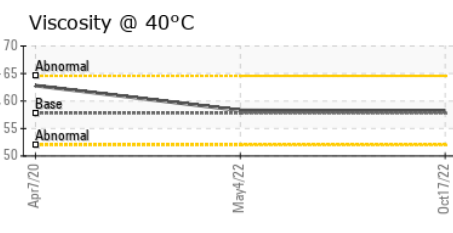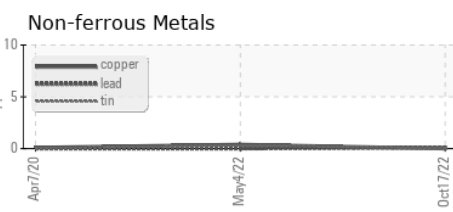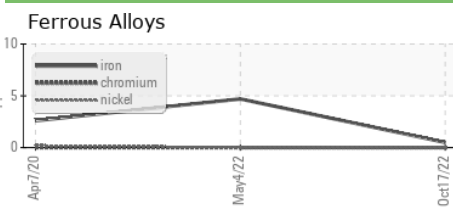

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0061759 **Received** : 19 Oct 2022  
**Lab Number** : 02517160 **Diagnosed** : 20 Oct 2022  
**Unique Number** : 5474140 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, TAN Man, VI )

**SAPUTO FOODS LTD**  
 284 HOPE STREET WEST  
 TAVISTOCK, ON  
 CA N0B 2R0  
 Contact: Joseph Ross  
 joseph.ross@saputo.com  
 T: (519)655-2337  
 F: (519)655-3449

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.