




OIL ANALYSIS REPORT

Sample Rating Trend

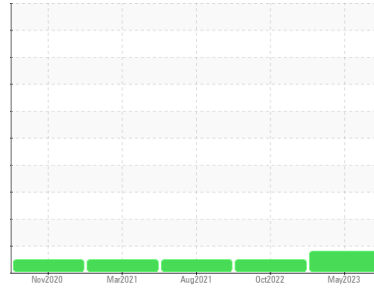

WEAR



Machine Id

8104

Component

Natural Gas Engine

Fluid

PETRO CANADA DURON GEO LD 15W40 (--- LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

Lead ppm levels are noted. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GFL0055422	GFL0055403	GFL0025616
Sample Date	Client Info		16 May 2023	26 Oct 2022	27 Aug 2021
Machine Age	hrs	Client Info	13945	13945	9255
Oil Age	hrs	Client Info	13945	13945	600
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			ATTENTION	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>50	13	6	27
Chromium	ppm	ASTM D5185(m)	>4	1	<1	2
Nickel	ppm	ASTM D5185(m)	>2	<1	0	1
Titanium	ppm	ASTM D5185(m)		<1	<1	0
Silver	ppm	ASTM D5185(m)	>3	0	0	<1
Aluminum	ppm	ASTM D5185(m)	>9	1	1	4
Lead	ppm	ASTM D5185(m)	>30	▲ 17	<1	2
Copper	ppm	ASTM D5185(m)	>35	7	10	18
Tin	ppm	ASTM D5185(m)	>4	<1	0	<1
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	50	9	32	3
Barium	ppm	ASTM D5185(m)	5	0	0	0
Molybdenum	ppm	ASTM D5185(m)	50	55	50	57
Manganese	ppm	ASTM D5185(m)	0	<1	<1	<1
Magnesium	ppm	ASTM D5185(m)	560	539	539	526
Calcium	ppm	ASTM D5185(m)	1510	1690	1509	1627
Phosphorus	ppm	ASTM D5185(m)	780	726	784	763
Zinc	ppm	ASTM D5185(m)	870	902	847	945
Sulfur	ppm	ASTM D5185(m)	2040	1999	2046	2008
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>+100	5	9	19
Sodium	ppm	ASTM D5185(m)		3	2	4
Potassium	ppm	ASTM D5185(m)	>20	0	0	1

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		0	0	0
Nitration	Abs/cm	ASTM D7624*	>20	12.3	8.3	12.2
Sulfation	Abs/.1mm	ASTM D7415*	>30	25.6	19.9	25.3


FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs/.1mm	ASTM D7414*	>25	21.7	16.6	20.5



OIL ANALYSIS REPORT

▲ Non-ferrous Metals









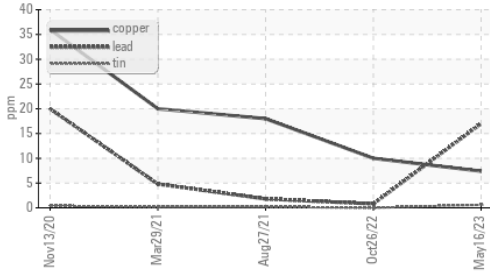


VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.1	14.4	14.0

GRAPHS

Viscosity @ 100°C

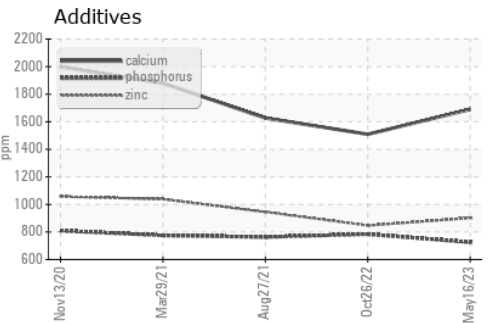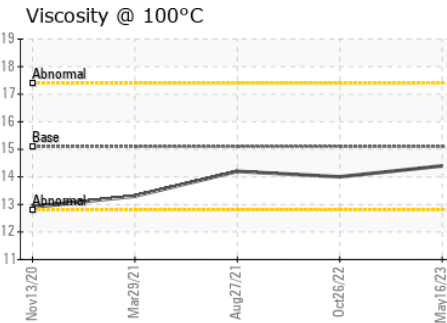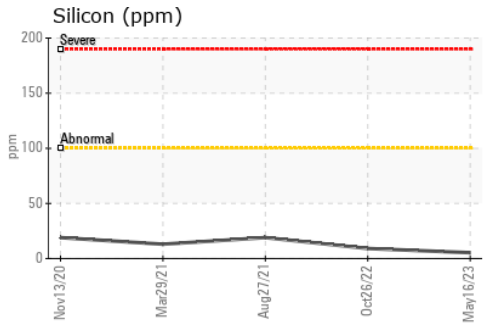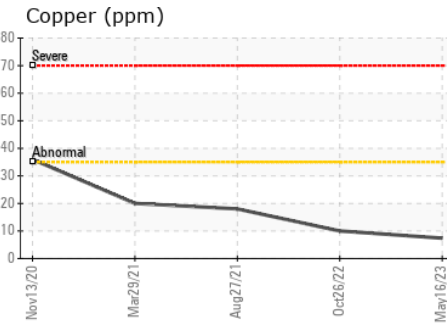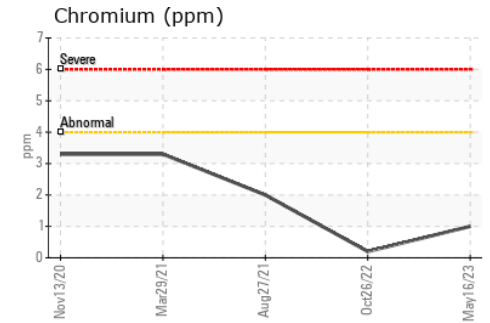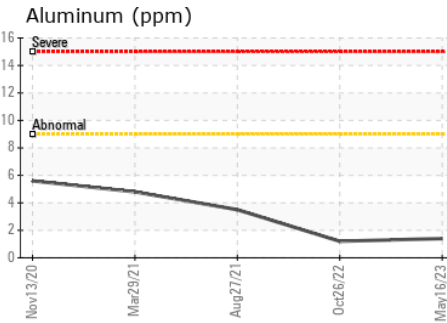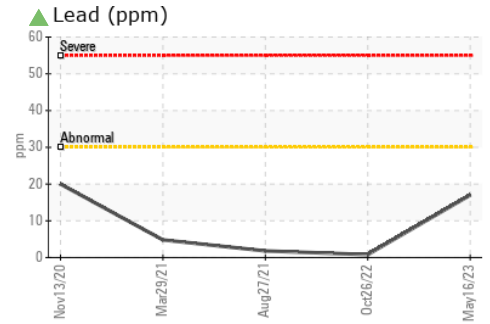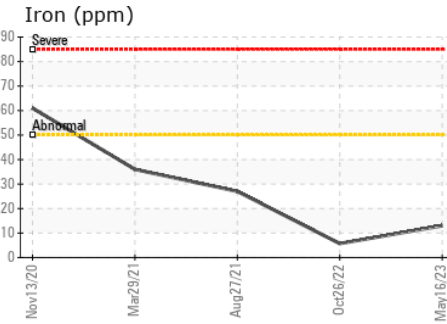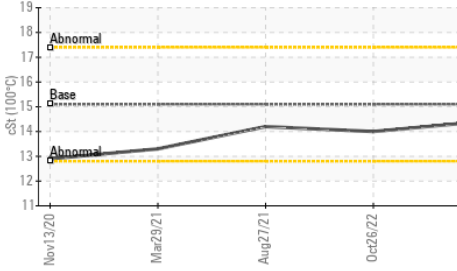

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 GFL Environmental - 9998 - Moved No Longer Used Units
Sample No. : GFL0055422 **Received** : 17 May 2023 **CANADIAN UNITS**
Lab Number : 02558023 **Diagnosed** : 17 May 2023
Unique Number : 5579063 **Diagnostician** : Kevin Marson CA
Test Package : MOB 1 **Contact:** Service Manager

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.