


Area
Main Power Generation [450150565]
Machine Id
Generator - MPG (Port) Lube Oil System (S/N Sample Tag XX-80201-S1)
Component
Turbine
Fluid
PETRO CANADA TURBOFLO 32 (8300 LTR)

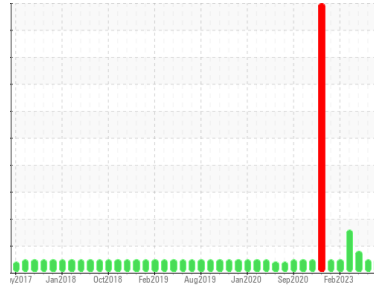

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using IND 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

Wear
Component wear rates appear to be normal (unconfirmed).

Contamination
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number			PC	PC	PC0052260
Sample Date			25 May 2023	24 Apr 2023	13 Mar 2023
Machine Age	hrs		0	0	0
Oil Age	hrs		0	0	0
Oil Changed			N/A	N/A	N/A
Sample Status			NORMAL	NORMAL	ATTENTION

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.03	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		0	0	0
Iron	ppm ASTM D5185(m)	>15	<1	<1	<1
Chromium	ppm ASTM D5185(m)	>4	0	0	0
Nickel	ppm ASTM D5185(m)	>2	0	0	0
Titanium	ppm ASTM D5185(m)		0	0	0
Silver	ppm ASTM D5185(m)		0	0	0
Aluminum	ppm ASTM D5185(m)	>10	0	0	0
Lead	ppm ASTM D5185(m)		0	0	0
Copper	ppm ASTM D5185(m)	>5	<1	<1	<1
Tin	ppm ASTM D5185(m)	>5	1	1	<1
Antimony	ppm ASTM D5185(m)		<1	<1	0
Vanadium	ppm ASTM D5185(m)		0	0	0
Beryllium	ppm ASTM D5185(m)		0	0	0
Cadmium	ppm ASTM D5185(m)		0	0	0






ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	0	0	0	<1
Barium	ppm ASTM D5185(m)	0	0	0	0
Molybdenum	ppm ASTM D5185(m)	0	0	0	0
Manganese	ppm ASTM D5185(m)		0	0	0
Magnesium	ppm ASTM D5185(m)	0	0	0	0
Calcium	ppm ASTM D5185(m)	0	0	0	0
Phosphorus	ppm ASTM D5185(m)	120	292	280	▲ 280
Zinc	ppm ASTM D5185(m)	0.0	<1	<1	<1
Sulfur	ppm ASTM D5185(m)	0	529	505	▲ 510
Lithium	ppm ASTM D5185(m)		<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m)	>15	<1	<1	<1
Sodium	ppm ASTM D5185(m)		0	<1	0
Potassium	ppm ASTM D5185(m)	>20	0	0	0

OIL ANALYSIS REPORT

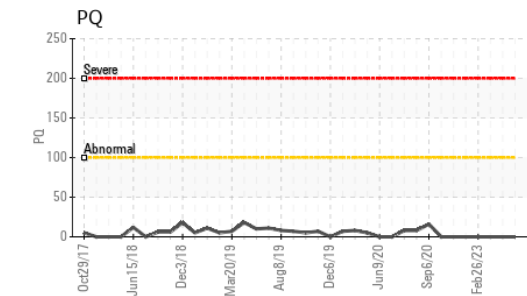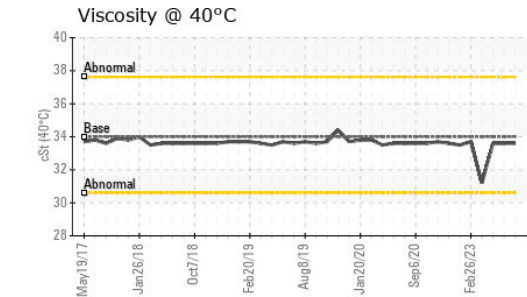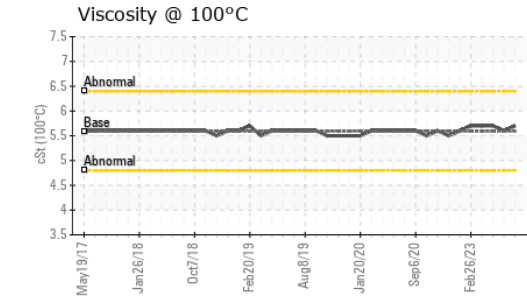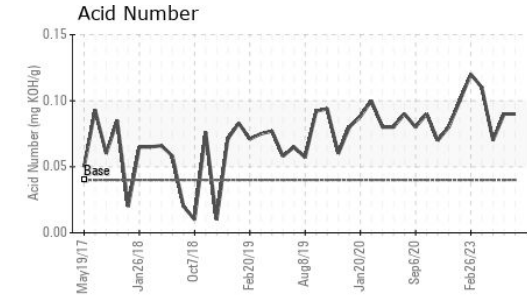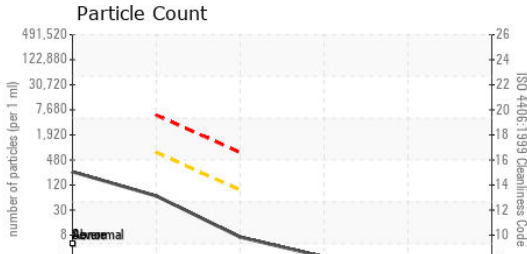

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647			220	232	1046
Particles >6µm	ASTM D7647	>640		58	68	194
Particles >14µm	ASTM D7647	>80		6	7	8
Particles >21µm	ASTM D7647	>20		2	2	3
Particles >38µm	ASTM D7647	>4		0	0	1
Particles >71µm	ASTM D7647	>3		0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/16/13		15/13/10	15/13/10	17/15/10

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.04	0.09	0.09	0.07

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.03	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	34.0	33.6	33.6	33.6
Visc @ 100°C	cSt	ASTM D7279(m)	5.59	5.7	5.6	5.7
Viscosity Index (VI)	Scale	ASTM D2270*	110	109	103	109

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC
Lab Number : **02563511** **Received** : 12 Jun 2023
Unique Number : 5592552 **Diagnosed** : 13 Jun 2023
Test Package : MAR 2 (Additional Tests: KV100, PQ, TAN Man, VI) **Diagnostician** : Kevin Marson

Suncor - Terra Nova Projects
 Scotia Centre, 235 Water Street
 St. John's, NL
 CA A1C 1B6
 Contact: Josh Hynes
 joshynes@suncor.com
 T: (709)778-3575
 F: (709)724-2835

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.