


# PROBLEM SUMMARY

Sample Rating Trend




ISO

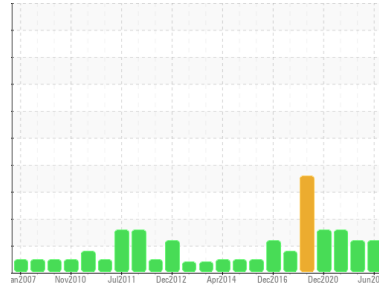

Area  
**1460**  
Machine Id  
**1460-5652-4014 - HGNI CONCENTRATE TANK 1 AGITATOR**  
Component  
**Gearbox**  
Fluid  
**PETRO CANADA ENDURATEX SYNTHETIC EP 220 (100 LTR)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

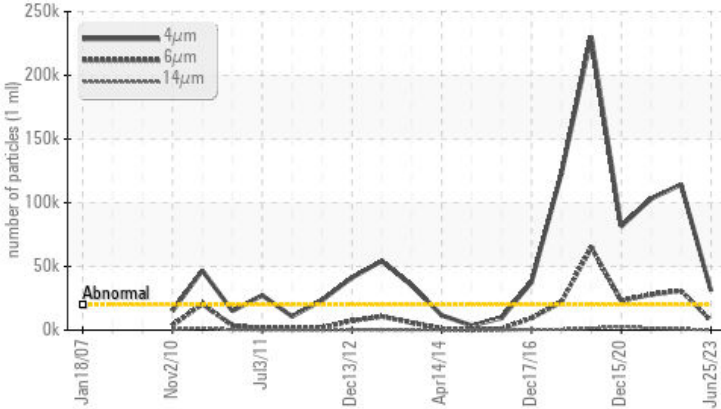

## RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ATTENTION</b>	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>20000	▲ <b>30977</b>	▲ 114322	▲ 103193
Particles >6µm	ASTM D7647	>5000	▲ <b>7545</b>	▲ 30946	▲ 28029
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ <b>22/20/15</b>	▲ 24/22/17	▲ 24/22/18

Customer Id: INCVOS  
Sample No.: PC0057978  
Lab Number: 02568903  
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
Wes Davis +1 905-569-8600 x223  
[wesd@wearcheck.ca](mailto:wesd@wearcheck.ca)

To change component or sample information:  
Gloria Gonzalez +1 (289)291-4643 x4643  
[gloria.gonzalez@wearcheck.com](mailto:gloria.gonzalez@wearcheck.com)

## RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

## HISTORICAL DIAGNOSIS

### 24 Jun 2021 Diag: Wes Davis

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >4µm are abnormally high. Particles >6µm are abnormally high. Particles >14µm are notably high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 20 Jun 2021 Diag: Wes Davis

ISO



We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >14µm are abnormally high. Particles >4µm are abnormally high. Particles >6µm are abnormally high. Particles >21µm are notably high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 15 Dec 2020 Diag: Wes Davis

ISO




We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >14µm are abnormally high. Particles >21µm are abnormally high. Particles >4µm are abnormally high. Particles >6µm are abnormally high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Area  
**1460**  
Machine Id  
**1460-5652-4014 - HGNI CONCENTRATE TANK 1 AGITATOR**  
Component  
**Gearbox**  
Fluid  
**PETRO CANADA ENDURATEX SYNTHETIC EP 220 (100 LTR)**

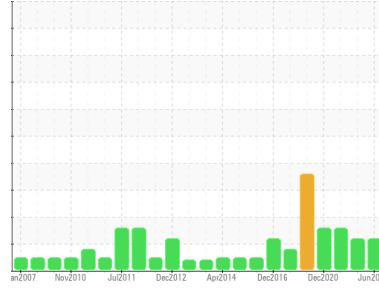

## DIAGNOSIS

### Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a light amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history 1	history 2
Sample Number	Client Info	<b>PC0057978</b>	PC0030074	PC0040206
Sample Date	Client Info	<b>25 Jun 2023</b>	24 Jun 2021	20 Jun 2021
Machine Age	yrs Client Info	<b>0</b>	0	0
Oil Age	yrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>ATTENTION</b>	ABNORMAL	ABNORMAL

## WEAR METALS

method	limit/base	current	history 1	history 2
PQ	ASTM D8184*	<b>0</b>	0	0
Iron	ppm ASTM D5185(m) >200	<b>2</b>	3	4
Chromium	ppm ASTM D5185(m) >15	<b>0</b>	0	0
Nickel	ppm ASTM D5185(m) >15	<b>&lt;1</b>	<1	<1
Titanium	ppm ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm ASTM D5185(m)	<b>0</b>	0	<1
Aluminum	ppm ASTM D5185(m) >25	<b>&lt;1</b>	<1	<1
Lead	ppm ASTM D5185(m) >100	<b>&lt;1</b>	1	<1
Copper	ppm ASTM D5185(m) >200	<b>&lt;1</b>	<1	<1
Tin	ppm ASTM D5185(m) >25	<b>0</b>	0	<1
Antimony	ppm ASTM D5185(m) >5	<b>0</b>	0	0
Vanadium	ppm ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm ASTM D5185(m)	<b>0</b>	0	0

## ADDITIVES

method	limit/base	current	history 1	history 2
Boron	ppm ASTM D5185(m) 33	<b>28</b>	25	23
Barium	ppm ASTM D5185(m) 5	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185(m)	<b>0</b>	0	0
Manganese	ppm ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm ASTM D5185(m) 5	<b>&lt;1</b>	<1	<1
Calcium	ppm ASTM D5185(m) 5	<b>4</b>	4	4
Phosphorus	ppm ASTM D5185(m) 437	<b>339</b>	348	320
Zinc	ppm ASTM D5185(m) 5	<b>11</b>	9	9
Sulfur	ppm ASTM D5185(m) 5000	<b>4712</b>	4930	4903
Lithium	ppm ASTM D5185(m)	<b>4</b>	2	3






## CONTAMINANTS

method	limit/base	current	history 1	history 2
Silicon	ppm ASTM D5185(m) >50	<b>11</b>	12	8
Sodium	ppm ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Potassium	ppm ASTM D5185(m) >20	<b>&lt;1</b>	0	<1

## FLUID CLEANLINESS

method	limit/base	current	history 1	history 2
Particles >4µm	ASTM D7647 >20000	<b>▲ 30977</b>	▲ 114322	▲ 103193
Particles >6µm	ASTM D7647 >5000	<b>▲ 7545</b>	▲ 30946	▲ 28029
Particles >14µm	ASTM D7647 >640	<b>233</b>	▲ 839	▲ 1580
Particles >21µm	ASTM D7647 >160	<b>37</b>	133	▲ 289
Particles >38µm	ASTM D7647 >40	<b>1</b>	0	3
Particles >71µm	ASTM D7647 >10	<b>1</b>	0	0
Oil Cleanliness	ISO 4406 (c) >21/19/16	<b>▲ 22/20/15</b>	▲ 24/22/17	▲ 24/22/18

# OIL ANALYSIS REPORT

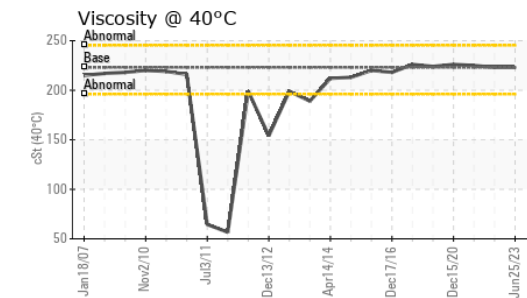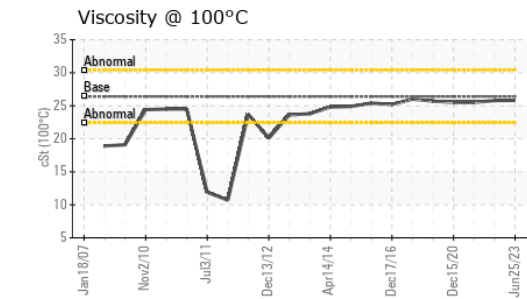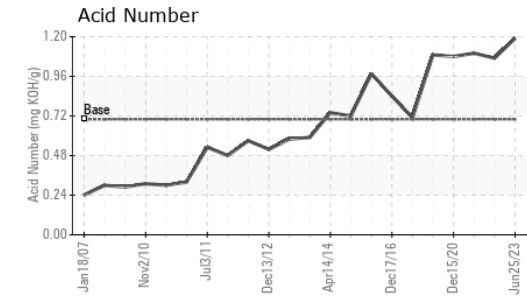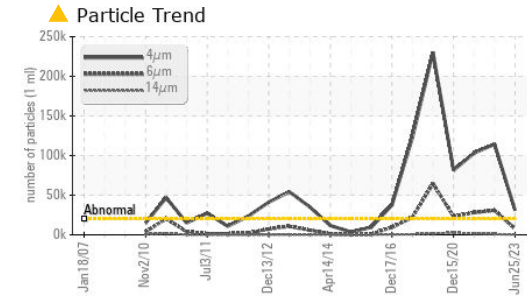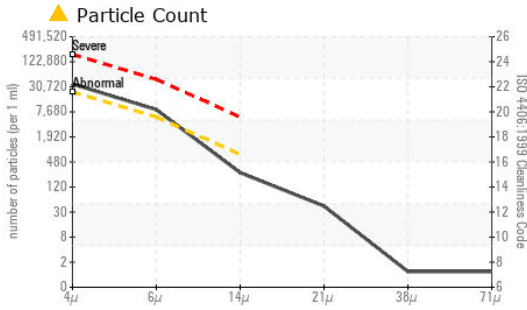

ISO 17025:2017  
Accredited  
Laboratory

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0057978 **Received** : 10 Jul 2023  
**Lab Number** : 02568903 **Diagnosed** : 11 Jul 2023  
**Unique Number** : 5605949 **Diagnostician** : Wes Davis  
**Test Package** : IND 2 ( Additional Tests: KV100, PQ, PrtCount, TAN Man, VI )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Vale - Voisey's Bay**  
 Voisey's Bay Mine Site, P.O. Box 7001, Str. C Happy Valley  
 Goose Bay, NL  
 CA A0P 1C0  
 Contact: Robert Feltham  
 robert.feltham@vale.com

T:  
F: x:

FLUID DEGRADATION						
	method	limit/base	current	history 1	history 2	
Acid Number (AN)	mg KOH/g	ASTM D974*	0.7	<b>1.19</b>	1.07	1.10
VISUAL						
	method	limit/base	current	history 1	history 2	
White Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	LIGHT
Yellow Metal	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	Visual*	NONE	<b>NONE</b>	LIGHT	LIGHT
Debris	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	Visual*	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	Visual*	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES						
	method	limit/base	current	history 1	history 2	
Visc @ 40°C	cSt	ASTM D7279(m)	223	<b>223</b>	223	225
Visc @ 100°C	cSt	ASTM D7279(m)	26.39	<b>25.8</b>	25.8	25.5
Viscosity Index (VI)	Scale	ASTM D2270*	151	<b>147</b>	147	144

SAMPLE IMAGES						
	method	limit/base	current	history 1	history 2	
Color						
Bottom						