

Machine Id  
**GARDNER DENVER COMP 2 (S/N 5507711)**

Component  
**2 Compressor**

Fluid  
**PETRO CANADA SYNDURO SHB ISO 68 (--- GAL)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

The water content is negligible. There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PC0070470</b>	PC0070465	PC0070466
Sample Date	Client Info			<b>12 Jul 2023</b>	29 Apr 2023	06 Mar 2023
Machine Age	hrs	Client Info		<b>32200</b>	30833	29836
Oil Age	hrs	Client Info		<b>4906</b>	499	2160
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	<1	<1
Chromium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)		<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>25	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185(m)	>25	<b>0</b>	<1	0
Copper	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m)	5.0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	5.0	<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m)	5.0	<b>&lt;1</b>	0	0
Phosphorus	ppm	ASTM D5185(m)	100	<b>76</b>	196	246
Zinc	ppm	ASTM D5185(m)	5.0	<b>2</b>	<1	1
Sulfur	ppm	ASTM D5185(m)	1900	<b>1283</b>	903	938
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>&lt;1</b>	<1	0
Sodium	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304*	>0.1	<b>0.006</b>	0.005	0.005
ppm Water	ppm	ASTM D6304*	>1000	<b>63.7</b>	54.1	55.3

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.3	<b>0.30</b>	0.29	0.28

# OIL ANALYSIS REPORT

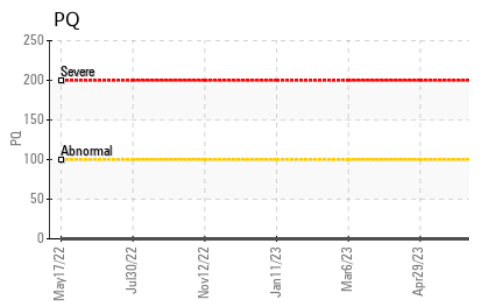
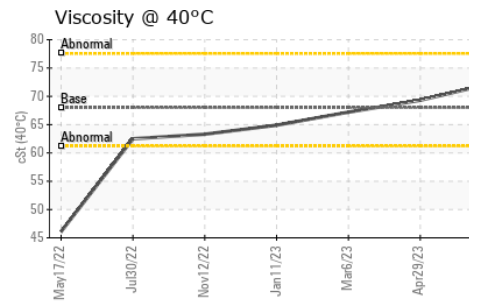
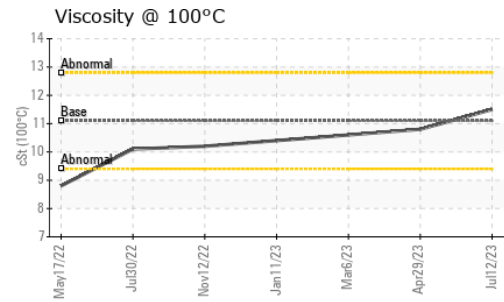
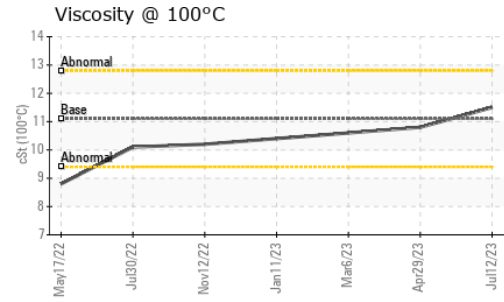
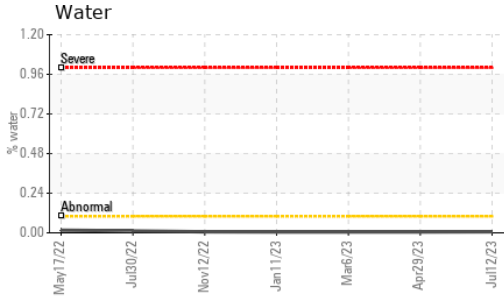


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	AMMON	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	68.0	72.3	69.3
Visc @ 100°C	cSt	ASTM D7279(m)	11.1	11.5	10.8
Viscosity Index (VI)	Scale	ASTM D2270*	155	152	145

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

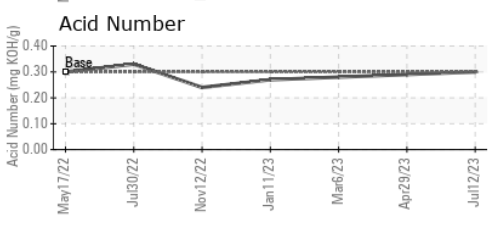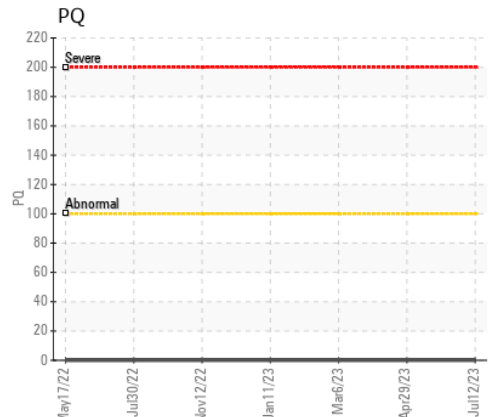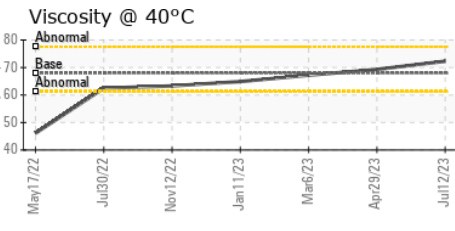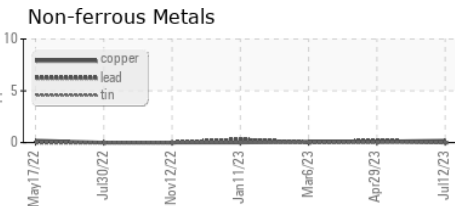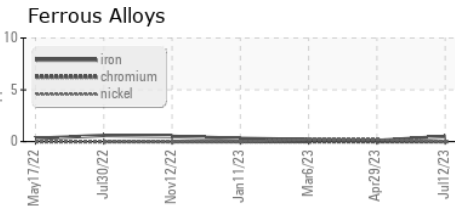

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0070470  
**Lab Number** : 02571427  
**Unique Number** : 5616478  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, TAN Man, VI )

**Powercor Manufacturing - Linamar**  
 545 Elmira Road  
 Guelph, ON  
 CA N1K 1C2  
 Contact: Quang Luong

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

T: (226)326-0125  
 F: