


OIL ANALYSIS REPORT



NORMAL



NO UNIT PC0069843

Component

Gearbox

PETRO CANADA ENDURATEX EP 220 (---

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


						,
GAL)				Aug2023		
SAMPLE INFORMA	NOITA	method	limit/base	current	history1	history2
Sample Number		Client Info		PC0069843		
Sample Date		Client Info		06 Aug 2023		
Machine Age h	ırs	Client Info		0		
Oil Age h	ırs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0		
lron p	pm	ASTM D5185(m)	>200	11		
		ASTM D5185(m)	>15	<1		
Nickel p	pm	ASTM D5185(m)	>15	0		
Titanium p	pm	ASTM D5185(m)		0		
Silver	pm	ASTM D5185(m)		0		
Aluminum p	pm	ASTM D5185(m)	>25	<1		
Lead p	pm	ASTM D5185(m)	>100	1		
Copper p	pm	ASTM D5185(m)	>200	<1		
Tin p	pm	ASTM D5185(m)	>25	0		
Antimony p	pm	ASTM D5185(m)	>5	0		
Vanadium p	pm	ASTM D5185(m)		0		
Beryllium p	pm	ASTM D5185(m)		0		
Cadmium p	pm	ASTM D5185(m)		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron p	pm	ASTM D5185(m)	60	36		
Barium p	pm	ASTM D5185(m)	0	0		
Molybdenum p	pm	ASTM D5185(m)	0	0		
Manganese p	pm	ASTM D5185(m)	0	0		
Magnesium p	pm	ASTM D5185(m)	0	<1		
Calcium	pm	ASTM D5185(m)	0	1		
Phosphorus p	pm	ASTM D5185(m)	270	403		
Zinc p	pm	ASTM D5185(m)	0	3		
Sulfur p	pm	ASTM D5185(m)	11200	5078		
Lithium p	pm	ASTM D5185(m)		<1		
CONTAMINANTS	S	method	limit/base	current	history1	history2
Silicon p	pm	ASTM D5185(m)	>50	2		
Sodium p	pm	ASTM D5185(m)		<1		
Potassium p	pm	ASTM D5185(m)	>20	<1		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN) mg KOH/g ASTM D974* 0.40

0.67



OIL ANALYSIS REPORT

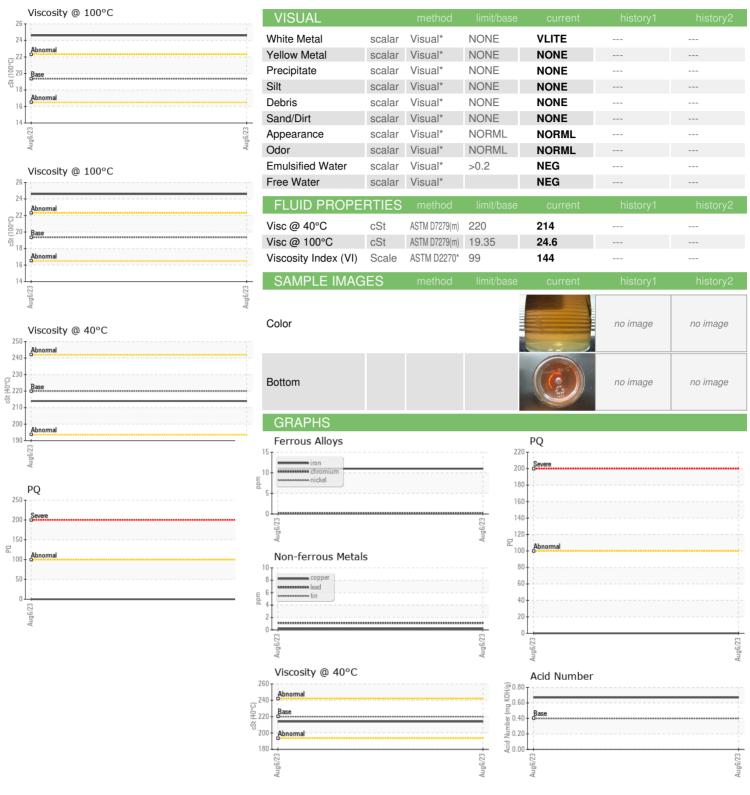



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number **Unique Number**

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9

: PC0069843 : 02579525

: 5632585

Received : 30 Aug 2023 : 31 Aug 2023 Diagnosed : Wes Davis Diagnostician

Test Package : IND 2 (Additional Tests: KV100, VI) To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

Dryden Fibre

Box 3001, 1 Duke Street Dryden, ON **CA P8N 2Z7**

Contact: Yvon St. Laurent yvon.stlaurent@domtar.com T: (807)223-9838

F: (807)223-9176