


PROBLEM SUMMARY


Area
1420
Machine Id
1420-7311-4202 - BALL MILL motor 1420-5512-4002 DE
Component
Drive End Journal Bearing
Fluid
PETRO CANADA TURBOFLO R&O 100 (10 LTR)

Sample Rating Trend

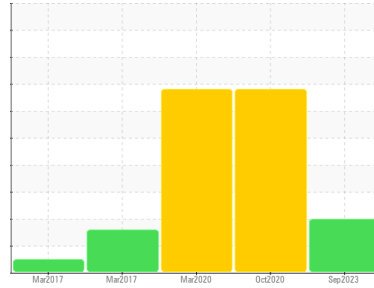

COMPONENT CONDITION SUMMARY

▲ Particle Trend

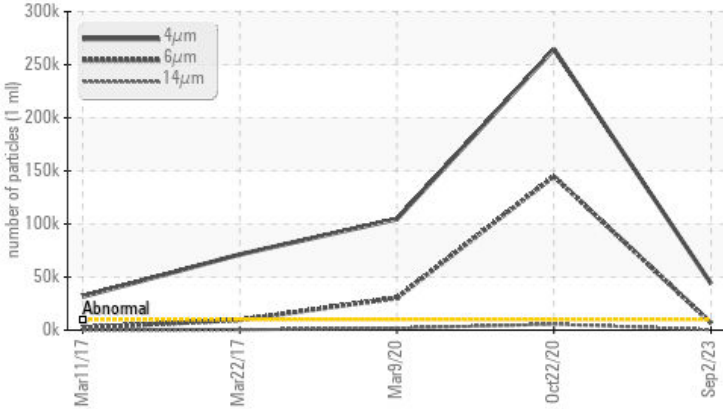

RECOMMENDATION

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	SEVERE	SEVERE
Particles >4µm	ASTM D7647	>10000	▲ 43714	● 264532	● 104547
Particles >6µm	ASTM D7647	>2500	▲ 6763	● 144800	● 30328
Particles >14µm	ASTM D7647	>160	▲ 368	● 5588	● 1833
Particles >21µm	ASTM D7647	>40	▲ 75	● 496	● 511
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 23/20/16	● 25/24/20	● 24/22/18

Customer Id: INCVOS
Sample No.: PC0070125
Lab Number: 02582829
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Bill Quesnel CLS,OMA II,MLA-III,LLA-I +1
(289)291-4641 x4641
Bill.Quesnel@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.

HISTORICAL DIAGNOSIS

22 Oct 2020 Diag: Kevin Marson

ISO



We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. All component wear rates are normal. Particles >14µm are severely high. Particles >21µm are severely high. Particles >6µm are severely high. Particles >4µm are severely high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



09 Mar 2020 Diag: Wes Davis

ISO



We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. All component wear rates are normal. Particles >14µm are severely high. Particles >21µm are severely high. Particles >6µm are severely high. Particles >4µm are severely high. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



22 Mar 2017 Diag: Wes Davis

ISO




We recommend you service the filters on this component. We recommend an early resample to monitor this condition. All component wear rates are normal. Particles >14µm are abnormally high. Particles >4µm are abnormally high. Particles >6µm are abnormally high. Oil Cleanliness is abnormal. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



Area
1420
Machine Id
1420-7311-4202 - BALL MILL motor 1420-5512-4002 DE
Component
Drive End Journal Bearing
Fluid
PETRO CANADA TURBOFLO R&O 100 (10 LTR)

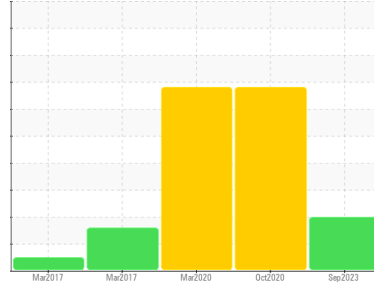

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PC0070125	PC0006089	PC384099
Sample Date	Client Info	02 Sep 2023	22 Oct 2020	09 Mar 2020
Machine Age	hrs	Client Info	0	0
Oil Age	hrs	Client Info	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		ABNORMAL	SEVERE	SEVERE

WEAR METALS

method	limit/base	current	history1	history2	
PQ	ASTM D8184*	0	16	0	
Iron	ppm	ASTM D5185(m) >60	<1	13	1
Chromium	ppm	ASTM D5185(m) >20	0	0	0
Nickel	ppm	ASTM D5185(m) >20	<1	1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	0	<1	0
Aluminum	ppm	ASTM D5185(m) >4	<1	<1	0
Lead	ppm	ASTM D5185(m) >250	0	<1	<1
Copper	ppm	ASTM D5185(m) >125	<1	9	1
Tin	ppm	ASTM D5185(m) >80	2	13	2
Antimony	ppm	ASTM D5185(m)	0	<1	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	0	<1	0
Barium	ppm	ASTM D5185(m)	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0
Manganese	ppm	ASTM D5185(m)	0	<1	0
Magnesium	ppm	ASTM D5185(m)	<1	<1	0
Calcium	ppm	ASTM D5185(m) 0	<1	2	<1
Phosphorus	ppm	ASTM D5185(m) 4	4	7	3
Zinc	ppm	ASTM D5185(m) 0	3	6	1
Sulfur	ppm	ASTM D5185(m)	38	105	56
Lithium	ppm	ASTM D5185(m)	<1	<1	<1






CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m) >50	0	2	0
Sodium	ppm	ASTM D5185(m)	0	<1	0
Potassium	ppm	ASTM D5185(m) >20	<1	<1	<1

FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>10000	▲ 43714	264532	104547
Particles >6µm	ASTM D7647	>2500	▲ 6763	144800	30328
Particles >14µm	ASTM D7647	>160	▲ 368	5588	1833
Particles >21µm	ASTM D7647	>40	▲ 75	496	511
Particles >38µm	ASTM D7647	>10	1	5	5
Particles >71µm	ASTM D7647	>3	1	0	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	▲ 23/20/16	25/24/20	24/22/18

OIL ANALYSIS REPORT

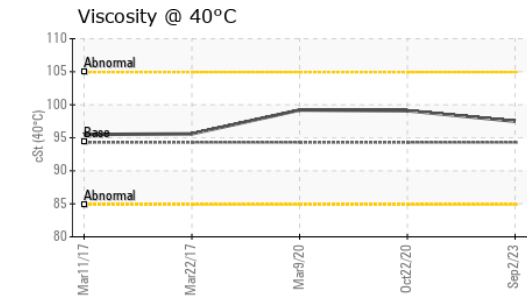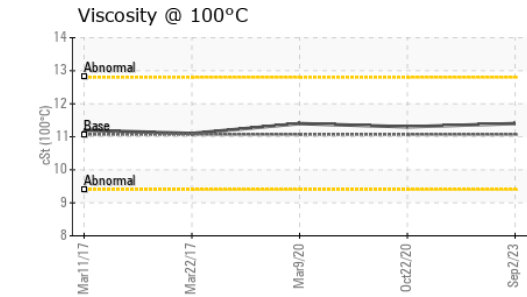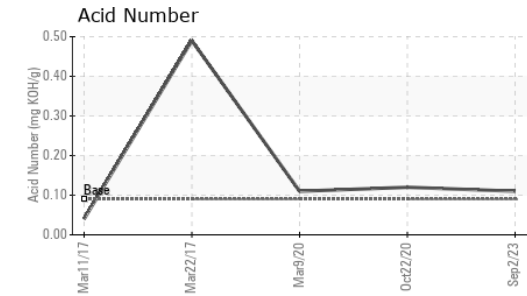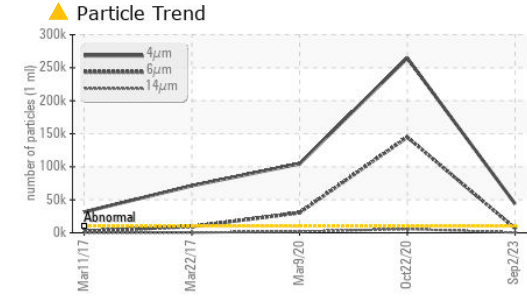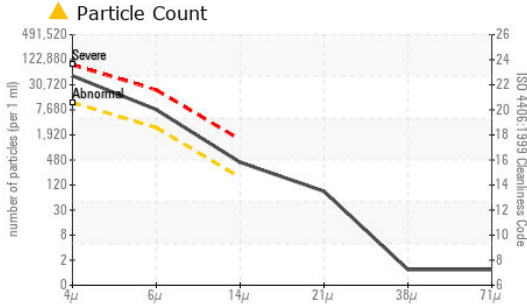

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0070125
Lab Number : 02582829
Unique Number : 5643894
Test Package : IND 2 (Additional Tests: KV100, PQ, PrtCount, TAN Man, VI)


To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.09	0.11	0.12	0.110

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	VLITE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	VLITE	LIGHT	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	94.3	97.5	99.1	99.2
Visc @ 100°C	cSt	ASTM D7279(m)	11.07	11.4	11.3	11.4
Viscosity Index (VI)	Scale	ASTM D2270*	103	103	99	---

SAMPLE IMAGES

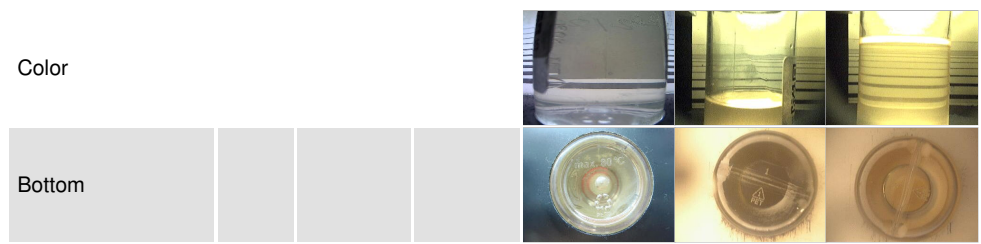

Vale - Voisey's Bay
 Voisey's Bay Mine Site, P.O. Box 7001, Stn. C Happy Valley
 Goose Bay, NL
 CA A0P 1C0
 Contact: Robert Feltham
 robert.feltham@vale.com
 T:
 F: x: