




OIL ANALYSIS REPORT

Sample Rating Trend

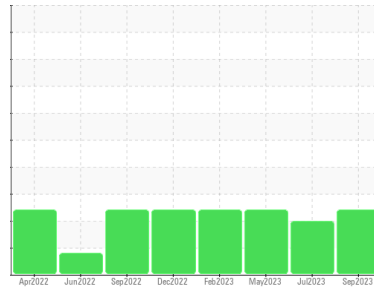

FUEL



Machine Id
800020

Component
Diesel Engine

Fluid
PETRO CANADA DURON SHP 15W40 (--- GAL)

DIAGNOSIS

Recommendation

We advise that you check the fuel injection system. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a high amount of fuel present in the oil. Tests confirm the presence of fuel in the oil.

Fluid Condition

Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GFL0089016	GFL0082959	GFL0077854
Sample Date	Client Info		19 Sep 2023	05 Jul 2023	02 May 2023
Machine Age	hrs	Client Info	16519	15942	15383
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	Changed
Sample Status			SEVERE	SEVERE	SEVERE

CONTAMINATION

	method	limit/base	current	history1	history2
Glycol	WC Method		NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >75	31	34	33
Chromium	ppm	ASTM D5185(m) >5	1	1	2
Nickel	ppm	ASTM D5185(m) >4	<1	0	<1
Titanium	ppm	ASTM D5185(m) >2	0	0	0
Silver	ppm	ASTM D5185(m) >2	0	0	0
Aluminum	ppm	ASTM D5185(m) >15	1	1	2
Lead	ppm	ASTM D5185(m) >25	0	0	<1
Copper	ppm	ASTM D5185(m) >100	<1	<1	1
Tin	ppm	ASTM D5185(m) >4	0	0	<1
Antimony	ppm	ASTM D5185(m)	0	0	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 0	4	4	4
Barium	ppm	ASTM D5185(m) 0	0	0	0
Molybdenum	ppm	ASTM D5185(m) 60	53	51	48
Manganese	ppm	ASTM D5185(m) 0	<1	<1	<1
Magnesium	ppm	ASTM D5185(m) 1010	825	827	759
Calcium	ppm	ASTM D5185(m) 1070	928	908	861
Phosphorus	ppm	ASTM D5185(m) 1150	935	925	859
Zinc	ppm	ASTM D5185(m) 1270	1059	1017	938
Sulfur	ppm	ASTM D5185(m) 2060	2171	2081	2012
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >25	8	9	8
Sodium	ppm	ASTM D5185(m)	10	8	8
Potassium	ppm	ASTM D5185(m) >20	<1	1	1
Fuel	%	ASTM D7593* >3.0	6.9	7.8	12.1

INFRA-RED



	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844* >6	0.7	0.6	0.6
Nitration	Abs/cm	ASTM D7624* >20	13.5	14.0	14.1
Sulfation	Abs/.1mm	ASTM D7415* >30	29.3	29.9	27.2

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414* >25	37.3	38.8	34.3











OIL ANALYSIS REPORT

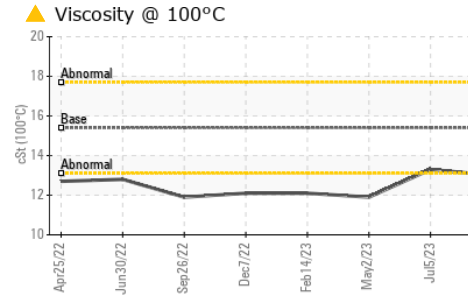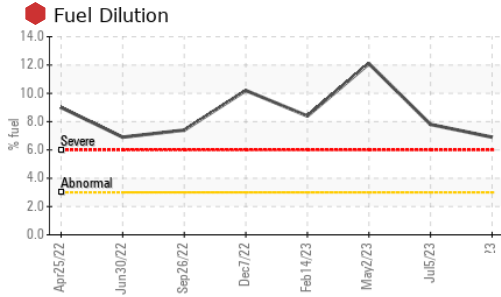

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.4	▲ 13.0	▲ 11.9

GRAPHS

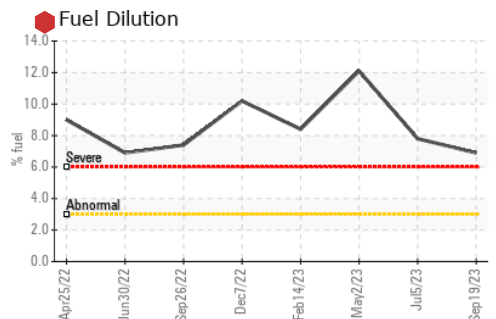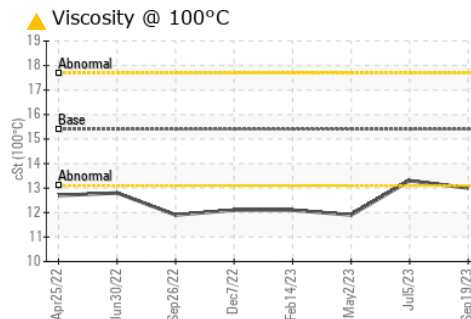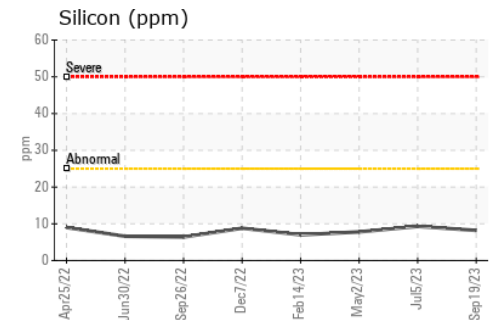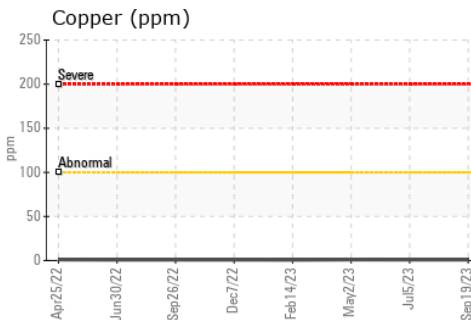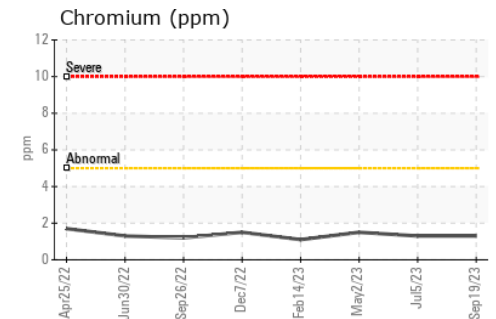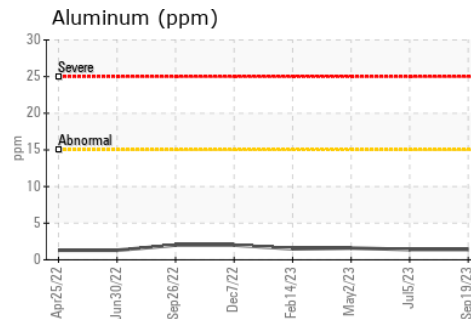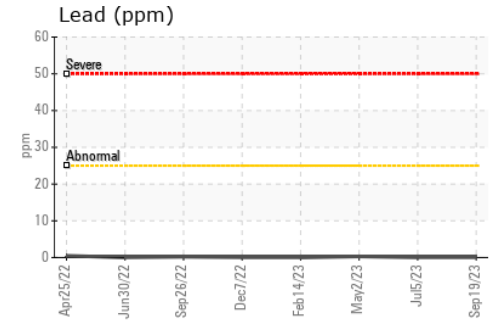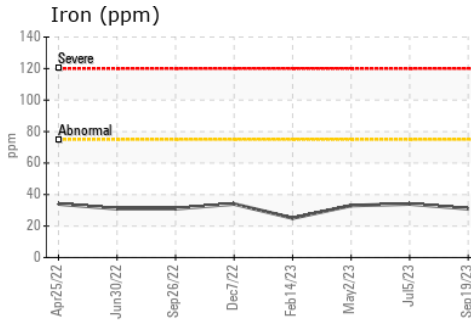

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **GFL Environmental - 207 - Pickering SW**
Sample No. : GFL0089016 **Received** : 21 Sep 2023 **1034 TOY AVENUE, PICKERING YARD**
Lab Number : 02584318 **Diagnosed** : 22 Sep 2023 **PICKERING, ON**
Unique Number : 5645383 **Diagnostician** : Bill Quesnel **CA L1W 3P1**
Test Package : MOB 1 (Additional Tests: PercentFuel)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Contact: Ian Patton
 ipatton@gflenv.com
 T: (905)831-6297
 F: (905)426-3577