


Area  
**Fwd Machinery Space [450204292]**  
Machine Id  
**Generator - PKSG Engine Crank Case (S/N Sample Tag CD-86101-S1)**  
Component  
**Diesel Engine**  
Fluid  
**PETRO CANADA BP ENERGOL DS3 154 (2670 LTR)**

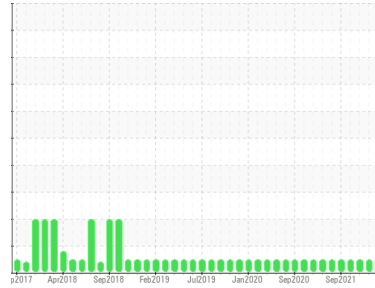

**DIAGNOSIS**

**Recommendation**  
Resample at the next service interval to monitor.

**Wear**  
All component wear rates are normal.

**Contamination**  
There is no indication of any contamination in the oil.

**Fluid Condition**  
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION** method limit/base current history1 history2

Sample Number	Client Info	<b>PC</b>	PC	WC0052236
Sample Date	Client Info	<b>08 Sep 2023</b>	29 May 2023	09 Mar 2023
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	N/A	N/A
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

**CONTAMINATION** method limit/base current history1 history2

Fuel	WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Glycol	WC Method		<b>NEG</b>	NEG	NEG

**WEAR METALS** method limit/base current history1 history2

PQ	ASTM D8184*		<b>0</b>	0	0
Iron	ppm ASTM D5185(m)	>25	<b>6</b>	6	5
Chromium	ppm ASTM D5185(m)	>5	<b>0</b>	0	0
Nickel	ppm ASTM D5185(m)	>5	<b>&lt;1</b>	0	<1
Titanium	ppm ASTM D5185(m)	>2	<b>0</b>	0	<1
Silver	ppm ASTM D5185(m)	>2	<b>&lt;1</b>	<1	0
Aluminum	ppm ASTM D5185(m)	>10	<b>2</b>	2	2
Lead	ppm ASTM D5185(m)	>5	<b>0</b>	0	<1
Copper	ppm ASTM D5185(m)	>5	<b>&lt;1</b>	<1	<1
Tin	ppm ASTM D5185(m)	>5	<b>0</b>	0	0
Antimony	ppm ASTM D5185(m)		<b>0</b>	0	<1
Vanadium	ppm ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm ASTM D5185(m)		<b>0</b>	0	0

**ADDITIVES** method limit/base current history1 history2

Boron	ppm ASTM D5185(m)	0	<b>2</b>	2	2
Barium	ppm ASTM D5185(m)	0	<b>0</b>	0	0
Molybdenum	ppm ASTM D5185(m)	0	<b>0</b>	<1	<1
Manganese	ppm ASTM D5185(m)		<b>0</b>	<1	<1
Magnesium	ppm ASTM D5185(m)	15	<b>17</b>	19	19
Calcium	ppm ASTM D5185(m)	5500	<b>5586</b>	5426	5736
Phosphorus	ppm ASTM D5185(m)	580	<b>886</b>	940	941
Zinc	ppm ASTM D5185(m)	650	<b>989</b>	987	949
Sulfur	ppm ASTM D5185(m)	8500	<b>10291</b>	10661	10797
Lithium	ppm ASTM D5185(m)		<b>&lt;1</b>	<1	<1





**CONTAMINANTS** method limit/base current history1 history2

Silicon	ppm ASTM D5185(m)	>20	<b>5</b>	6	6
Sodium	ppm ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Potassium	ppm ASTM D5185(m)	>20	<b>0</b>	<1	0

**INFRA-RED** method limit/base current history1 history2

Soot %	% ASTM D7844*	>2	<b>0.6</b>	0	0
Nitration	Abs/cm ASTM D7624*	>20	<b>9.5</b>	9.5	5.4
Sulfation	Abs./1mm ASTM D7415*	>30	<b>13.4</b>	14.4	15.4

# OIL ANALYSIS REPORT

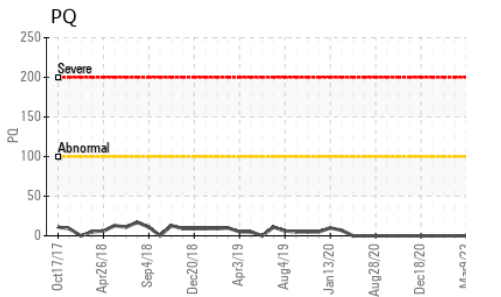
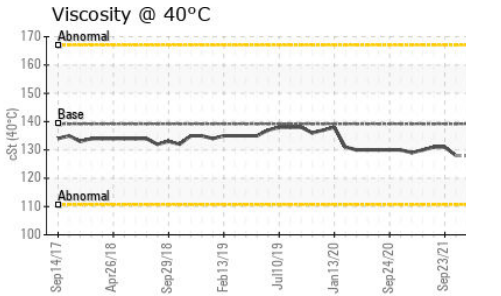
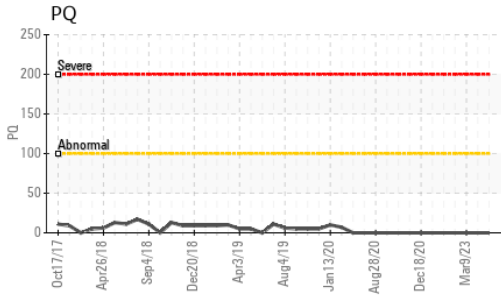
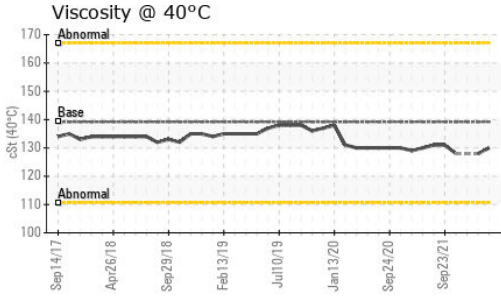


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>8.0</b>	7.8	5.4
Base Number (BN)	mg KOH/g	ASTM D2896*	15	<b>15.80</b>	15.76	15.77

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.1	<b>NEG</b>	NEG	NEG
Free Water	scalar	Visual*		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	139.2	<b>130</b>	128	---
Visc @ 100°C	cSt	ASTM D7279(m)	14.0	<b>13.4</b>	13.3	13.3
Viscosity Index (VI)	Scale	ASTM D2270*	99	<b>97</b>	97	---

## GRAPHS

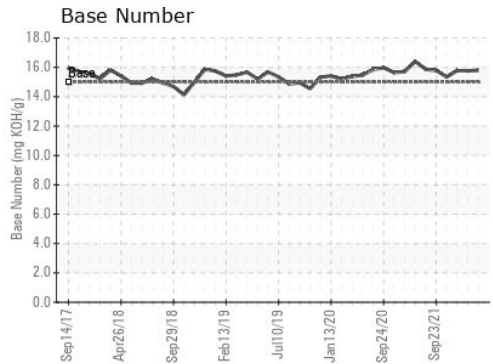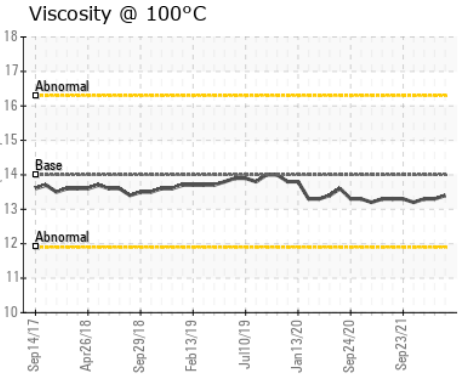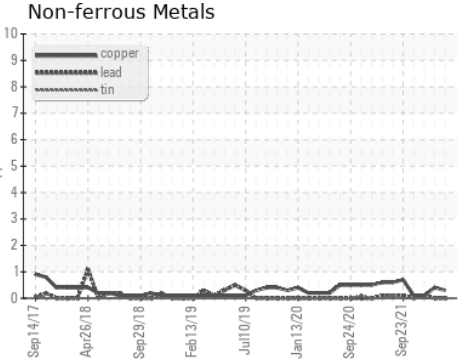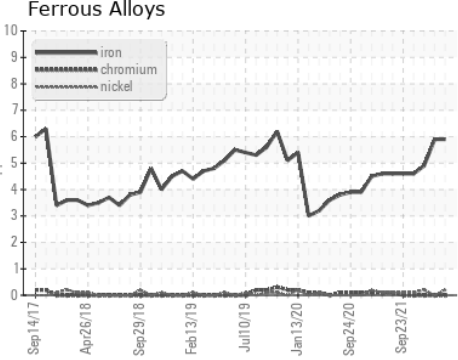

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC  
**Lab Number** : **02584891**      **Received** : 25 Sep 2023  
**Unique Number** : 5645956      **Diagnosed** : 26 Sep 2023  
**Test Package** : MAR 2 ( Additional Tests: KV40, PQ, PrtCount, VI )      **Diagnostician** : Bill Quesnel

**Suncor - Terra Nova Projects**  
 Scotia Centre, 235 Water Street  
 St. John's, NL  
 CA A1C 1B6  
 Contact: Josh Hynes  
 joshhynes@suncor.com  
 T: (709)778-3575  
 F: (709)724-2835

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.