




OIL ANALYSIS REPORT

Sample Rating Trend

WEAR



Machine Id
733024
Component
Natural Gas Engine
Fluid
RDL-3647 (--- GAL)

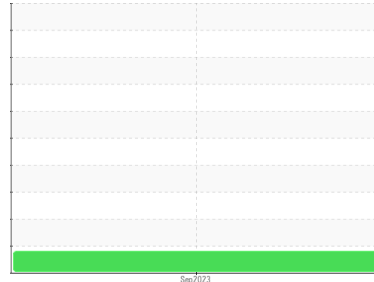

DIAGNOSIS

Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

Wear

Iron ppm levels are abnormal. Cylinder, crank, or cam shaft wear is indicated.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	GFL0093909	---	---
Sample Date	Client Info	24 Sep 2023	---	---
Machine Age	hrs Client Info	1132	---	---
Oil Age	hrs Client Info	0	---	---
Oil Changed	Client Info	N/A	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	---	---
Iron	ppm ASTM D5185(m) >50	▲ 53	---	---
Chromium	ppm ASTM D5185(m) >4	1	---	---
Nickel	ppm ASTM D5185(m) >2	1	---	---
Titanium	ppm ASTM D5185(m)	0	---	---
Silver	ppm ASTM D5185(m) >3	<1	---	---
Aluminum	ppm ASTM D5185(m) >9	4	---	---
Lead	ppm ASTM D5185(m) >30	2	---	---
Copper	ppm ASTM D5185(m) >35	14	---	---
Tin	ppm ASTM D5185(m) >4	1	---	---
Antimony	ppm ASTM D5185(m)	0	---	---
Vanadium	ppm ASTM D5185(m)	0	---	---
Beryllium	ppm ASTM D5185(m)	0	---	---
Cadmium	ppm ASTM D5185(m)	0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 50	12	---	---
Barium	ppm ASTM D5185(m) 5	2	---	---
Molybdenum	ppm ASTM D5185(m) 50	78	---	---
Manganese	ppm ASTM D5185(m) 0	8	---	---
Magnesium	ppm ASTM D5185(m) 560	650	---	---
Calcium	ppm ASTM D5185(m) 1510	1366	---	---
Phosphorus	ppm ASTM D5185(m) 780	726	---	---
Zinc	ppm ASTM D5185(m) 870	907	---	---
Sulfur	ppm ASTM D5185(m) 2040	2050	---	---
Lithium	ppm ASTM D5185(m)	<1	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >+100	20	---	---
Sodium	ppm ASTM D5185(m)	4	---	---
Potassium	ppm ASTM D5185(m) >20	2	---	---

INFRA-RED

method	limit/base	current	history1	history2
Soot %	% ASTM D7844*	0	---	---
Nitration	Abs/cm ASTM D7624*	>20	---	---
Sulfation	Abs/.1mm ASTM D7415*	>30	---	---


FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414*	>25	---	---



OIL ANALYSIS REPORT

▲ Ferrous Alloys

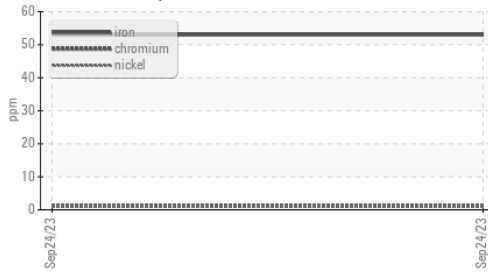


VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.1	NEG	---
Free Water	scalar	Visual*		NEG	---


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.1	14.5	---

GRAPHS

Viscosity @ 100°C

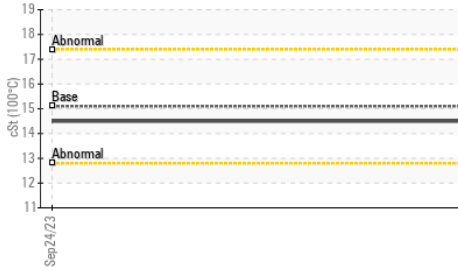


▲ Iron (ppm)

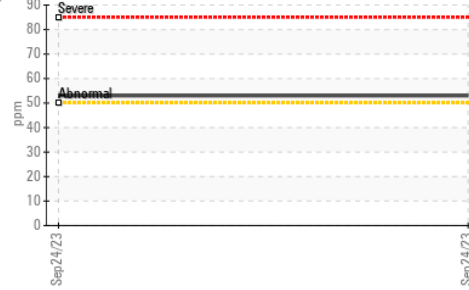


Lead (ppm)




Aluminum (ppm)

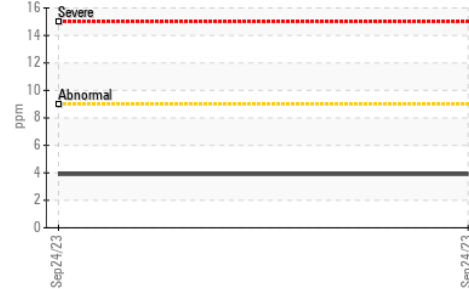


Chromium (ppm)

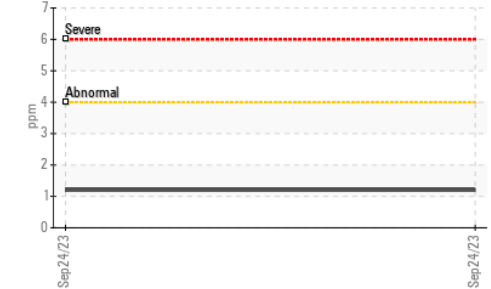


PQ

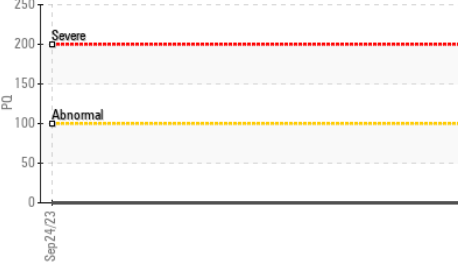


Copper (ppm)

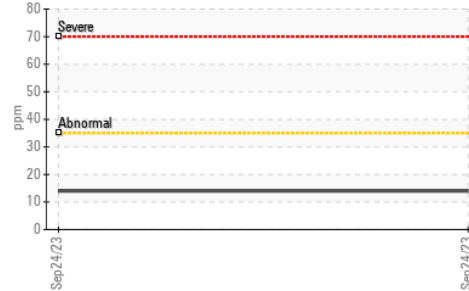


Silicon (ppm)

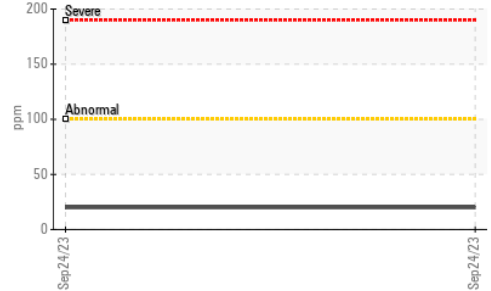

Viscosity @ 100°C

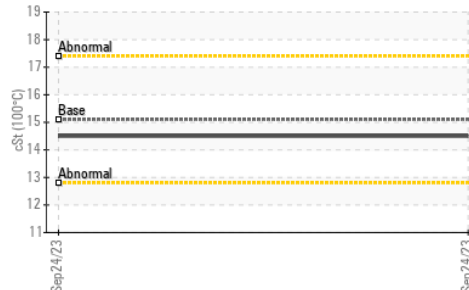

PQ

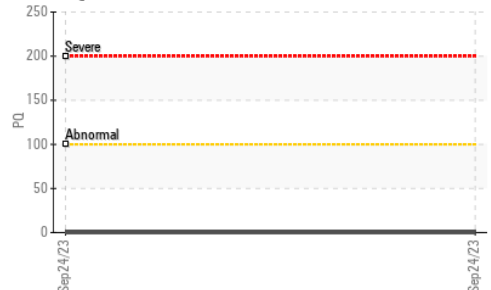

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 GFL Environmental - 554 - Edmonton SW
Sample No. : GFL0093909 **Received** : 03 Oct 2023
Lab Number : 02586399 **Diagnosed** : 03 Oct 2023
Unique Number : 5655465 **Diagnostician** : Kevin Marson
Test Package : MOB 1 (Additional Tests: PQ)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

8409 -15th Street NW
 Edmonton, AB
 CA T6P 0B8
 Contact: Tim Greig
 tgreig@gflenv.com
 T:
 F: