

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL




Area
[450207956]

Machine Id
No. 2 Service Air Compressor Lube System (S/N TAG # KA-63201B-S2)

Component
Air Compressor

Fluid
NOT GIVEN (--- LTR)

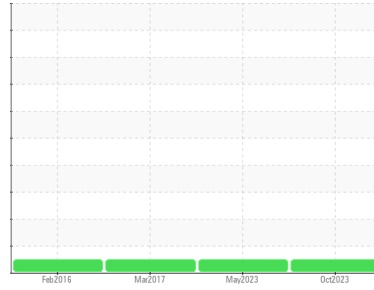

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PC	PC	PC
Sample Date	Client Info	06 Oct 2023	20 May 2023	31 Mar 2017
Machine Age	hrs Client Info	0	0	0
Oil Age	hrs Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	0	5
Iron	ppm ASTM D5185(m) >50	<1	3	<1
Chromium	ppm ASTM D5185(m) >4	0	0	0
Nickel	ppm ASTM D5185(m) >4	0	0	0
Titanium	ppm ASTM D5185(m)	0	0	0
Silver	ppm ASTM D5185(m)	<1	0	0
Aluminum	ppm ASTM D5185(m) >10	0	<1	0
Lead	ppm ASTM D5185(m) >20	0	0	0
Copper	ppm ASTM D5185(m) >40	<1	<1	<1
Tin	ppm ASTM D5185(m) >5	0	0	0
Antimony	ppm ASTM D5185(m)	0	0	0
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	<1	<1	0
Barium	ppm ASTM D5185(m)	<1	0	0
Molybdenum	ppm ASTM D5185(m)	0	0	0
Manganese	ppm ASTM D5185(m)	0	0	0
Magnesium	ppm ASTM D5185(m)	0	0	0
Calcium	ppm ASTM D5185(m)	<1	0	4
Phosphorus	ppm ASTM D5185(m)	34	72	37
Zinc	ppm ASTM D5185(m)	2	1	4
Sulfur	ppm ASTM D5185(m)	638	703	423
Lithium	ppm ASTM D5185(m)	<1	<1	<1






CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	0	0	<1
Sodium	ppm ASTM D5185(m)	<1	<1	<1
Potassium	ppm ASTM D5185(m) >20	0	0	<1
Water	% ASTM D6304* >0.6	0.001	0.002	---
ppm Water	ppm ASTM D6304* >6000	10.8	16.4	---

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	256	1440	2710
Particles >6µm	ASTM D7647 >2500	83	328	618
Particles >14µm	ASTM D7647 >320	11	16	54
Particles >21µm	ASTM D7647 >80	4	5	14
Particles >38µm	ASTM D7647 >20	1	0	2
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	15/14/11	18/16/11	19/16/13

OIL ANALYSIS REPORT

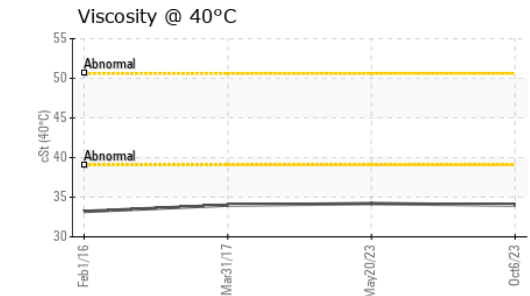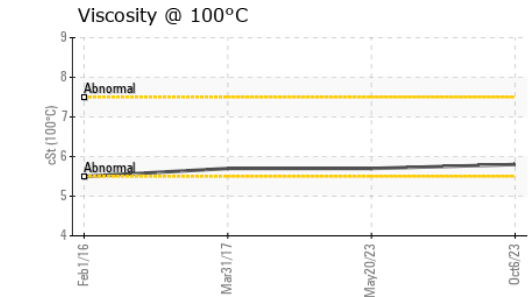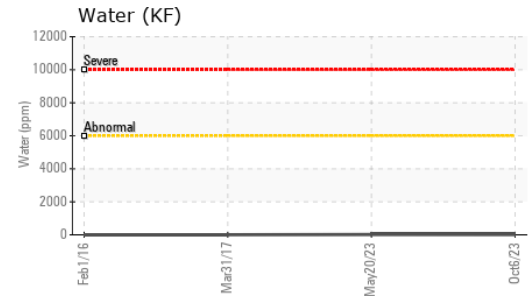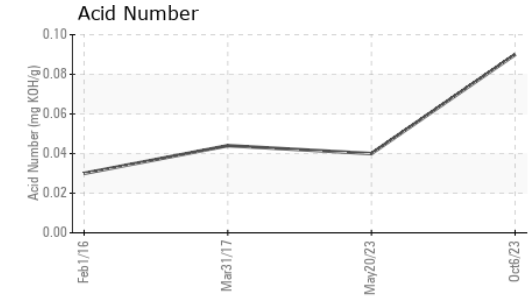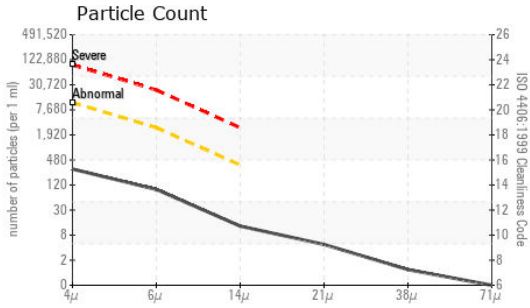


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		0.09	0.04	0.044

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.6	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)		34.0	34.2	34.0
Visc @ 100°C	cSt	ASTM D7279(m)		5.8	5.7	5.7
Viscosity Index (VI)	Scale	ASTM D2270*		112	105	107

SAMPLE IMAGES

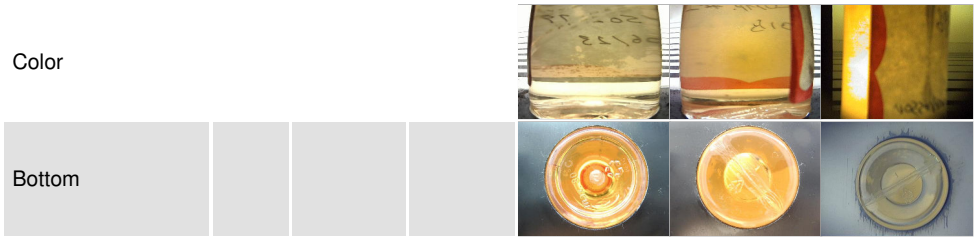

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC
Lab Number : **02590073** **Received** : 18 Oct 2023
Unique Number : 5659139 **Diagnosed** : 22 Oct 2023
Test Package : MAR 2 (Additional Tests: KF, KV100, PQ, PRTCOUNT, TAN Man, VI) **Diagnostician** : Kevin Marson

Suncor - Terra Nova Projects
 Scotia Centre, 235 Water Strret
 St. John's, NL
 CA A1C 1B6
 Contact: Josh Hynes
 joshynes@suncor.com
 T: (709)778-3575
 F: (709)724-2835

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.