


Area
1420
Machine Id
1420-5671-4001 - SAG MILL TRUNNION/PINION LUBE
Component
Bulk Fluid Tank
Fluid
PETRO CANADA ENDURATEX EP 320 (1000 LTR)

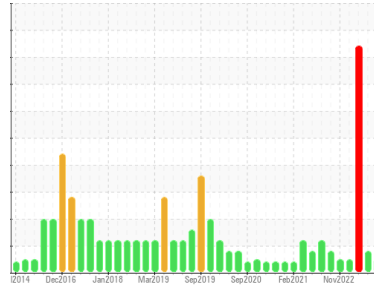

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PC0070109	PC0070132	PC0040301
Sample Date	Client Info	10 Sep 2023	14 Aug 2023	27 Apr 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	ATTENTION	SEVERE

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	4	5	6
Chromium	ppm	ASTM D5185(m)	0	0	0
Nickel	ppm	ASTM D5185(m)	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	0	0
Silver	ppm	ASTM D5185(m)	<1	0	0
Aluminum	ppm	ASTM D5185(m)	0	0	<1
Lead	ppm	ASTM D5185(m)	<1	<1	<1
Copper	ppm	ASTM D5185(m)	2	1	▲ 17
Tin	ppm	ASTM D5185(m)	0	0	0
Antimony	ppm	ASTM D5185(m)	0	0	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185(m)	55	18	19	23
Barium	ppm	ASTM D5185(m)	0	<1	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	<1	0
Manganese	ppm	ASTM D5185(m)	0	0	0	<1
Magnesium	ppm	ASTM D5185(m)	0	<1	1	<1
Calcium	ppm	ASTM D5185(m)	0	2	2	0
Phosphorus	ppm	ASTM D5185(m)	240	228	248	266
Zinc	ppm	ASTM D5185(m)	1	5	6	6
Sulfur	ppm	ASTM D5185(m)	13700	5121	5278	5633
Lithium	ppm	ASTM D5185(m)		5	5	5

CONTAMINANTS






method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185(m)		<1	<1	1
Sodium	ppm	ASTM D5185(m)		1	1	<1
Potassium	ppm	ASTM D5185(m)	>20	0	<1	<1

FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>5000	433	▲ 7036	● 109505
Particles >6µm	ASTM D7647	>1300	70	215	● 40491
Particles >14µm	ASTM D7647	>160	10	19	● 3364
Particles >21µm	ASTM D7647	>40	4	5	● 709
Particles >38µm	ASTM D7647	>10	2	2	4
Particles >71µm	ASTM D7647	>3	1	2	0
Oil Cleanliness	ISO 4406 (c)	>19/17/14	16/13/10	▲ 20/15/11	● 24/23/19

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D974* 0.4	0.46	0.36	0.36

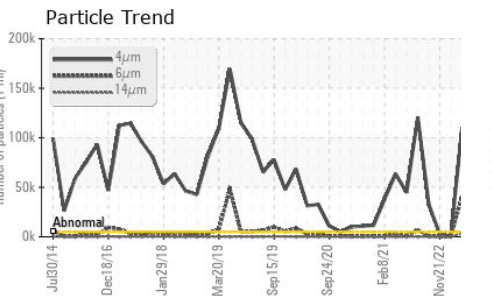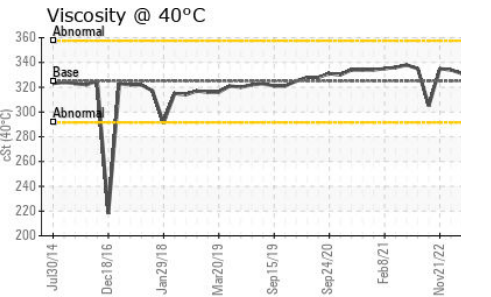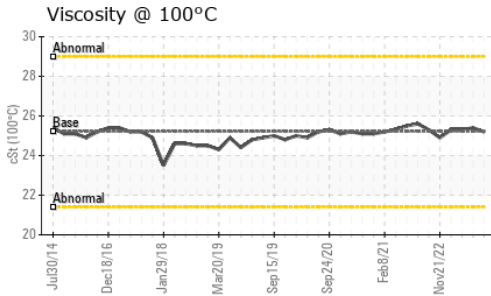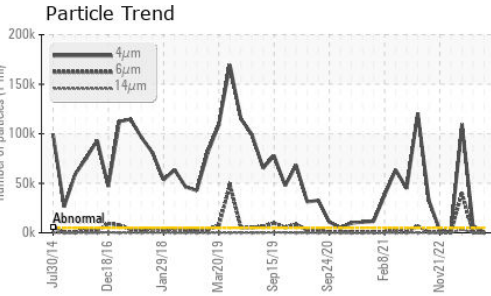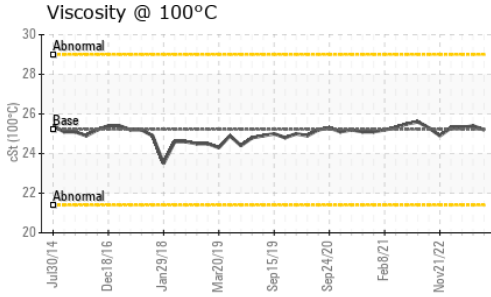

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	NEG	NEG	NEG
Free Water	scalar	Visual*	NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	325	332	331
Visc @ 100°C	cSt	ASTM D7279(m)	25.22	25.4	25.3
Viscosity Index (VI)	Scale	ASTM D2270*	100	99	99

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0070109
Lab Number : 02590399
Unique Number : 5659465
Test Package : IND 2 (Additional Tests: KV100, TAN Man, VI)

Vale - Voisey's Bay
 Voisey's Bay Mine Site, P.O. Box 7001, Stn. C Happy Valley
 Goose Bay, NL
 CA A0P 1C0
 Contact: Robert Feltham
 robert.feltham@vale.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

T:
 F: x: