


Area
TEAM 1
Machine Id
160130 Scrubber ID Fan Inboard Bearing
Component
Inboard Bearing
Fluid
PETRO CANADA TURBOFLO R&O 150 (1 GAL)

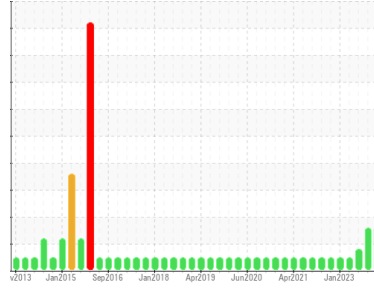

DIAGNOSIS

- Recommendation**
We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.
- Wear**
Lead ppm levels are abnormal. Iron ppm levels are noted. Bearing wear is indicated. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion.
- Contamination**
There is no indication of any contamination in the oil.
- Fluid Condition**
The oil is no longer serviceable as a result of the abnormal and/or severe wear.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PC0074780	PC0074772	PC0069722
Sample Date	Client Info			25 Oct 2023	18 Jul 2023	04 Apr 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ATTENTION


WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>20	▲ 20	▲ 20	▲ 19
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		<1	0	0
Aluminum	ppm	ASTM D5185(m)	>20	0	<1	<1
Lead	ppm	ASTM D5185(m)	>20	▲ 32	▲ 22	14
Copper	ppm	ASTM D5185(m)	>20	3	3	2
Tin	ppm	ASTM D5185(m)	>20	<1	1	<1
Antimony	ppm	ASTM D5185(m)		0	<1	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	<1	0
Barium	ppm	ASTM D5185(m)		<1	0	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	<1	<1
Magnesium	ppm	ASTM D5185(m)		0	<1	<1
Calcium	ppm	ASTM D5185(m)	0	6	6	6
Phosphorus	ppm	ASTM D5185(m)	4	4	6	2
Zinc	ppm	ASTM D5185(m)	0	6	6	3
Sulfur	ppm	ASTM D5185(m)		3943	5051	8069
Lithium	ppm	ASTM D5185(m)		<1	<1	<1


CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	2	2	1
Sodium	ppm	ASTM D5185(m)		<1	<1	<1
Potassium	ppm	ASTM D5185(m)	>20	0	<1	0

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

▲ Non-ferrous Metals

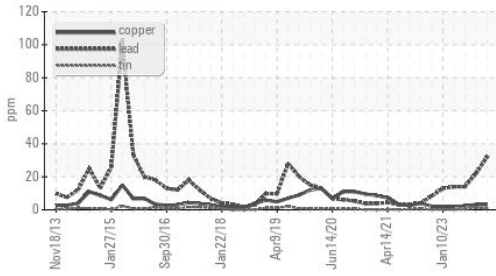


▲ Ferrous Alloys

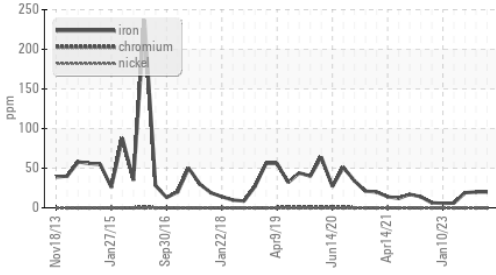

FLUID PROPERTIES


	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	137.1	150	153
Visc @ 100°C	cSt	ASTM D7279(m)	14.19	14.5	14.4
Viscosity Index (VI)	Scale	ASTM D2270*	101	94	91

SAMPLE IMAGES

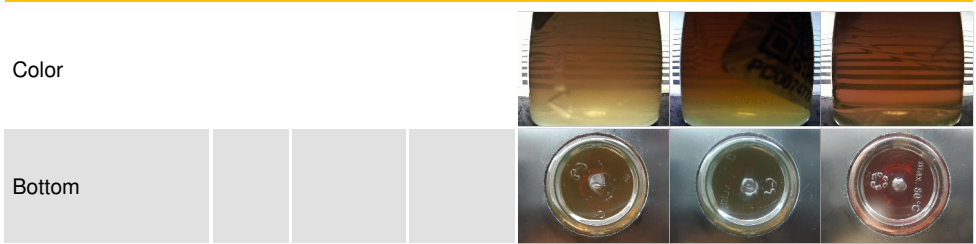


GRAPHS


▲ Iron (ppm)

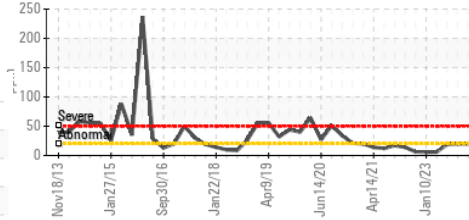


▲ Lead (ppm)

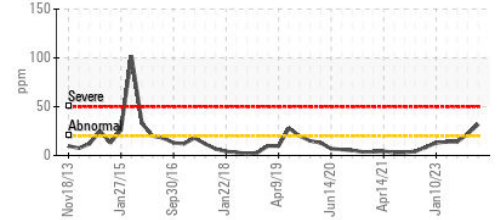


Aluminum (ppm)

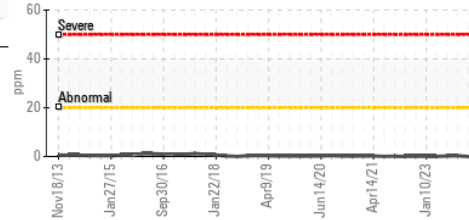


Chromium (ppm)

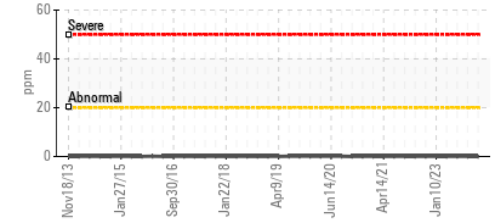


Copper (ppm)

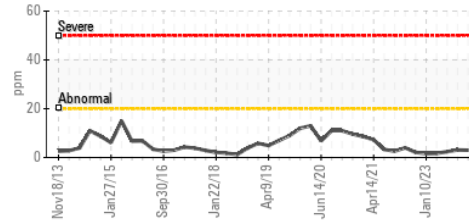


Silicon (ppm)

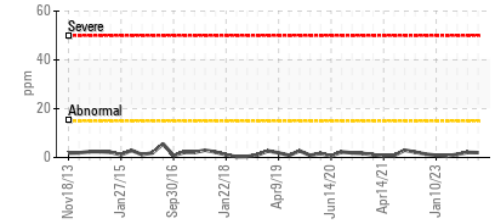


Viscosity @ 40°C

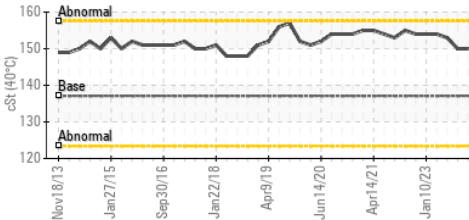


PQ

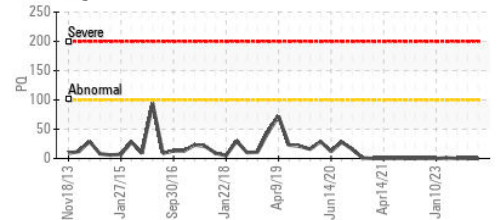


Viscosity @ 100°C

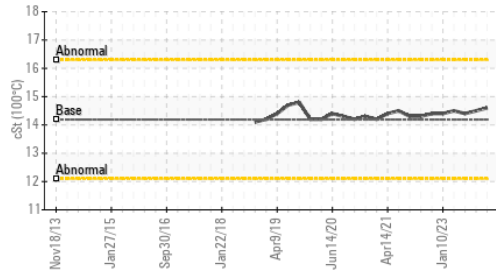

Viscosity @ 40°C

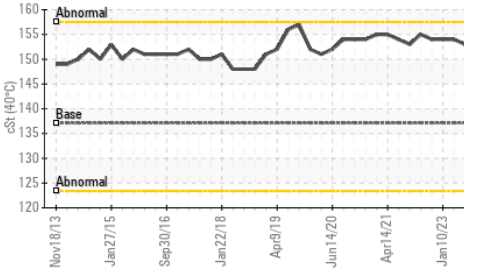

PQ

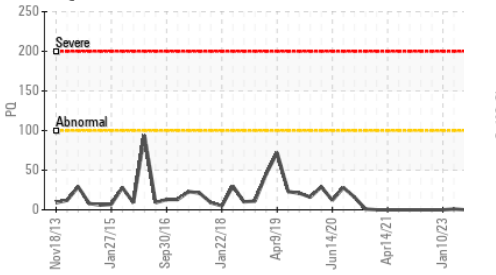

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0074780
Lab Number : 02595197
Unique Number : 5672276
Test Package : MOB 1 (Additional Tests: KV100, PQ, VI)

Received : 08 Nov 2023
Diagnosed : 10 Nov 2023
Diagnostician : Bill Quesnel

Dryden Fibre
 Box 3001, 1 Duke Street
 Dryden, ON
 CA P8N 2Z7
 Contact: Adebukola Adekanye
 AADEKANYE@DRYDENFIBRE.CA
 T: (807)223-9950
 F: (807)223-9176

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.