




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

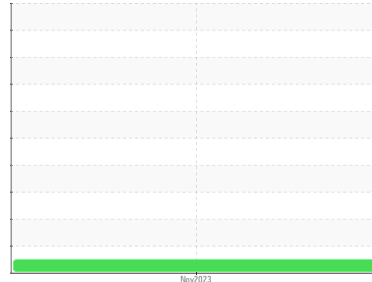

Area  
**[510125-3]**  
 Machine Id  
**733013**  
 Component  
**Diesel Engine**  
 Fluid  
**NOT GIVEN (--- GAL)**

## DIAGNOSIS

### Recommendation

Échantillonner de nouveau l'équipement au prochain intervalle de vidange afin d'en surveiller la condition. Veuillez préciser la marque, le type et la viscosité de l'huile lors de votre prochain échantillon.

### Wear

Les taux de métaux sont typiques pour la période de rodage d'un nouveau composant.

### Contamination

Elevated aluminum (Al) and/or lead (Pb) and potassium (K) levels in your metals analysis are likely a result of solder flux release into the lubricant and is common on new equipment/components. Il n'y a aucun indice de contamination dans l'huile.

### Fluid Condition

L'état de l'huile est acceptable pour la durée de service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>GFL0047473</b>	---	---
Sample Date	Client Info	<b>14 Nov 2023</b>	---	---
Machine Age	hrs Client Info	<b>501</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>NORMAL</b>	---	---

## CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >3.0	<b>&lt;1.0</b>	---	---
Glycol	WC Method	<b>NEG</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >120	<b>69</b>	---	---
Chromium	ppm ASTM D5185(m) >20	<b>1</b>	---	---
Nickel	ppm ASTM D5185(m) >5	<b>1</b>	---	---
Titanium	ppm ASTM D5185(m) >2	<b>0</b>	---	---
Silver	ppm ASTM D5185(m) >2	<b>&lt;1</b>	---	---
Aluminum	ppm ASTM D5185(m) >20	<b>13</b>	---	---
Lead	ppm ASTM D5185(m) >40	<b>2</b>	---	---
Copper	ppm ASTM D5185(m) >330	<b>19</b>	---	---
Tin	ppm ASTM D5185(m) >15	<b>1</b>	---	---
Antimony	ppm ASTM D5185(m)	<b>0</b>	---	---
Vanadium	ppm ASTM D5185(m)	<b>0</b>	---	---
Beryllium	ppm ASTM D5185(m)	<b>0</b>	---	---
Cadmium	ppm ASTM D5185(m)	<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	<b>13</b>	---	---
Barium	ppm ASTM D5185(m)	<b>3</b>	---	---
Molybdenum	ppm ASTM D5185(m)	<b>54</b>	---	---
Manganese	ppm ASTM D5185(m)	<b>12</b>	---	---
Magnesium	ppm ASTM D5185(m)	<b>821</b>	---	---
Calcium	ppm ASTM D5185(m)	<b>1234</b>	---	---
Phosphorus	ppm ASTM D5185(m)	<b>701</b>	---	---
Zinc	ppm ASTM D5185(m)	<b>881</b>	---	---
Sulfur	ppm ASTM D5185(m)	<b>1928</b>	---	---
Lithium	ppm ASTM D5185(m)	<b>&lt;1</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	<b>33</b>	---	---
Sodium	ppm ASTM D5185(m)	<b>6</b>	---	---
Potassium	ppm ASTM D5185(m) >20	<b>18</b>	---	---

## INFRA-RED


method	limit/base	current	history1	history2
Soot %	% ASTM D7844* >4	<b>0</b>	---	---
Nitration	Abs/cm ASTM D7624* >20	<b>13.1</b>	---	---
Sulfation	Abs/.1mm ASTM D7415* >30	<b>20.0</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414* >25	<b>19.2</b>	---	---











# OIL ANALYSIS REPORT

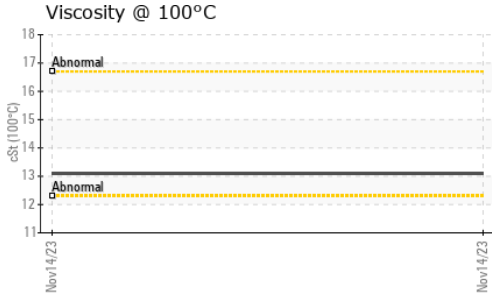

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	VLITE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---
Free Water	scalar	Visual*		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	13.1	---	---

## GRAPHS

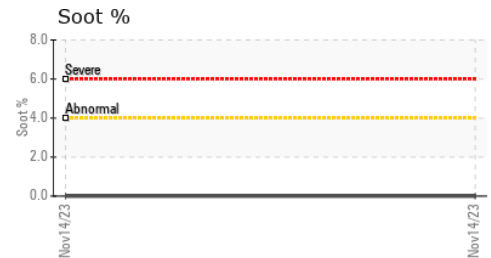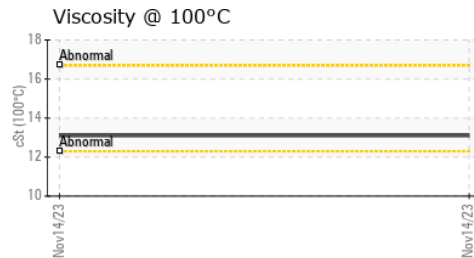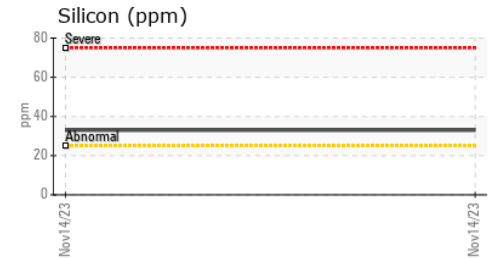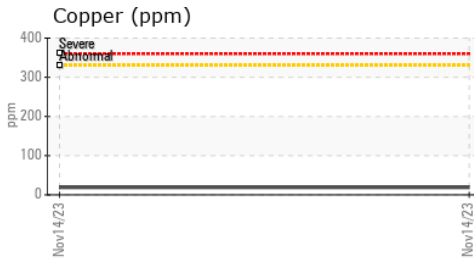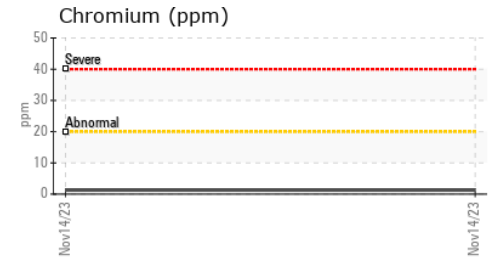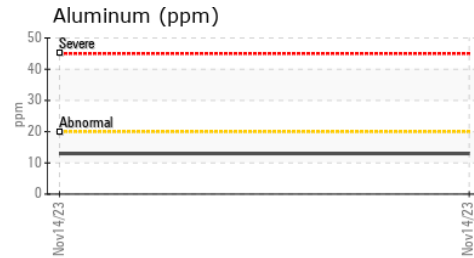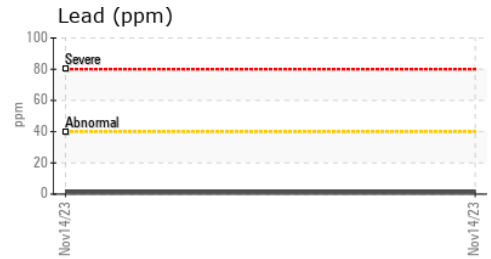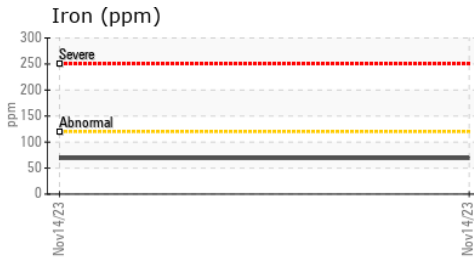

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 GFL Environmental - 780 - GMA - ICI - Solid Waste  
**Sample No.** : GFL0047473 **Received** : 16 Nov 2023 4365 boul. St-Elzear Ouest, Laval, QC  
**Lab Number** : 02596765 **Diagnosed** : 16 Nov 2023 CA H7P 4J3  
**Unique Number** : 5681845 **Diagnostician** : Kevin Marson Contact: Louis Michaud  
**Test Package** : MOB 1 ( Additional Tests: Visual ) louis.michaud@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.