




Machine Id  
**COMPRESSOR #2, PACKAGING NH3 (S/N G0627)**  
Component  
**Rotary Compressor**  
Fluid  
**TRIBOSPEC FRIGOSPEC ISO 68 (35 GAL)**

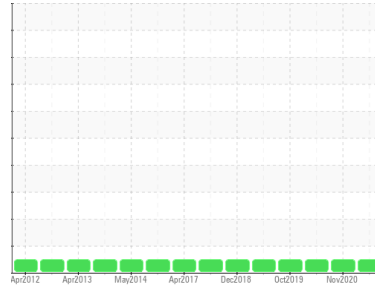

**DIAGNOSIS**

- Recommendation**  
Resample at the next service interval to monitor.
- Wear**  
All component wear rates are normal.
- Contamination**  
There is no indication of any contamination in the oil.
- Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

**SAMPLE INFORMATION**

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PC0062601</b>	PC0035327	PC0022570
Sample Date	Client Info		<b>24 Oct 2023</b>	20 Nov 2020	07 Apr 2020
Machine Age	hrs	Client Info	<b>87138</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

**WEAR METALS**

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	0	7
Iron	ppm	ASTM D5185(m) >70	<b>&lt;1</b>	3	4
Chromium	ppm	ASTM D5185(m) >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	0
Aluminum	ppm	ASTM D5185(m) >3	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185(m) >4	<b>&lt;1</b>	0	<1
Copper	ppm	ASTM D5185(m) >20	<b>1</b>	1	2
Tin	ppm	ASTM D5185(m) >3	<b>0</b>	0	0
Antimony	ppm	ASTM D5185(m)	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	0

**ADDITIVES**






	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1
Barium	ppm	ASTM D5185(m)	<b>&lt;1</b>	0	<1
Molybdenum	ppm	ASTM D5185(m)	<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185(m)	<b>2</b>	3	4
Phosphorus	ppm	ASTM D5185(m)	<b>0</b>	<1	0
Zinc	ppm	ASTM D5185(m)	<b>2</b>	2	2
Sulfur	ppm	ASTM D5185(m)	<b>215</b>	555	732
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

**CONTAMINANTS**

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >45	<b>&lt;1</b>	2	1
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185(m) >20	<b>0</b>	0	<1
Water	%	ASTM D6304* >0.6	<b>0.002</b>	0.001	0.001
ppm Water	ppm	ASTM D6304*	<b>24.2</b>	14.0	7.9

**FLUID DEGRADATION**

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	<b>0.01</b>	0.04	0.03

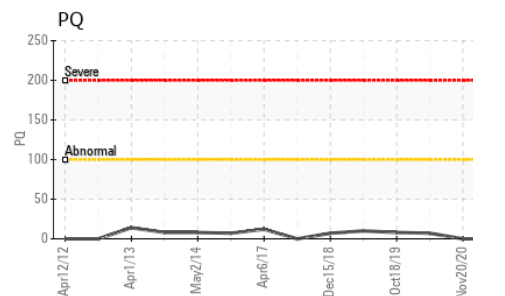
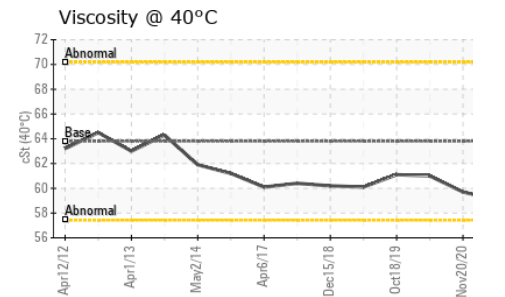
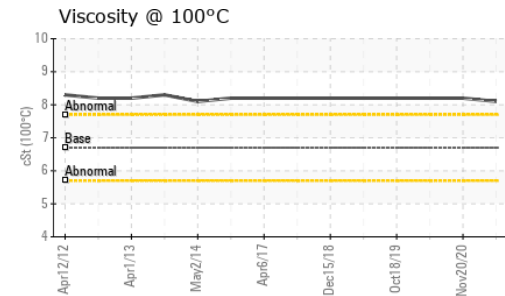
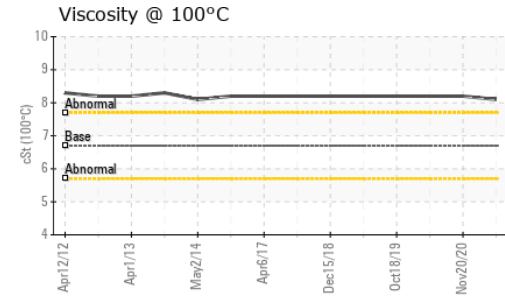
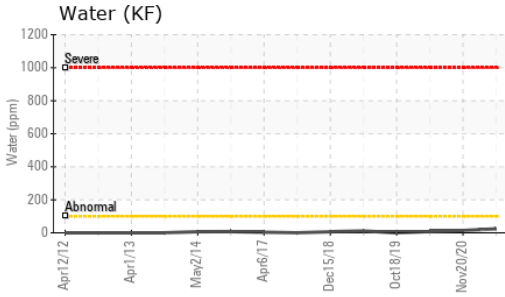


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	VLITE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.6	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	63.8	59.1	59.7
Visc @ 100°C	cSt	ASTM D7279(m)	6.7	8.1	8.2
Viscosity Index (VI)	Scale	ASTM D2270*		104	105

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

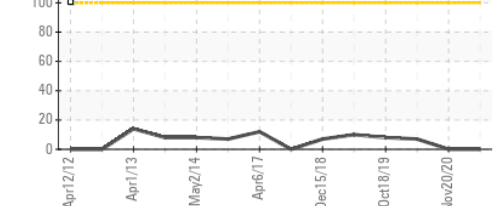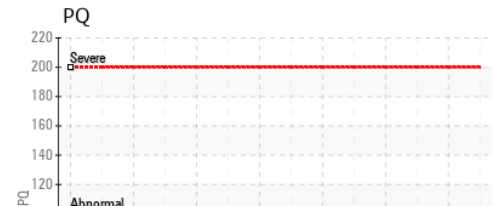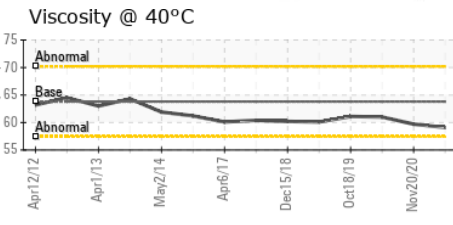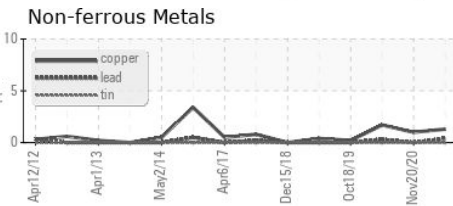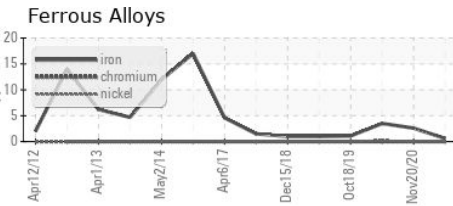

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0062601 **Received** : 16 Nov 2023  
**Lab Number** : 02596845 **Diagnosed** : 17 Nov 2023  
**Unique Number** : 5681925 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, VI )

**SAPUTO FOODS LTD**  
 284 HOPE STREET WEST  
 TAVISTOCK, ON  
 CA N0B 2R0  
 Contact: Joseph Ross  
 joseph.ross@saputo.com  
 T: (519)655-2337  
 F: (519)655-3449

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.