

Machine Id  
**DRYER NH3 #3 (S/N 18029)**  
 Component  
**Compressor**  
 Fluid  
**TRIBOSPEC FRIGOSPEC ISO 68 (16 LTR)**

**DIAGNOSIS**

**Recommendation**

Resample at the next service interval to monitor.

**Wear**

All component wear rates are normal.

**Contamination**

The water content is negligible. There is no indication of any contamination in the oil.

**Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PC0062599</b>	PC0076117	PC0058459
Sample Date	Client Info			<b>24 Oct 2023</b>	05 May 2023	04 May 2022
Machine Age	hrs	Client Info		<b>15952</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL






WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		<b>0</b>	0	0
Iron	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	<1	2
Chromium	ppm	ASTM D5185(m)	>10	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	<1
Aluminum	ppm	ASTM D5185(m)	>25	<b>0</b>	0	<1
Lead	ppm	ASTM D5185(m)	>25	<b>&lt;1</b>	0	0
Copper	ppm	ASTM D5185(m)	>50	<b>&lt;1</b>	0	1
Tin	ppm	ASTM D5185(m)	>15	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	0
Barium	ppm	ASTM D5185(m)		<b>2</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Calcium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185(m)		<b>0</b>	0	0
Zinc	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1
Sulfur	ppm	ASTM D5185(m)		<b>14</b>	22	23
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>3</b>	0	0
Sodium	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	0
Potassium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	<1
Water	%	ASTM D6304*	>0.1	<b>0.003</b>	0.00	0.003
ppm Water	ppm	ASTM D6304*	>1000	<b>36.2</b>	0.00	29.7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*		<b>0.01</b>	0.01	0.02

# OIL ANALYSIS REPORT

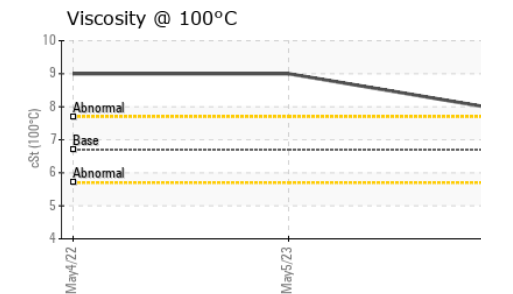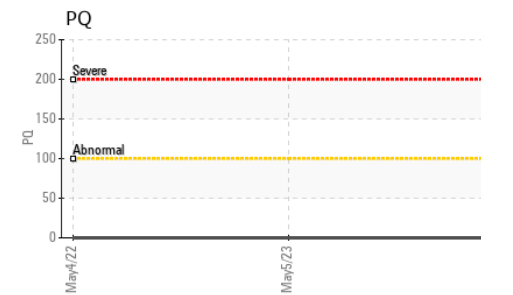
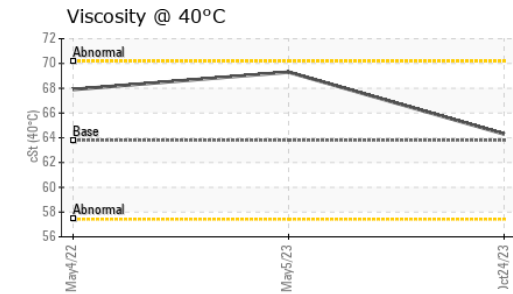
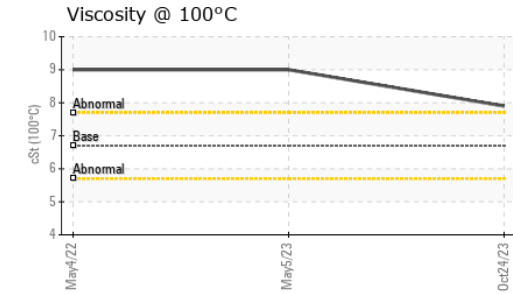
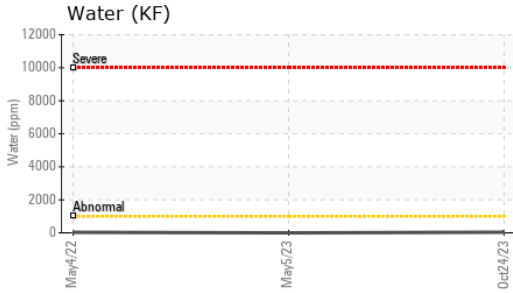


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	AMMON	AMMON
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	63.8	64.3	69.3
Visc @ 100°C	cSt	ASTM D7279(m)	6.7	7.9	9
Viscosity Index (VI)	Scale	ASTM D2270*	85	103	106

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

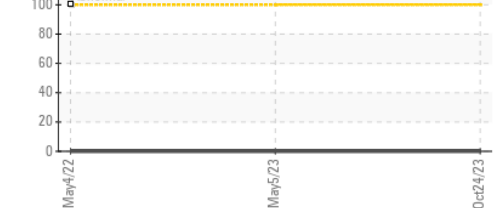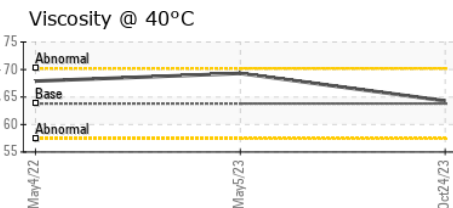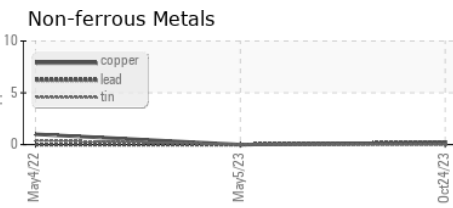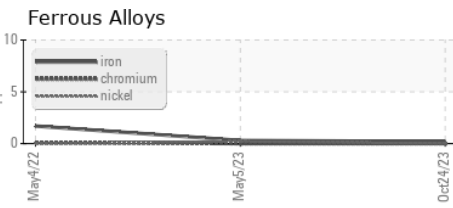

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0062599 **Received** : 16 Nov 2023  
**Lab Number** : 02596846 **Diagnosed** : 17 Nov 2023  
**Unique Number** : 5681926 **Diagnostician** : Kevin Marson  
**Test Package** : IND 2 ( Additional Tests: KF, KV100, VI )

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**SAPUTO FOODS LTD**  
 284 HOPE STREET WEST  
 TAVISTOCK, ON  
 CA N0B 2R0  
 Contact: Joseph Ross  
 joseph.ross@saputo.com  
 T: (519)655-2337  
 F: (519)655-3449