



Machine Id
GUASCOR LINDY`S NG1

Component
Natural Gas Engine

Fluid
PETRO CANADA SENTRON LD 5000 (--- GAL)

DIAGNOSIS

Recommendation

Confirm the source of the lubricant being utilized for top-up/fill. Resample at the next service interval to monitor.

Wear

Metal levels are typical for a components first oil change.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

Additive levels indicate the addition of a different brand, or type of oil. The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

| | | | | |
|---------------|-----------------|--------------------|-----|-----|
| Sample Number | Client Info | PC0073833 | --- | --- |
| Sample Date | Client Info | 17 Oct 2023 | --- | --- |
| Machine Age | hrs Client Info | 154 | --- | --- |
| Oil Age | hrs Client Info | 154 | --- | --- |
| Oil Changed | Client Info | Changed | --- | --- |
| Sample Status | | NORMAL | --- | --- |

CONTAMINATION method limit/base current history1 history2

| | | | | | |
|-------|-----------|------|------------|-----|-----|
| Water | WC Method | >0.1 | NEG | --- | --- |
|-------|-----------|------|------------|-----|-----|

WEAR METALS method limit/base current history1 history2

| | | | | | | |
|-----------|-----|---------------|-----|--------------|-----|-----|
| Iron | ppm | ASTM D5185(m) | >50 | 82 | --- | --- |
| Chromium | ppm | ASTM D5185(m) | >4 | 2 | --- | --- |
| Nickel | ppm | ASTM D5185(m) | >2 | 0 | --- | --- |
| Titanium | ppm | ASTM D5185(m) | | 0 | --- | --- |
| Silver | ppm | ASTM D5185(m) | >3 | <1 | --- | --- |
| Aluminum | ppm | ASTM D5185(m) | >9 | 12 | --- | --- |
| Lead | ppm | ASTM D5185(m) | >30 | 4 | --- | --- |
| Copper | ppm | ASTM D5185(m) | >35 | 88 | --- | --- |
| Tin | ppm | ASTM D5185(m) | >4 | <1 | --- | --- |
| Antimony | ppm | ASTM D5185(m) | | 0 | --- | --- |
| Vanadium | ppm | ASTM D5185(m) | | 0 | --- | --- |
| Beryllium | ppm | ASTM D5185(m) | | 0 | --- | --- |
| Cadmium | ppm | ASTM D5185(m) | | 0 | --- | --- |

ADDITIVES method limit/base current history1 history2

| | | | | | | |
|------------|-----|---------------|------|--------------|-----|-----|
| Boron | ppm | ASTM D5185(m) | 2 | <1 | --- | --- |
| Barium | ppm | ASTM D5185(m) | 3 | <1 | --- | --- |
| Molybdenum | ppm | ASTM D5185(m) | 0 | 0 | --- | --- |
| Manganese | ppm | ASTM D5185(m) | 0 | 2 | --- | --- |
| Magnesium | ppm | ASTM D5185(m) | 4 | 4 | --- | --- |
| Calcium | ppm | ASTM D5185(m) | 1727 | 1206 | --- | --- |
| Phosphorus | ppm | ASTM D5185(m) | 272 | 252 | --- | --- |
| Zinc | ppm | ASTM D5185(m) | 333 | 330 | --- | --- |
| Sulfur | ppm | ASTM D5185(m) | 3415 | 1928 | --- | --- |
| Lithium | ppm | ASTM D5185(m) | | <1 | --- | --- |


CONTAMINANTS method limit/base current history1 history2

| | | | | | | |
|-----------|-----|---------------|-------|-----------|-----|-----|
| Silicon | ppm | ASTM D5185(m) | >+100 | 13 | --- | --- |
| Sodium | ppm | ASTM D5185(m) | | 3 | --- | --- |
| Potassium | ppm | ASTM D5185(m) | >20 | 0 | --- | --- |

INFRA-RED method limit/base current history1 history2


| | | | | | | |
|-----------|----------|-------------|-----|-------------|-----|-----|
| Soot % | % | ASTM D7844* | | 0 | --- | --- |
| Nitration | Abs/cm | ASTM D7624* | >20 | 4.0 | --- | --- |
| Sulfation | Abs/.1mm | ASTM D7415* | >30 | 15.8 | --- | --- |

OIL ANALYSIS REPORT

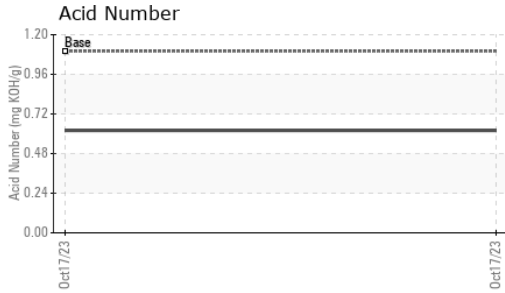












| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|------------|-------------|------------|-------------|----------|----------|
| Oxidation | Abs./1mm | ASTM D7414* | >25 | 9.1 | --- | --- |
| Acid Number (AN) | mg KOH/g | ASTM D974* | 1.1 | 0.62 | --- | --- |
| Base Number (BN) | mg KOH/g | ASTM D2896* | 4.9 | 3.44 | --- | --- |
| i-pH | Scale 0-14 | ASTM D7946* | <4.5 | 6.31 | --- | --- |

| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|------------|----------|----------|
| Emulsified Water | scalar | Visual* | >0.1 | NEG | --- | --- |
| Free Water | scalar | Visual* | | NEG | --- | --- |

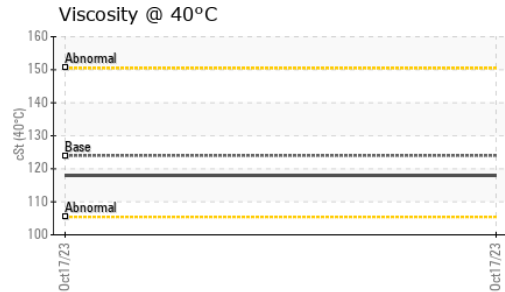

| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
|----------------------|-------|---------------|------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D7279(m) | 124 | 118 | --- | --- |
| Visc @ 100°C | cSt | ASTM D7279(m) | 13.48 | 13.0 | --- | --- |
| Viscosity Index (VI) | Scale | ASTM D2270* | 104 | 103 | --- | --- |

GRAPHS

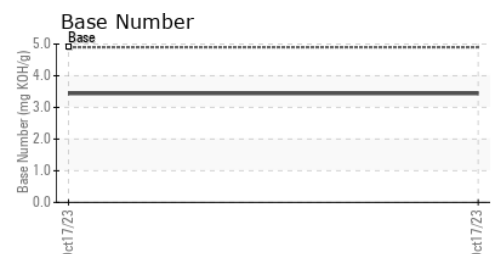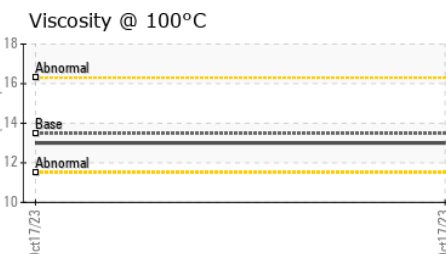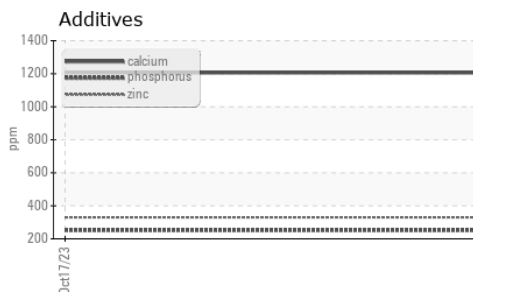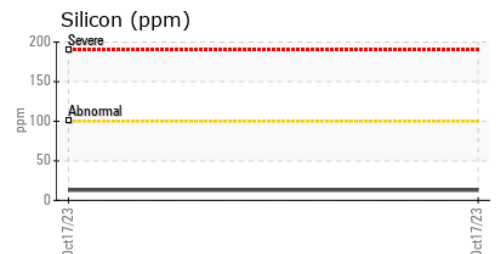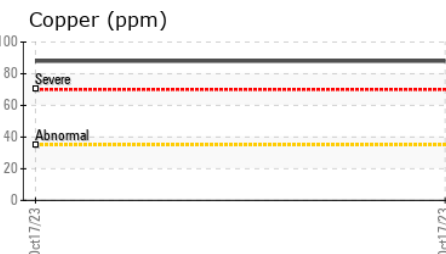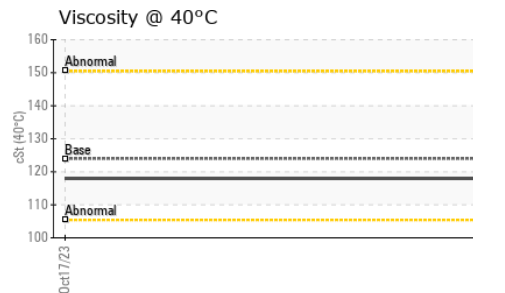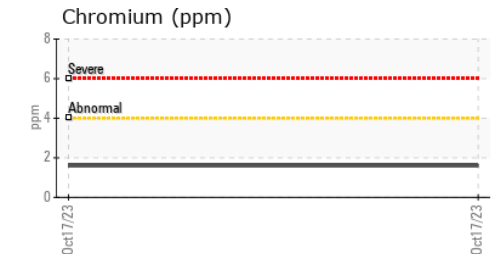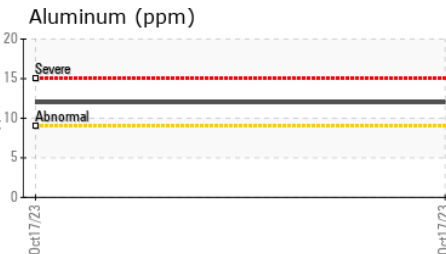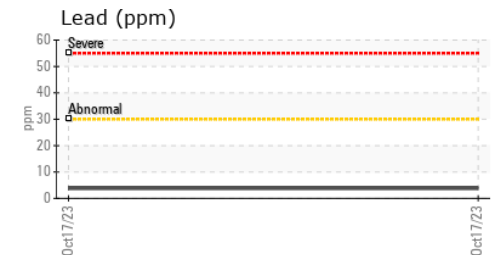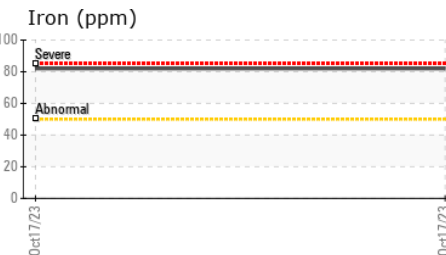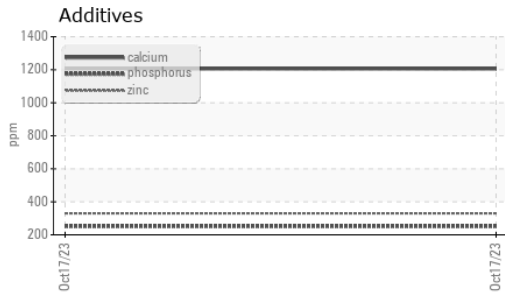

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0073833
Lab Number : 02598785
Unique Number : 5683865
Test Package : MOB 2 (Additional Tests: i-pH, KV40, TAN Auto, TAN Man, VI)

Martin Energy Group Canada
 1050 Boyde Lane RR#1
 Linwood, ON
 CA N0B 2A0
 Contact: J Wagler
 jwagler@martinenergygroup.com

*To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.*

T:
F: