OIL ANALYSIS REPORT

Sample Rating Trend

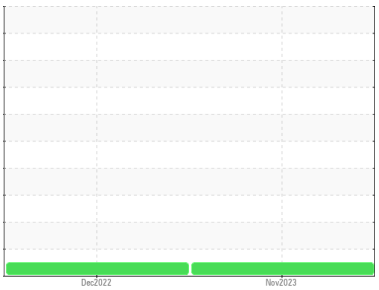

NORMAL

Machine Id
D7620
Component
Compressor
Fluid
PETRO CANADA REFLO 68A AMMONIA OIL (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**PC0052545**	PC0052630	---
Sample Date		Client Info		**12 Nov 2023**	11 Dec 2022	---
Machine Age	hrs	Client Info		**0**	0	---
Oil Age	hrs	Client Info		**0**	0	---
Oil Changed		Client Info		**N/A**	N/A	---
Sample Status				**NORMAL**	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		**0**	0	---
Iron	ppm	ASTM D5185(m)	>50	**11**	4	---
Chromium	ppm	ASTM D5185(m)	>10	**0**	0	---
Nickel	ppm	ASTM D5185(m)		**<1**	<1	---
Titanium	ppm	ASTM D5185(m)		**0**	0	---
Silver	ppm	ASTM D5185(m)		**<1**	0	---
Aluminum	ppm	ASTM D5185(m)	>25	**<1**	<1	---
Lead	ppm	ASTM D5185(m)	>25	**<1**	<1	---
Copper	ppm	ASTM D5185(m)	>50	**2**	2	---
Tin	ppm	ASTM D5185(m)	>15	**0**	0	---
Antimony	ppm	ASTM D5185(m)		**0**	0	---
Vanadium	ppm	ASTM D5185(m)		**0**	0	---
Beryllium	ppm	ASTM D5185(m)		**0**	0	---
Cadmium	ppm	ASTM D5185(m)		**0**	0	---

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	**<1**	<1	---
Barium	ppm	ASTM D5185(m)	0	**<1**	0	---
Molybdenum	ppm	ASTM D5185(m)	0	**0**	0	---
Manganese	ppm	ASTM D5185(m)		**0**	0	---
Magnesium	ppm	ASTM D5185(m)	0	**0**	0	---
Calcium	ppm	ASTM D5185(m)	0	**3**	<1	---
Phosphorus	ppm	ASTM D5185(m)	0	**8**	8	---
Zinc	ppm	ASTM D5185(m)	0	**7**	8	---
Sulfur	ppm	ASTM D5185(m)	0	**139**	158	---
Lithium	ppm	ASTM D5185(m)		**<1**	<1	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	**0**	0	---
Sodium	ppm	ASTM D5185(m)		**<1**	0	---
Potassium	ppm	ASTM D5185(m)	>20	**0**	0	---
Water	%	ASTM D6304*	>0.1	**0.001**	0.001	---
ppm Water	ppm	ASTM D6304*	>1000	**12**	0.1	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.05	**0.06**	0.09	---

OIL ANALYSIS REPORT

Water (KF)

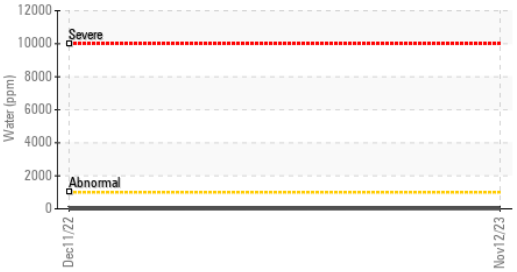

Viscosity @ 100°C

Viscosity @ 100°C

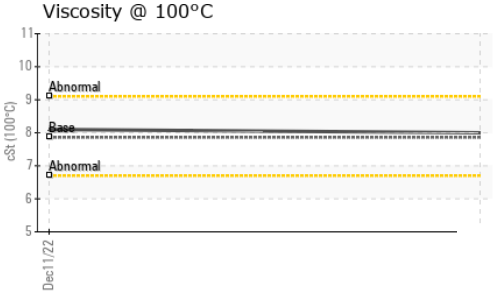

Viscosity @ 40°C

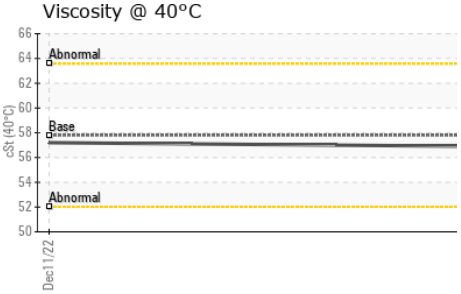

PQ

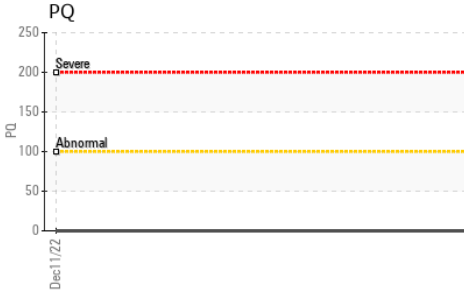

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	---
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	---
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	---
Silt	scalar	Visual*	NONE	**NONE**	NONE	---
Debris	scalar	Visual*	NONE	**VLITE**	NONE	---
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	---
Appearance	scalar	Visual*	NORML	**NORML**	NORML	---
Odor	scalar	Visual*	NORML	**NORML**	NORML	---
Emulsified Water	scalar	Visual*	>0.1	**NEG**	NEG	---
Free Water	scalar	Visual*		**NEG**	NEG	---

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	57.8	**56.9**	57.2	---
Visc @ 100°C	cSt	ASTM D7279(m)	7.86	**8**	8.1	---
Viscosity Index (VI)	Scale	ASTM D2270*	101	**107**	109	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					*no image*
Bottom					*no image*

GRAPHS

Ferrous Alloys

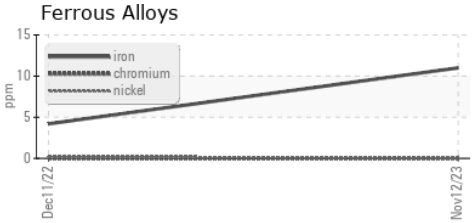

Non-ferrous Metals

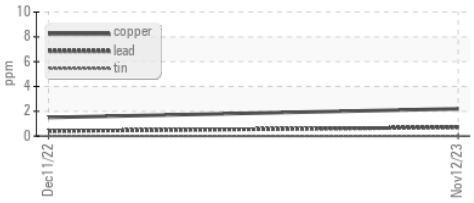

Viscosity @ 40°C

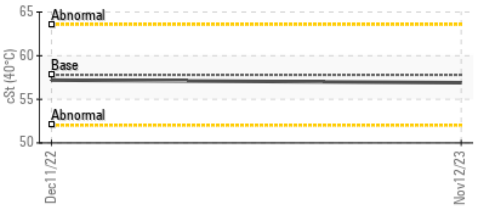

PQ

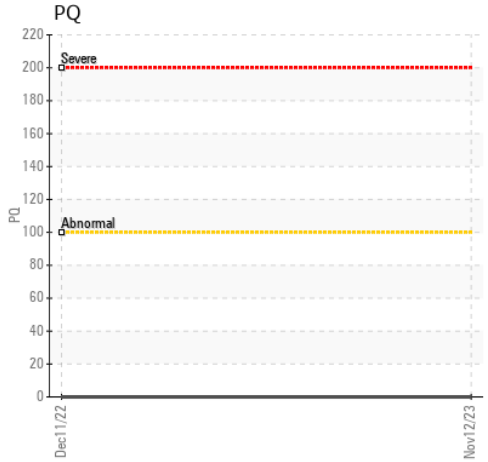

Acid Number

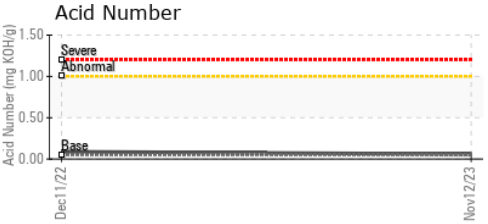

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0052545 **Received** : 28 Nov 2023
Lab Number : 02599439 **Diagnosed** : 29 Nov 2023
Unique Number : 5684519 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: KF, KV100, TAN Man, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

Labatt - St. John`s Brewery
60 Leslie Street
St John`s, NL
CA A1E 2V8
Contact: Rod Penney
rod.penney@labatt.com
T: (709)570-7152
F: (709)570-7160