


OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

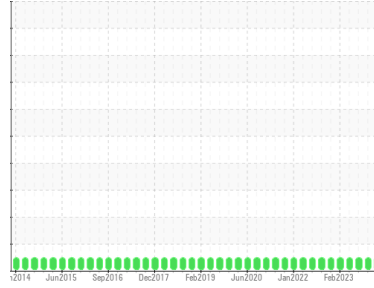

Area
TEAM 3
Machine Id
166170
Component
Hydraulic System
Fluid
PETRO CANADA HYDREX AW 46 (150 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PC0076945	PC0069853	PC0074799
Sample Date	Client Info	14 Jan 2024	20 Oct 2023	08 Aug 2023
Machine Age	mths Client Info	0	0	0
Oil Age	mths Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.05	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >20	1	1	1
Chromium	ppm ASTM D5185(m) >20	0	0	0
Nickel	ppm ASTM D5185(m) >20	<1	<1	0
Titanium	ppm ASTM D5185(m)	0	0	<1
Silver	ppm ASTM D5185(m)	0	<1	0
Aluminum	ppm ASTM D5185(m) >20	<1	0	<1
Lead	ppm ASTM D5185(m) >20	0	<1	0
Copper	ppm ASTM D5185(m) >20	<1	<1	<1
Tin	ppm ASTM D5185(m) >20	0	0	0
Antimony	ppm ASTM D5185(m)	0	0	0
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 0	<1	<1	<1
Barium	ppm ASTM D5185(m) 0	0	<1	0
Molybdenum	ppm ASTM D5185(m) 0	0	0	<1
Manganese	ppm ASTM D5185(m) 0	0	0	0
Magnesium	ppm ASTM D5185(m) 0	4	5	5
Calcium	ppm ASTM D5185(m) 50	95	97	103
Phosphorus	ppm ASTM D5185(m) 330	340	336	360
Zinc	ppm ASTM D5185(m) 430	429	441	440
Sulfur	ppm ASTM D5185(m) 760	1630	1571	1709
Lithium	ppm ASTM D5185(m)	<1	<1	<1






CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >15	<1	1	1
Sodium	ppm ASTM D5185(m)	9	10	11
Potassium	ppm ASTM D5185(m) >20	<1	0	<1

FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	1187	466	---
Particles >6µm	ASTM D7647 >1300	326	131	---
Particles >14µm	ASTM D7647 >160	13	10	---
Particles >21µm	ASTM D7647 >40	3	2	---
Particles >38µm	ASTM D7647 >10	0	0	---
Particles >71µm	ASTM D7647 >3	0	0	---
Oil Cleanliness	ISO 4406 (c) >--/17/14	17/16/11	16/14/10	---

OIL ANALYSIS REPORT

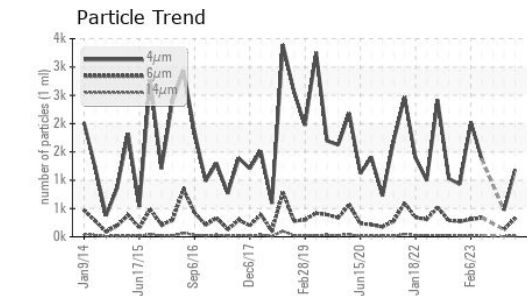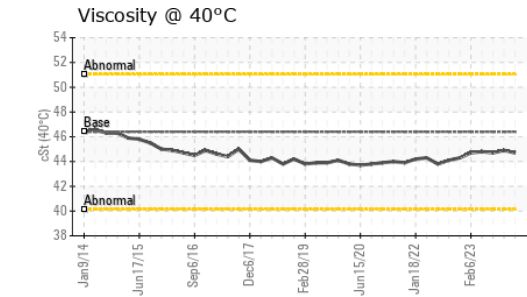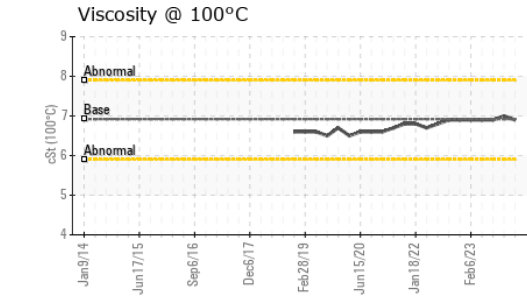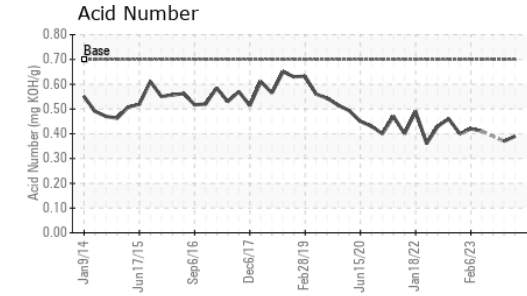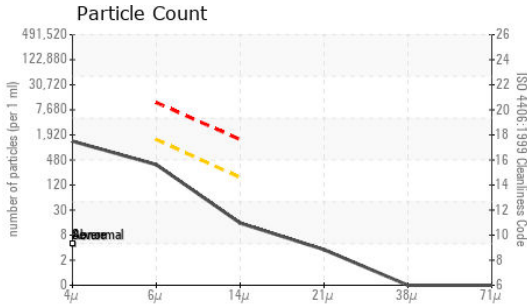


FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN) mg KOH/g	ASTM D974*	0.70	0.39	0.37	---
VISUAL					
method	limit/base	current	history1	history2	
White Metal	scalar Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	NONE
Debris	scalar Visual*	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.05	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES

method	limit/base	current	history1	history2	
Visc @ 40°C	cSt ASTM D7279(m)	46.4	44.7	44.9	44.7
Visc @ 100°C	cSt ASTM D7279(m)	6.92	6.9	7	6.9
Viscosity Index (VI)	Scale ASTM D2270*	104	110	113	110

SAMPLE IMAGES

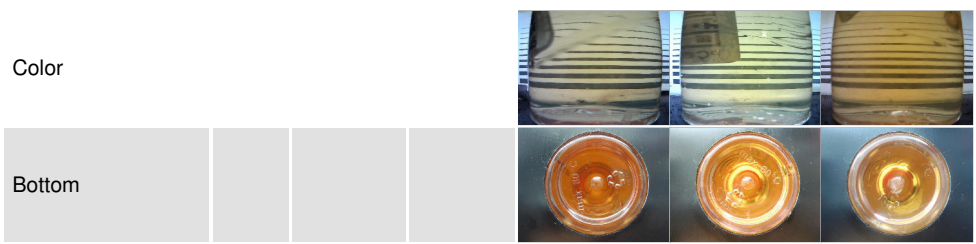

Color

Bottom



ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0076945 **Received** : 24 Jan 2024
Lab Number : **02610882** **Diagnosed** : 25 Jan 2024
Unique Number : 5719977 **Diagnostician** : Wes Davis
Test Package : IND 2 (Additional Tests: KV100, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Dryden Fibre
 Box 3001, 1 Duke Street
 Dryden, ON
 CA P8N 2Z7
 Contact: Adebukola Adekanye
 aadekanye@drydenfibre.ca
 T: (807)223-9950
 F: (807)223-9176