


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

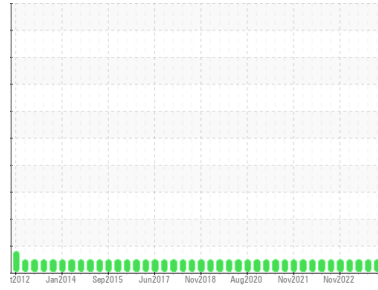

Area
TEAM 3
Machine Id
165174
Component
Inboard Bearing
Fluid
PETRO CANADA TURBOFLO R&O 220 (1 QTS)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

| method | limit/base | current | history1 | history2 |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | PC0077057 | PC0074811 | PC0070268 |
| Sample Date | Client Info | 13 Jan 2024 | 08 Aug 2023 | 06 Feb 2023 |
| Machine Age | hrs | Client Info | 0 | 0 |
| Oil Age | hrs | Client Info | 0 | 0 |
| Oil Changed | Client Info | N/A | N/A | N/A |
| Sample Status | | NORMAL | NORMAL | NORMAL |

CONTAMINATION

| method | limit/base | current | history1 | history2 |
|--------|--------------|------------|----------|----------|
| Water | WC Method >2 | NEG | NEG | NEG |

WEAR METALS

| method | limit/base | current | history1 | history2 | |
|-----------|-------------|-------------------|--------------|----------|----|
| PQ | ASTM D8184* | 0 | --- | 0 | |
| Iron | ppm | ASTM D5185(m) >20 | <1 | 2 | 1 |
| Chromium | ppm | ASTM D5185(m) >20 | 0 | 0 | 0 |
| Nickel | ppm | ASTM D5185(m) >20 | <1 | 0 | 0 |
| Titanium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185(m) >20 | <1 | <1 | <1 |
| Lead | ppm | ASTM D5185(m) >20 | 0 | 1 | 0 |
| Copper | ppm | ASTM D5185(m) >20 | 0 | <1 | 0 |
| Tin | ppm | ASTM D5185(m) >20 | 0 | 0 | 0 |
| Antimony | ppm | ASTM D5185(m) | 0 | 0 | <1 |
| Vanadium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | 0 | 0 | 0 |

ADDITIVES





| method | limit/base | current | history1 | history2 | |
|------------|------------|-----------------|--------------|----------|------|
| Boron | ppm | ASTM D5185(m) | <1 | <1 | <1 |
| Barium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Manganese | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Magnesium | ppm | ASTM D5185(m) | <1 | <1 | <1 |
| Calcium | ppm | ASTM D5185(m) 0 | <1 | <1 | 0 |
| Phosphorus | ppm | ASTM D5185(m) 4 | 7 | 9 | 4 |
| Zinc | ppm | ASTM D5185(m) 0 | 6 | 4 | 5 |
| Sulfur | ppm | ASTM D5185(m) | 1029 | 1019 | 1139 |
| Lithium | ppm | ASTM D5185(m) | <1 | <1 | <1 |

CONTAMINANTS

| method | limit/base | current | history1 | history2 | |
|-----------|------------|-------------------|--------------|----------|----|
| Silicon | ppm | ASTM D5185(m) >15 | <1 | <1 | <1 |
| Sodium | ppm | ASTM D5185(m) | 0 | 0 | 0 |
| Potassium | ppm | ASTM D5185(m) >20 | <1 | 0 | 0 |

FLUID DEGRADATION

| method | limit/base | current | history1 | history2 | |
|------------------|------------|-----------------|-------------|----------|------|
| Acid Number (AN) | mg KOH/g | ASTM D974* 0.17 | 0.13 | --- | 0.16 |

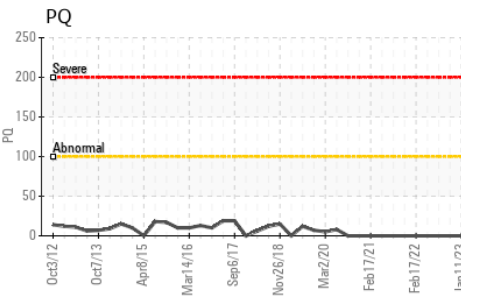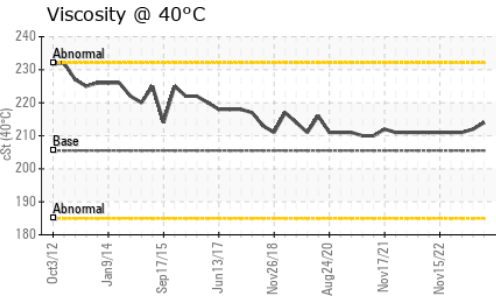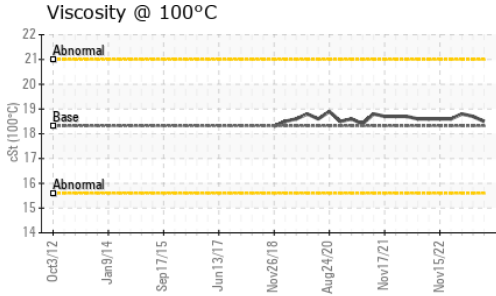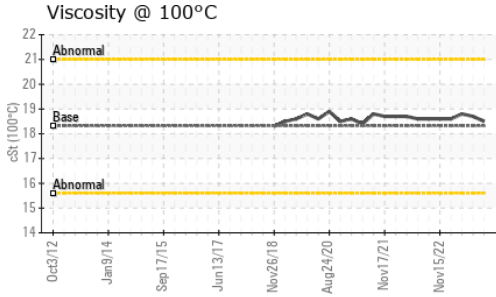

| VISUAL | method | limit/base | current | history1 | history2 |
|------------------|--------|------------|---------|----------|----------|
| White Metal | scalar | Visual* | NONE | NONE | NONE |
| Yellow Metal | scalar | Visual* | NONE | NONE | NONE |
| Precipitate | scalar | Visual* | NONE | NONE | NONE |
| Silt | scalar | Visual* | NONE | NONE | NONE |
| Debris | scalar | Visual* | NONE | NONE | NONE |
| Sand/Dirt | scalar | Visual* | NONE | NONE | NONE |
| Appearance | scalar | Visual* | NORML | NORML | NORML |
| Odor | scalar | Visual* | NORML | NORML | NORML |
| Emulsified Water | scalar | Visual* | >2 | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG |

| FLUID PROPERTIES | method | limit/base | current | history1 | history2 |
|----------------------|--------|---------------|---------|----------|----------|
| Visc @ 40°C | cSt | ASTM D7279(m) | 205.5 | 212 | 211 |
| Visc @ 100°C | cSt | ASTM D7279(m) | 18.32 | 18.7 | 18.8 |
| Viscosity Index (VI) | Scale | ASTM D2270* | 98 | 98 | 99 |

| SAMPLE IMAGES | method | limit/base | current | history1 | history2 |
|---------------|--------|------------|---------|----------|----------|
| Color | | | | | |
| Bottom | | | | | |

| GRAPHS | |
|--------|--|
| | |
| | |
| | |



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0077057 **Received** : 24 Jan 2024
Lab Number : 02610975 **Diagnosed** : 25 Jan 2024
Unique Number : 5720070 **Diagnostician** : Kevin Marson
Test Package : IND 2 (Additional Tests: KV100, TAN Man, VI)

Dryden Fibre
 Box 3001, 1 Duke Street
 Dryden, ON
 CA P8N 2Z7
 Contact: Adebukola Adekanye
 aadekanye@drydenfibre.ca
 T: (807)223-9950
 F: (807)223-9176

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.