


# OIL ANALYSIS REPORT

Sample Rating Trend



**NORMAL**

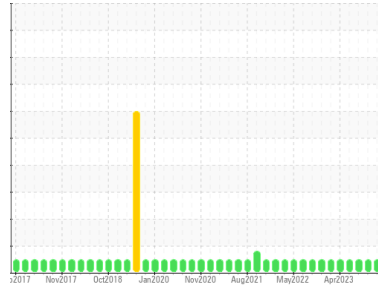

Area  
**TEAM 1**  
Machine Id  
**136120 ID Fan Outboard**  
Component  
**Bearing**  
Fluid  
**PETRO CANADA TURBOFLO R&O 68 (4 QTS)**

**DIAGNOSIS**

**Recommendation**  
Resample at the next service interval to monitor.

**Wear**  
All component wear rates are normal.

**Contamination**  
There is no indication of any contamination in the oil.

**Fluid Condition**  
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>PC0078798</b>	PC0069859	PC0069915
Sample Date	Client Info			<b>22 Jan 2024</b>	24 Oct 2023	24 Aug 2023
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>2	<b>NEG</b>	NEG	NEG




WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	<b>2</b>	1	2
Chromium	ppm	ASTM D5185(m)	>20	<b>0</b>	0	0
Nickel	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	0
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	0
Lead	ppm	ASTM D5185(m)	>20	<b>18</b>	12	13
Copper	ppm	ASTM D5185(m)	>20	<b>14</b>	14	13
Tin	ppm	ASTM D5185(m)	>20	<b>1</b>	<1	<1
Antimony	ppm	ASTM D5185(m)		<b>&lt;1</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<b>0</b>	<1	0
Barium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185(m)		<b>0</b>	0	0
Manganese	ppm	ASTM D5185(m)		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Calcium	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	<1	1
Phosphorus	ppm	ASTM D5185(m)	4	<b>12</b>	13	14
Zinc	ppm	ASTM D5185(m)	0	<b>12</b>	12	14
Sulfur	ppm	ASTM D5185(m)		<b>178</b>	182	180
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	<b>0</b>	0	0
Sodium	ppm	ASTM D5185(m)		<b>3</b>	2	3
Potassium	ppm	ASTM D5185(m)	>20	<b>&lt;1</b>	0	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.11	<b>0.06</b>	0.08	0.05

# OIL ANALYSIS REPORT






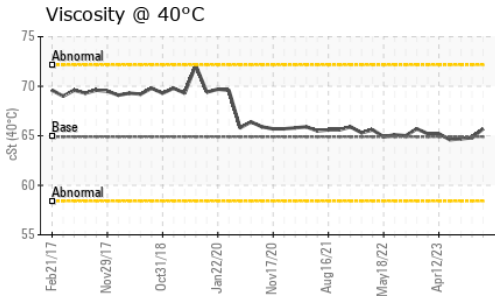
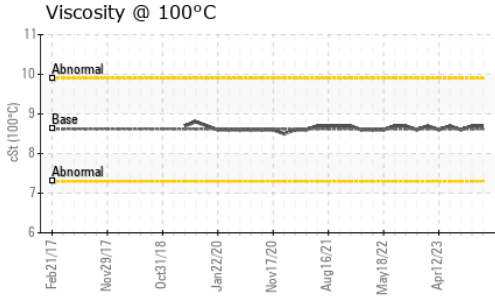
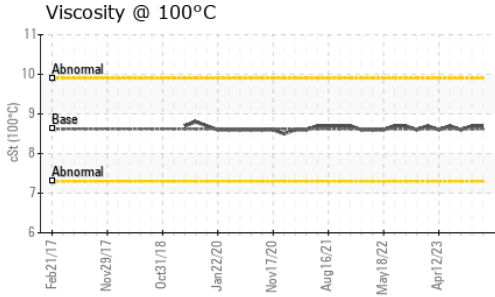


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>2	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D7279(m)	64.9	65.7	64.8	64.7
Visc @ 100°C	cSt	ASTM D7279(m)	8.62	8.7	8.7	8.6
Viscosity Index (VI)	Scale	ASTM D2270*	104	104	106	104

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

## GRAPHS

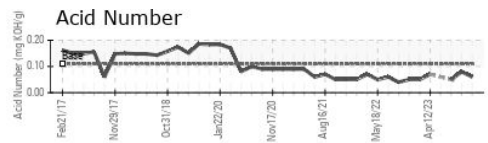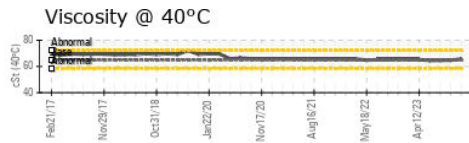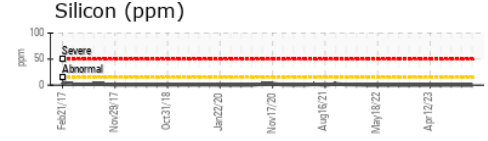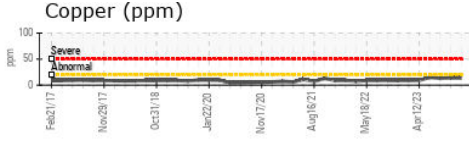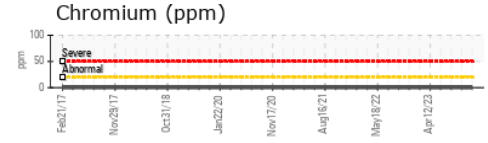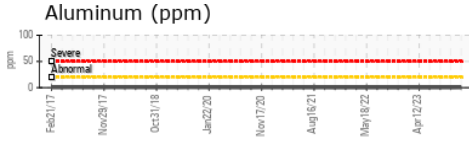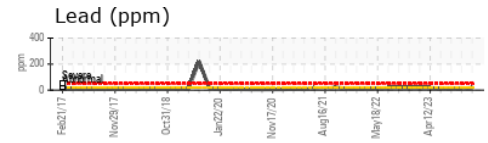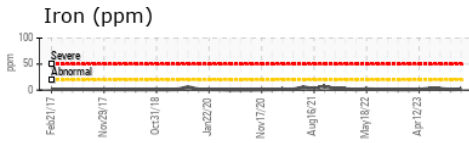

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0078798 **Received** : 31 Jan 2024  
**Lab Number** : 02612463 **Diagnosed** : 01 Feb 2024  
**Unique Number** : 5721558 **Diagnostician** : Wes Davis  
**Test Package** : MOB 2 ( Additional Tests: KV100, TAN Man, VI )

**Dryden Fibre**  
 Box 3001, 1 Duke Street  
 Dryden, ON  
 CA P8N 2Z7  
 Contact: Adebukola Adekanye  
 aadekanye@drydenfibre.ca  
 T: (807)223-9950  
 F: (807)223-9176

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.