


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

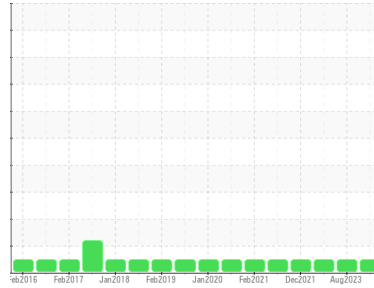

Machine Id
20007904 BATTER OAKES (S/N 386621415078)

Component
Hydraulic System

Fluid
PETRO CANADA PURITY FG HYDRAULIC AW 68 (200 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PC0058597	PC0058600	PC0058611
Sample Date	Client Info			29 Jan 2024	01 Aug 2023	18 Jan 2023
Machine Age	hrs	Client Info		32000	31000	30000
Oil Age	hrs	Client Info		3000	4000	3000
Oil Changed	Client Info			Not Changed	Not Changed	Not Changed
Sample Status				NORMAL	NORMAL	NORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	NEG	NEG	NEG






WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	2	2	3
Chromium	ppm	ASTM D5185(m)	>20	0	0	0
Nickel	ppm	ASTM D5185(m)	>20	0	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	<1	<1	0
Lead	ppm	ASTM D5185(m)	>20	0	0	<1
Copper	ppm	ASTM D5185(m)	>20	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>20	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	<1
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	<1	<1
Barium	ppm	ASTM D5185(m)		0	0	0
Molybdenum	ppm	ASTM D5185(m)		0	0	0
Manganese	ppm	ASTM D5185(m)		0	0	0
Magnesium	ppm	ASTM D5185(m)		<1	<1	<1
Calcium	ppm	ASTM D5185(m)		<1	<1	0
Phosphorus	ppm	ASTM D5185(m)		448	503	480
Zinc	ppm	ASTM D5185(m)		8	9	8
Sulfur	ppm	ASTM D5185(m)		462	450	465
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	3	3	3
Sodium	ppm	ASTM D5185(m)		0	0	0
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	0

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>5000	1142	443	565
Particles >6µm		ASTM D7647	>1300	352	121	145
Particles >14µm		ASTM D7647	>160	33	11	16
Particles >21µm		ASTM D7647	>40	9	4	6
Particles >38µm		ASTM D7647	>10	1	1	1
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>19/17/14	17/16/12	16/14/11	16/14/11

OIL ANALYSIS REPORT

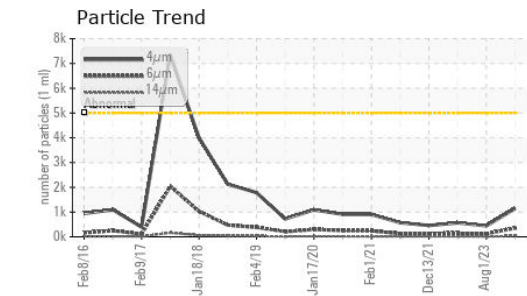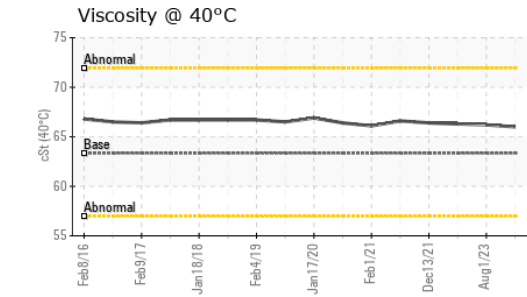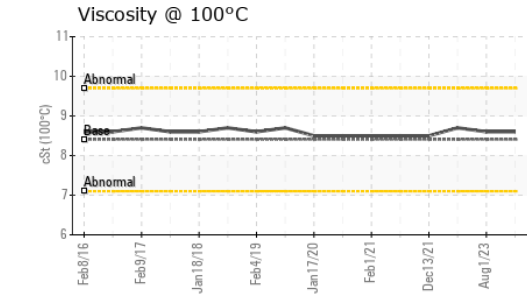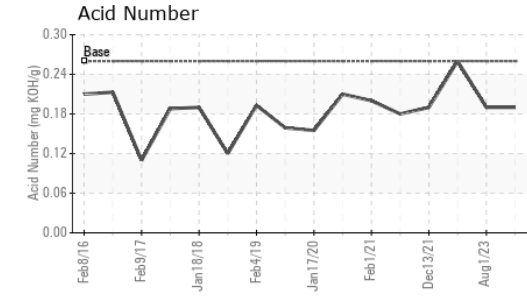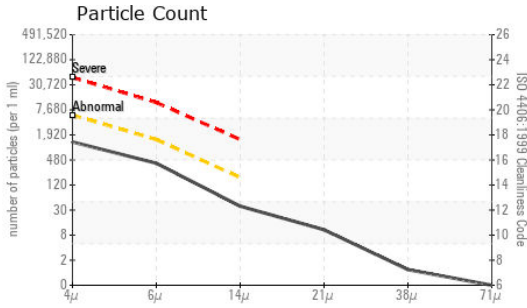


FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.26	0.19	0.19	0.26

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	63.34	66.0	66.2	66.3
Visc @ 100°C	cSt	ASTM D7279(m)	8.409	8.6	8.6	8.7
Viscosity Index (VI)	Scale	ASTM D2270*	102	101	100	102

SAMPLE IMAGES

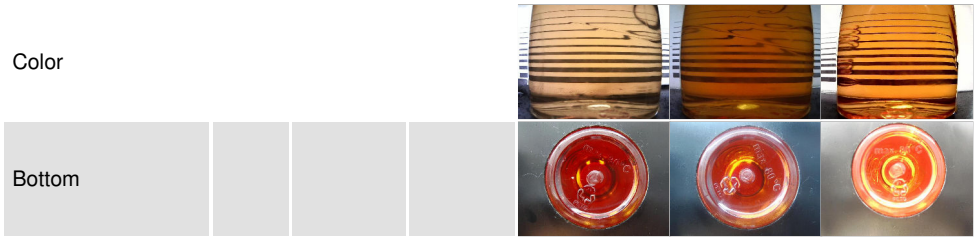

Color

Bottom



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9

Sample No. : PC0058597

Lab Number : **02612832**

Unique Number : 5721927

Test Package : IND 2 (Additional Tests: KV100, VI)

Received : 01 Feb 2024

Diagnosed : 02 Feb 2024

Diagnostician : Wes Davis

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

MCCAIN FOODS-FLORENCEVILLE
 8800 MAIN ST
 FLORENCEVILLE-BRISTOL, NB
 CA E7L 1B2
 Contact: Robert Green
 robert.green@mccain.ca
 T: (506)392-4839
 F: (506)392-0891