




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

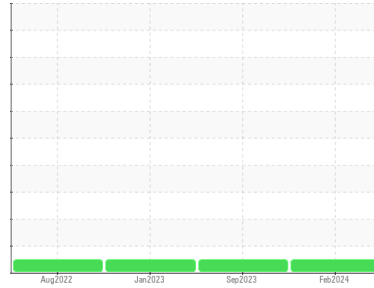

Machine Id
126054

Component
Diesel Engine

Fluid
PETRO CANADA DURON XL SYN BLEND 15W40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GFL0099570	GFL0091622	GFL0063708
Sample Date	Client Info		03 Feb 2024	19 Sep 2023	25 Jan 2023
Machine Age	hrs	Client Info	11823	12600	11635
Oil Age	hrs	Client Info	561	0	1295
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Fuel	WC Method	>5	<1.0	<1.0	<1.0
Water	WC Method	>0.2	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>100	32	57	44
Chromium	ppm	ASTM D5185(m)	>20	<1	1	<1
Nickel	ppm	ASTM D5185(m)	>4	<1	<1	<1
Titanium	ppm	ASTM D5185(m)		0	0	<1
Silver	ppm	ASTM D5185(m)	>3	0	0	0
Aluminum	ppm	ASTM D5185(m)	>20	3	4	4
Lead	ppm	ASTM D5185(m)	>40	0	<1	0
Copper	ppm	ASTM D5185(m)	>330	1	2	2
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	1	2	2	4
Barium	ppm	ASTM D5185(m)	1	0	<1	0
Molybdenum	ppm	ASTM D5185(m)	60	60	64	64
Manganese	ppm	ASTM D5185(m)	1	0	<1	<1
Magnesium	ppm	ASTM D5185(m)	1010	958	978	985
Calcium	ppm	ASTM D5185(m)	1070	1078	1153	1165
Phosphorus	ppm	ASTM D5185(m)	1150	999	1026	1080
Zinc	ppm	ASTM D5185(m)	1270	1185	1260	1275
Sulfur	ppm	ASTM D5185(m)	2060	2229	1976	2218
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS




	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>25	5	8	7
Sodium	ppm	ASTM D5185(m)		37	110	78
Potassium	ppm	ASTM D5185(m)	>20	9	27	26
Glycol	%	ASTM D7922*		0.0	0.0	0.0

INFRA-RED

	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*	>3	0.4	0.6	0
Nitration	Abs/cm	ASTM D7624*	>20	12.7	16.5	7.8
Sulfation	Abs/.1mm	ASTM D7415*	>30	24.6	29.9	19.1



OIL ANALYSIS REPORT






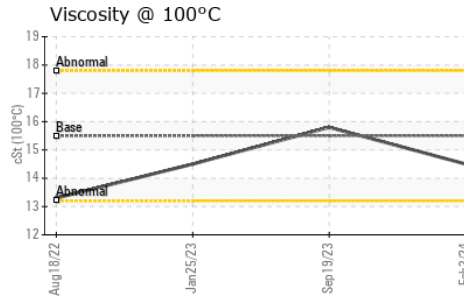
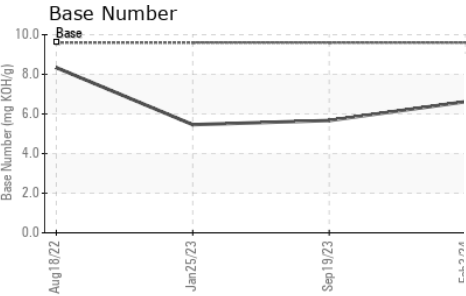
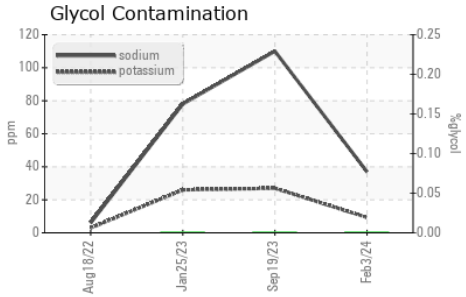


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	27.0	36.0	15.2
Base Number (BN)	mg KOH/g	ASTM D2896*	9.6	6.62	5.67	5.46

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.5	14.5	15.8	14.5

GRAPHS

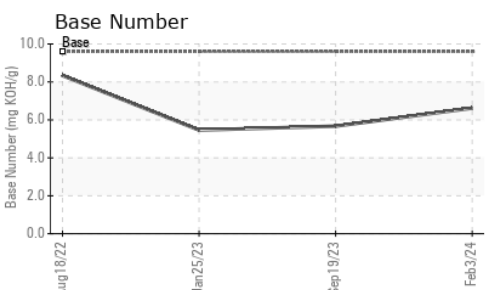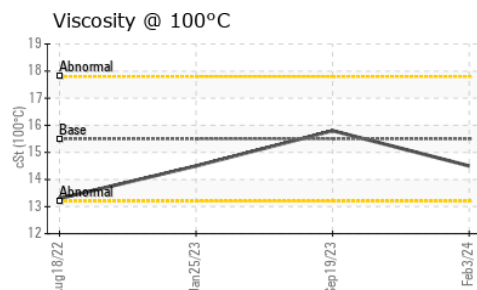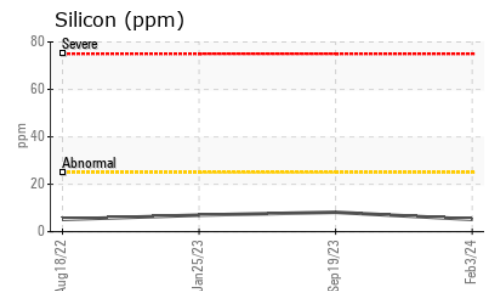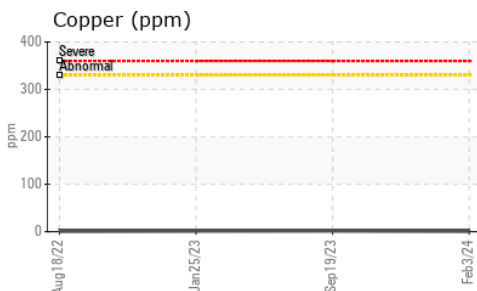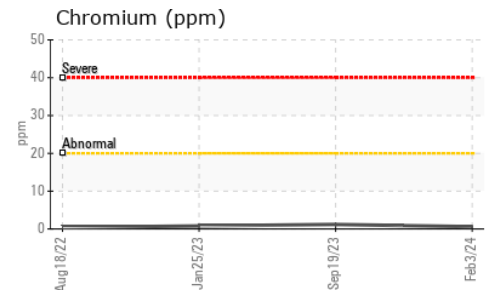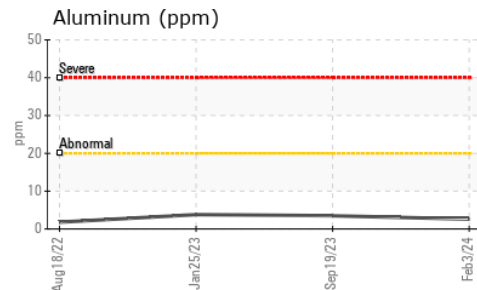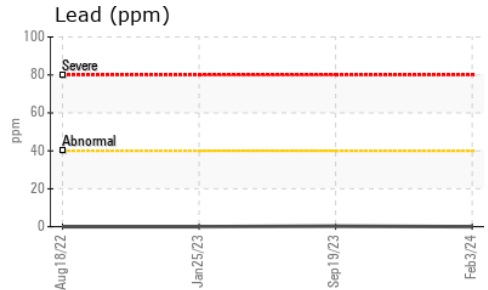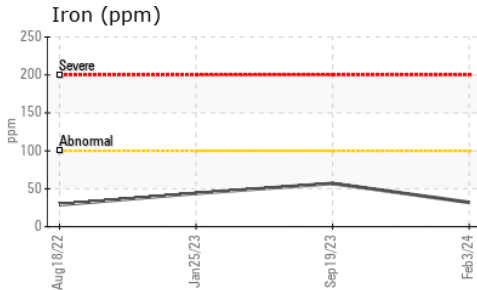

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GFL0099570 **Received** : 08 Feb 2024
Lab Number : **02614222** **Tested** : 09 Feb 2024
Unique Number : 5723317 **Diagnosed** : 09 Feb 2024 - Kevin Marson
Test Package : MOB 2 (Additional Tests: Glycol)

GFL Environmental - 550 - Rocky View County
 220 Carmek Blvd
 Rocky View County, AB
 CA T1X 1X1
 Contact: GFL Calgary
 calgarymaintenance@gflenv.com
 T:
 F: (403)369-6163

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.