

COOLANT REPORT

NO UNIT PC0081069

Component

Coolant

EXTENDED LIFE COOLANT (--- GAL)

Sample Rating Trend



DIAGNOSIS

Recommendation

The fluid is suitable for further service. Resample at the next service interval to monitor.

Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

Contaminants

There is no indication of any contamination in the coolant.


Coolant Condition

The nitrite level is acceptable. The pH level of this fluid is within the acceptable limits. The reserve alkalinity of this fluid is acceptable.


				Feb2024		
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PC0081069		
Sample Date		Client Info		15 Feb 2024		
Machine Age	hrs	Client Info		0		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				NORMAL		
PHYSICAL TEST F	RESULTS	method	limit/base	current	history1	history2
Specific Gravity		ASTM D1298*		1.069		
рН	Scale 0-14	ASTM D1287*	9.0	8.72		
Nitrites	ppm	Alcan Test Kit*		640		
Reserve Alkalinity	Scale 0-20	ASTM D1121*		2.7		
Percentage Glycol	%	ASTM D3321*	50	51.5		
Freezing Point	°C	ASTM D3321*	-40	-39		
Boiling Point	°C	WC Method*		108		
Carboxylate						
CORROSION INH	IBITORS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)		6		
Phosphorus	ppm	ASTM D5185(m)		15		
Boron	ppm	ASTM D5185(m)		18		
Molybdenum	ppm	ASTM D5185(m)		179		
CORROSION		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>15	0		
Aluminum	ppm	ASTM D5185(m)	>10	1		
Copper	ppm	ASTM D5185(m)	>10	0		
Lead	ppm	ASTM D5185(m)	>10	0		
Tin	ppm	ASTM D5185(m)	>10	0		
Silver	ppm	ASTM D5185(m)	>10	<1		
Zinc	ppm	ASTM D5185(m)		<1		
CARRIER SAL	TS	method	limit/base	current	history1	history2
Sodium	ppm	ASTM D5185(m)		6366		
Potassium	ppm	ASTM D5185(m)		8516		
SCALE POTEN	ITIAL	method	limit/base	current	history1	history2
Calcium	ppm	ASTM D5185(m)	>100	7		
Magnesium	ppm	ASTM D5185(m)	>40	4		
Hardness	mg/L CaCO3	In-house*	<75	33		



COOLANT REPORT





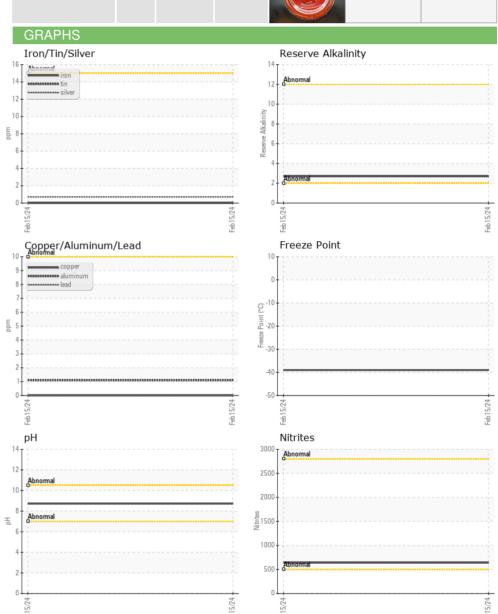



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Unique Number : 5733587

: PC0081069 Lab Number : 02616477

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 Received **Tested**

: 21 Feb 2024 Diagnosed

: 21 Feb 2024 - Kevin Marson

: 16 Feb 2024

Test Package: COOL (Additional Tests: GlycolType) To discuss this sample report, contact Customer Service at 1-800-268-2131.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.

Suncor - Terra Nova Projects

Scotia Centre, 235 Water Strret St. John's, NL CA A1C 1B6 Contact: Josh Hynes joshynes@suncor.com T: (709)778-3575

F: (709)724-2835