




OIL ANALYSIS REPORT

Sample Rating Trend

WEAR

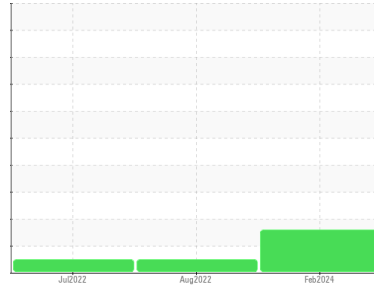

Machine Id
831043
 Component
Natural Gas Engine
 Fluid
PETRO CANADA DURON GEO LD 15W40 (--- GAL)

DIAGNOSIS

Recommendation

We recommend an early resample to monitor this condition.

Wear

Chromium and iron ppm levels are marginal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	GFL0102610	GFL0057716	GFL0054189
Sample Date	Client Info	10 Feb 2024	11 Aug 2022	19 Jul 2022
Machine Age	hrs	4646	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	Changed	Changed
Sample Status		MARGINAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Water	WC Method >0.1	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185(m) >50	▲ 34	8	20
Chromium	ppm ASTM D5185(m) >5	▲ 3	<1	1
Nickel	ppm ASTM D5185(m) >4	1	<1	<1
Titanium	ppm ASTM D5185(m) >5	0	<1	<1
Silver	ppm ASTM D5185(m) >3	0	0	0
Aluminum	ppm ASTM D5185(m) >25	5	2	3
Lead	ppm ASTM D5185(m) >40	12	<1	1
Copper	ppm ASTM D5185(m) >150	3	<1	2
Tin	ppm ASTM D5185(m) >4	1	<1	<1
Antimony	ppm ASTM D5185(m)	0	<1	0
Vanadium	ppm ASTM D5185(m)	0	0	0
Beryllium	ppm ASTM D5185(m)	0	0	0
Cadmium	ppm ASTM D5185(m)	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m) 50	7	20	8
Barium	ppm ASTM D5185(m) 5	0	0	0
Molybdenum	ppm ASTM D5185(m) 50	60	50	51
Manganese	ppm ASTM D5185(m) 0	<1	<1	1
Magnesium	ppm ASTM D5185(m) 560	649	561	535
Calcium	ppm ASTM D5185(m) 1510	1834	1557	1584
Phosphorus	ppm ASTM D5185(m) 780	844	780	654
Zinc	ppm ASTM D5185(m) 870	1029	886	886
Sulfur	ppm ASTM D5185(m) 2040	2138	2098	1979
Lithium	ppm ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >25	5	5	6
Sodium	ppm ASTM D5185(m)	14	6	10
Potassium	ppm ASTM D5185(m) >20	7	<1	8
Glycol	% ASTM D7922*	0.0	---	---

INFRA-RED

method	limit/base	current	history1	history2
Soot %	% ASTM D7844*	0	0	0
Nitration	Abs/cm ASTM D7624*	14.2	8.4	12.1
Sulfation	Abs/.1mm ASTM D7415*	29.9	20.3	24.0


FLUID DEGRADATION

method	limit/base	current	history1	history2
Oxidation	Abs/.1mm ASTM D7414*	28.0	16.8	19.7




OIL ANALYSIS REPORT


▲ Ferrous Alloys

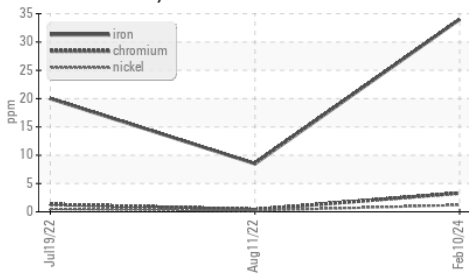

Glycol Contamination

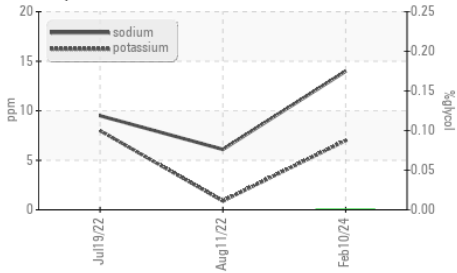

Viscosity @ 100°C

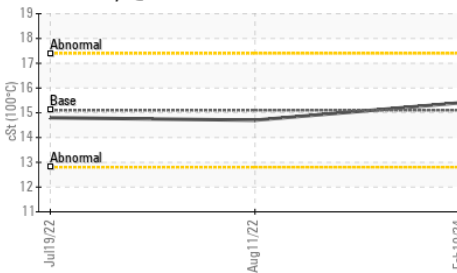


VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.1	15.4	14.7

GRAPHS


▲ Iron (ppm)

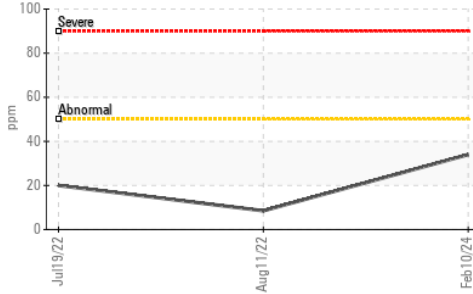


Lead (ppm)

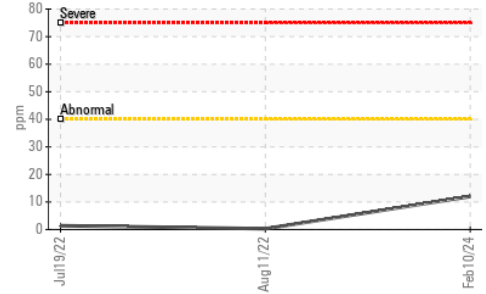


Aluminum (ppm)

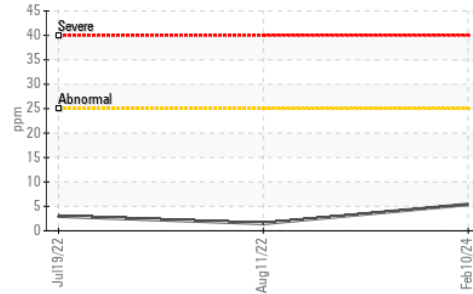


▲ Chromium (ppm)

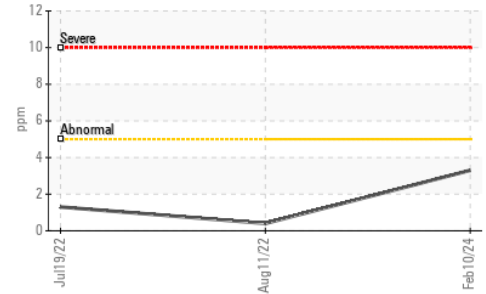


Copper (ppm)

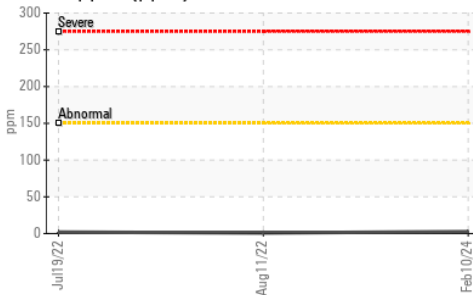


Silicon (ppm)

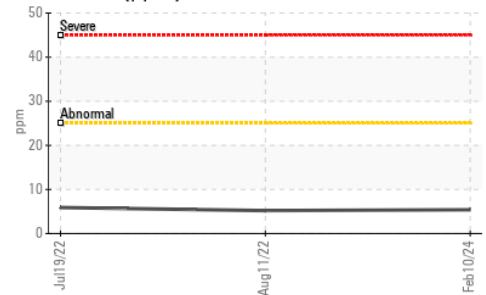

Viscosity @ 100°C

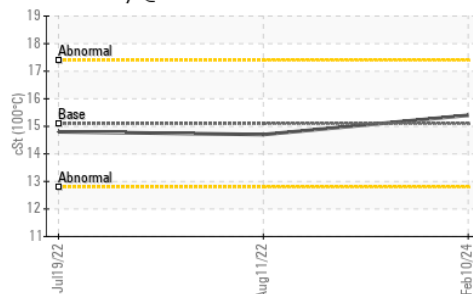

Additives

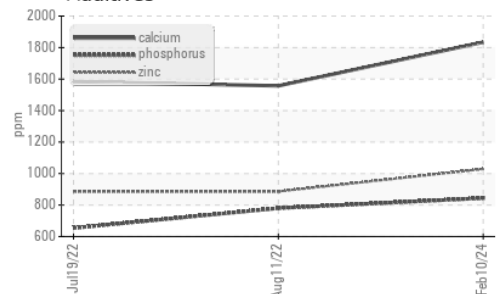

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GFL0102610
Lab Number : 02616538
Unique Number : 5733648
Test Package : MOB 1 (Additional Tests: Glycol)

GFL Environmental - 554 - Edmonton SW
 8409 -15th Street NW
 Edmonton, AB
 CA T6P 0B8
 Contact: Tim Greig
 tgreig@gflenv.com
 T: (780)231-0521
 F:

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.