


# **OIL ANALYSIS REPORT**

## **Sample Rating Trend**







Component Reciprocating Compressor

PETRO CANADA SENTRON LD 3000 (--- LTR)

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

#### Wear

All component wear rates are normal.

### Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.


## **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

TRON LD 3000 ( LTR)						
SAMPLE INFORI	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PC0085506	PC0085491	PC90000913
Sample Date		Client Info		16 Feb 2024	17 Jan 2024	25 Oct 2023
Machine Age	hrs	Client Info		30859	30149	28203
Oil Age	hrs	Client Info		0	0	1846
Oil Changed		Client Info		Not Changd	N/A	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METAL	S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>50	<1	<1	0
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)		0	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		<1	0	0
Aluminum	ppm	ASTM D5185(m)	>25	1	1	1
Lead	ppm	ASTM D5185(m)	>25	<1	<1	0
Copper	ppm	ASTM D5185(m)	>50	4	3	5
Tin	ppm	ASTM D5185(m)	>15	<1	<1	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	<1	<1	1
Barium	ppm	ASTM D5185(m)	1	0	0	0
Molybdenum	ppm	ASTM D5185(m)	2	0	0	0
Manganese	ppm	ASTM D5185(m)	1	0	0	0
Magnesium	ppm	ASTM D5185(m)	5	7	6	6
Calcium	ppm	ASTM D5185(m)	1220	1230	1222	1148
Phosphorus	ppm	ASTM D5185(m)	298	264	260	269
Zinc	ppm	ASTM D5185(m)	350	303	298	305
Sulfur	ppm	ASTM D5185(m)	1995	2172	2132	
Lithium	ppm	ASTM D5185(m)		<1	<1	0
CONTAMINAN	TS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	1	1	2
Sodium	ppm	ASTM D5185(m)		<1	<1	0
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	0
Water	%	ASTM D6304*	>0.1	0.007	0.002	
ppm Water	ppm	ASTM D6304*	>1000	76	23	
FLUID CLEANI	LINESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>1300	177	145	
Particles >6µm		ASTM D7647	>640	57	54	
Particles >14µm		ASTM D7647	>160	6	6	
Particles >21µm		ASTM D7647	>40	2	2	
Particles >38µm		ASTM D7647	>10	1	0	
Particles >71µm		ASTM D7647	>3	1	0	
Oil Cleanliness		ISO 4406 (c)	>17/16/14	15/13/10	14/13/10	



## OIL ANALYSIS REPORT

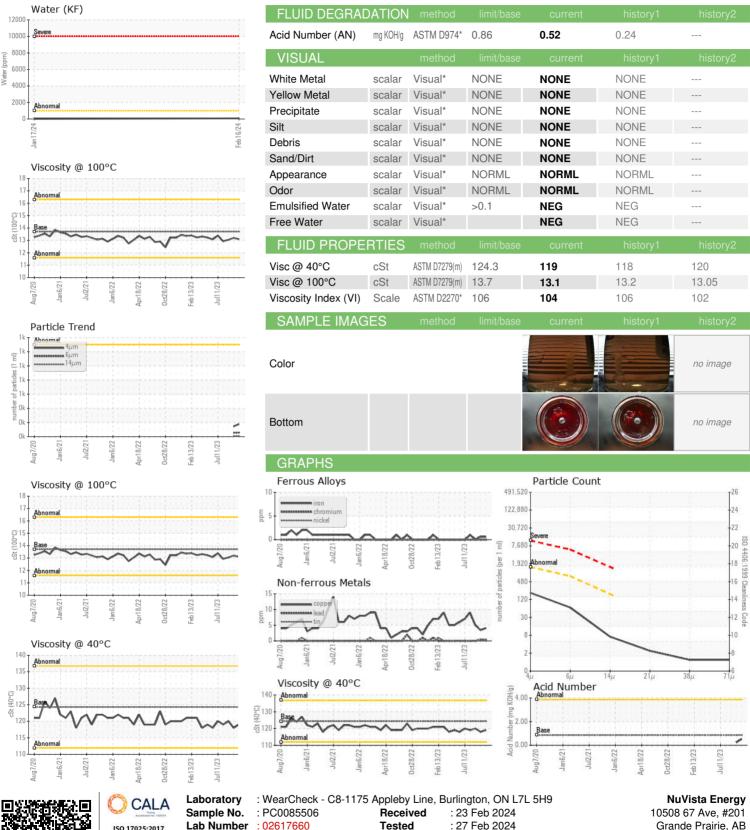



ISO 17025:2017 Accredited

Lab Number

: 02617660 Unique Number : 5734770

**Tested** Diagnosed Test Package: PLANT (Additional Tests: KF, KV100, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

Validity of results and interpretation are based on the sample and information as supplied.

: 27 Feb 2024 - Wes Davis

Grande Prairie, AB **CA T8W 0K8** 

Contact: Eldon Weaver eweaver@nvaenergy.com

T: F: