


OIL ANALYSIS REPORT

Sample Rating Trend







Machine Id **K604** Component

Reciprocating Compressor

PETRO CANADA SENTRON LD 3000 (--- LTR)



DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

I HON LD 3000 (-		May2023	un2023 Jul2023 Jul202	3 Aug 2023 Sep 2023 Oct 2023	Feb2024	
SAMPLE INFOR	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		PC0085500	PC90000515	PC90000513
Sample Date		Client Info		16 Feb 2024	25 Oct 2023	11 Sep 2023
Machine Age	hrs	Client Info		7307	4648	3723
Oil Age	hrs	Client Info		0	2080	1155
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>50	<1	2	2
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)		0	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		<1	0	0
Aluminum	ppm	ASTM D5185(m)	>25	1	1	1
Lead	ppm	ASTM D5185(m)	>25	<1	0	0
Copper	ppm	ASTM D5185(m)	>50	6	13	9
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	2	4	5
Barium	ppm	ASTM D5185(m)	1	0	0	0
Molybdenum	ppm	ASTM D5185(m)	2	<1	0	0
Manganese	ppm	ASTM D5185(m)	1	0	0	0
Magnesium	ppm	ASTM D5185(m)	5	7	6	7
Calcium	ppm	ASTM D5185(m)	1220	1236	1213	1288
Phosphorus	ppm	ASTM D5185(m)	298	266	287	283
Zinc	ppm	ASTM D5185(m)	350	302	314	322
Sulfur	ppm	ASTM D5185(m)	1995	2116		
Lithium	ppm	ASTM D5185(m)		<1	0	0
CONTAMINAN	ITS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	2	3	2
Sodium	ppm	ASTM D5185(m)		<1	1	1
Potassium	ppm	ASTM D5185(m)	>20	<1	0	0
Water	%	ASTM D6304*	>0.1	0.005		
ppm Water	ppm	ASTM D6304*	>1000	54		
FLUID CLEAN	LINESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>1300	211		
Particles >6µm		ASTM D7647	>640	92		
Particles >14μm		ASTM D7647	>160	16		
Particles >21µm		ASTM D7647	>40	6		
Particles >38µm		ASTM D7647	>10	1		
Particles >71μm		ASTM D7647	>3	1		
Oil Cleanliness		ISO 4406 (c)	>17/16/14	15/14/11		



OIL ANALYSIS REPORT

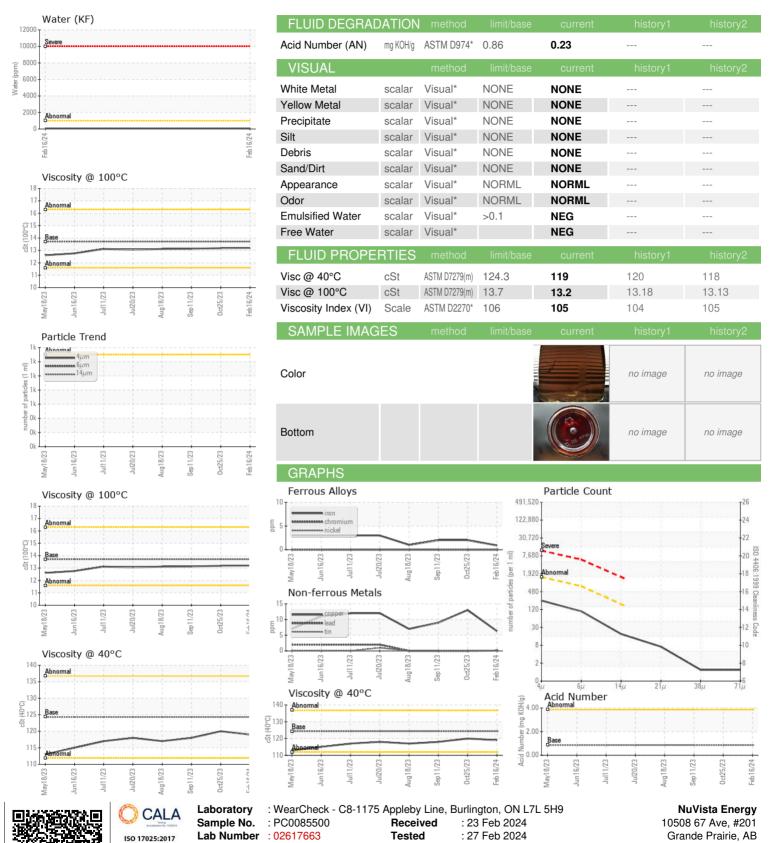

Unique Number : 5734773

Test Package: PLANT (Additional Tests: KF, KV100, VI)

Validity of results and interpretation are based on the sample and information as supplied.

Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.

To discuss this sample report, contact Customer Service at 1-800-268-2131.

Accredited

: 27 Feb 2024 - Wes Davis

Diagnosed

T:

F:

CA T8W 0K8

Contact: Eldon Weaver

eweaver@nvaenergy.com