


FUEL REPORT

Sample Rating Trend



ISO

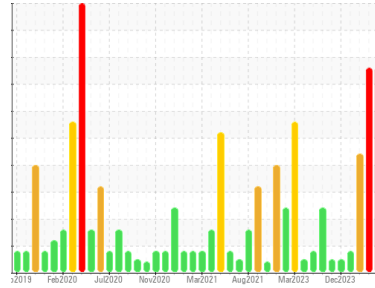

Area
CRANES
Machine Id
Crane - Fwd Fuel Sample (S/N Sample Tag: MA-04003)
Component
Diesel Fuel
Fluid
No.2 DIESEL FUEL (LOW-SULPHUR) (--- GAL)

DIAGNOSIS

▲ Recommendation

We advise that you check all areas where contaminants can enter the system. Laboratory test indicate that this fuel is suitable for use and meets all test requirements. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We advise that you filter this fluid before use. Resample in 30-45 days to monitor this situation.

▲ Contaminants

There is a high amount of particulates (2 to 100 microns in size) present in the fuel. The water content is negligible.

Fuel Condition

The fuel is still serviceable provided that the contaminant(s) can be reduced to acceptable levels. All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel (US EPA/CGSB-3.517-3 type B).

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PC	PC0076303	PC
Sample Date	Client Info	07 Feb 2024	24 Jan 2024	24 Jan 2024
Machine Age	hrs	0	0	0
Sample Status		SEVERE	ABNORMAL	SEVERE

PHYSICAL PROPERTIES

method	limit/base	current	history1	history2		
Specific Gravity	ASTM D1298*	0.839	0.851	0.853	0.854	
Fuel Color	text	Visual Screen*	Yellow	Yellow	Yellow	
Visc @ 40°C	cSt	ASTM D7279(m)	3.0	3	2.9	2.9
Pensky-Martens Flash Point	°C	ASTM D7215*	52	64.7	64.3	65.7

SULFUR CONTENT

method	limit/base	current	history1	history2		
Sulfur	ppm	ASTM D5185(m)	250	8	8	10

DISTILLATION

method	limit/base	current	history1	history2		
Initial Boiling Point	°C	ASTM D2887*	165	176	176	177
5% Distillation Point	°C	ASTM D2887*		203	202	205
10% Distill Point	°C	ASTM D2887*	201	215	214	216
15% Distillation Point	°C	ASTM D2887*		223	222	224
20% Distill Point	°C	ASTM D2887*	216	232	231	232
30% Distill Point	°C	ASTM D2887*	230	246	245	245
40% Distill Point	°C	ASTM D2887*	243	258	256	255
50% Distill Point	°C	ASTM D2887*	255	270	268	266
60% Distill Point	°C	ASTM D2887*	267	283	280	277
70% Distill Point	°C	ASTM D2887*	280	296	293	289
80% Distill Point	°C	ASTM D2887*	295	310	307	302
85% Distillation Point	°C	ASTM D2887*		321	318	311
90% Distill Point	°C	ASTM D2887*	310	331	329	321
95% Distillation Point	°C	ASTM D2887*		348	347	338
Final Boiling Point	°C	ASTM D2887*	341	363	377	353

IGNITION QUALITY

method	limit/base	current	history1	history2	
API Gravity	ASTM D1298*	37.7	34	34	34
Cetane Index	ASTM D4737*	<40.0	47	45	45






CONTAMINANTS

method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185(m)	<1.0	0	0	0
Sodium	ppm	ASTM D5185(m)	<0.1	<1	<1	<1
Potassium	ppm	ASTM D5185(m)	<0.1	0	0	0
Water	%	ASTM D6304*	<0.05	0.006	0.009	0.006
ppm Water	ppm	ASTM D6304*	<500	70	95	68

FLUID CLEANLINESS

method	limit/base	current	history1	history2	
Particles >4µm	ASTM D7647	>2500	▲ 24039	▲ 7747	▲ 35534
Particles >6µm	ASTM D7647	>640	▲ 8059	▲ 1050	▲ 9592
Particles >14µm	ASTM D7647	>80	▲ 960	▲ 34	▲ 553
Particles >21µm	ASTM D7647	>20	▲ 223	▲ 8	▲ 154
Particles >38µm	ASTM D7647	>4	5	▲ 1	▲ 4
Particles >71µm	ASTM D7647	>3	0	▲ 0	▲ 0
Oil Cleanliness	ISO 4406 (c)	>18/16/13	▲ 22/20/17	▲ 20/17/12	▲ 22/20/16




FUEL REPORT

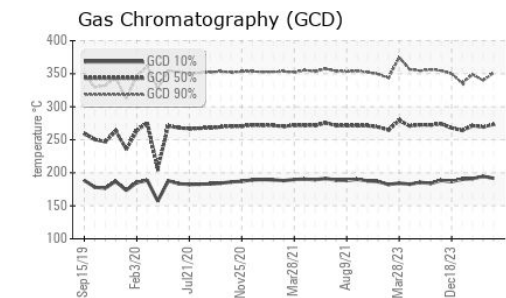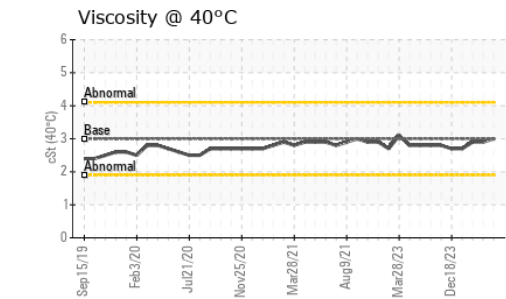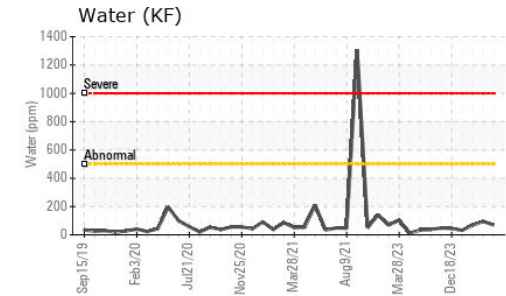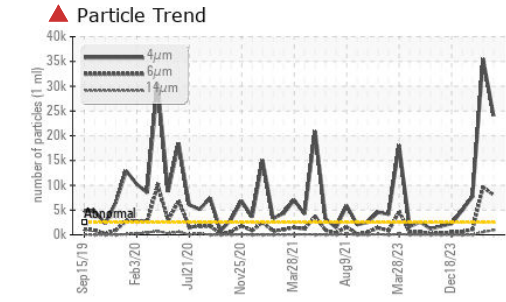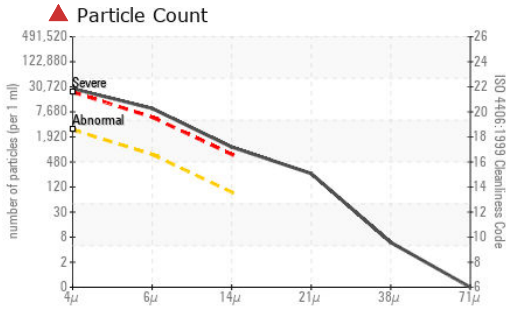

HEAVY METALS		method	limit/base	current	history1	history2
Aluminum	ppm	ASTM D5185(m)	<0.1	0	0	0
Nickel	ppm	ASTM D5185(m)	<0.1	0	0	0
Lead	ppm	ASTM D5185(m)	<0.1	0	0	0
Vanadium	ppm	ASTM D5185(m)	<0.1	0	0	0
Iron	ppm	ASTM D5185(m)	<0.1	0	0	0
Calcium	ppm	ASTM D5185(m)	<0.1	0	0	0
Magnesium	ppm	ASTM D5185(m)	<0.1	0	0	0
Phosphorus	ppm	ASTM D5185(m)	<0.1	<1	0	<1
Zinc	ppm	ASTM D5185(m)	<0.1	0	0	0

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						

GRAPHS

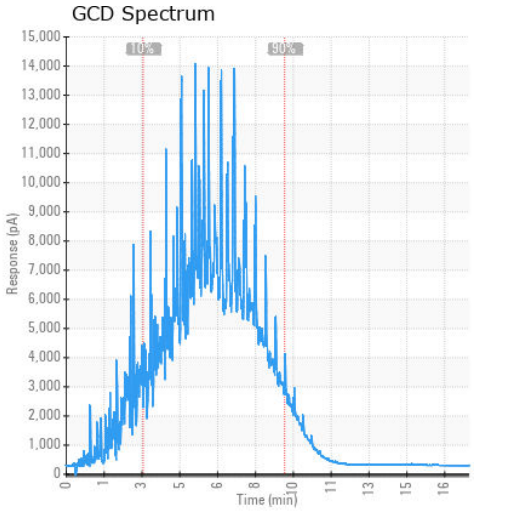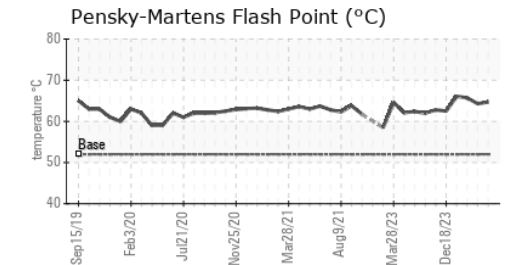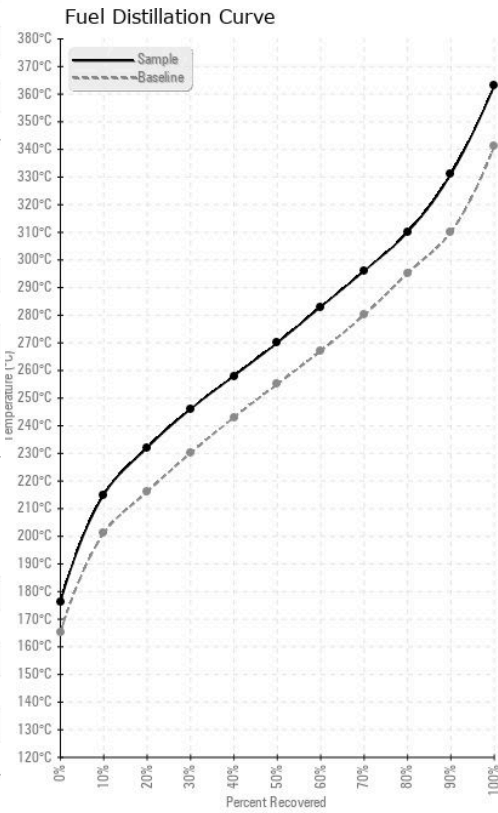

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC
Lab Number : 02618519
Unique Number : 5735629
Test Package : FUEL (Additional Tests: CC Flash, GC-PercFuel, PrtCount)
Received : 27 Feb 2024
Tested : 28 Feb 2024
Diagnosed : 29 Feb 2024 - Kevin Marson

Suncor - Terra Nova Projects
 Scotia Centre, 235 Water Street
 St. John's, NL
 CA A1C 1B6
 Contact: Josh Hynes
 joshhynes@suncor.com
 T: (709)778-3575
 F: (709)724-2835

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.