




PROBLEM SUMMARY

Sample Rating Trend

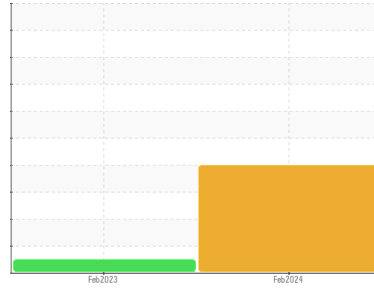

Area
[WO 450327061]
 Machine Id
Gearbox Fire Water Pump B (S/N Sample Tag CG-71001B)
 Component
Gearbox
 Fluid
PETRO CANADA PREMIUM R&O 220 (--- LTR)

COMPONENT CONDITION SUMMARY

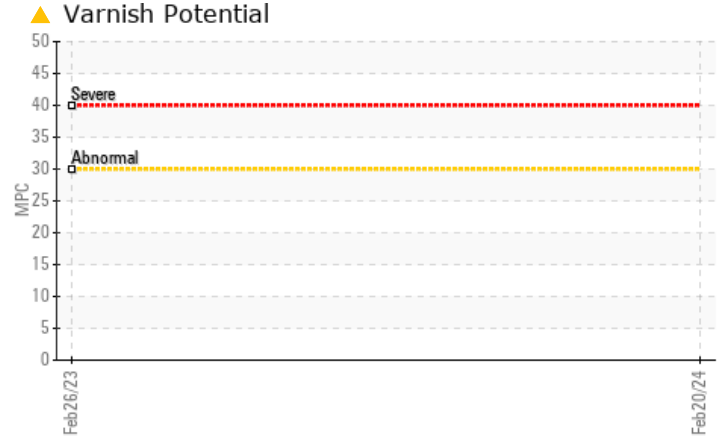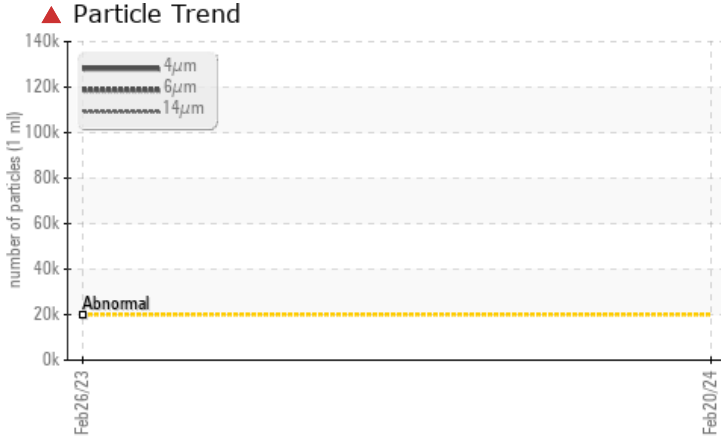

RECOMMENDATION

Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. We recommend that you use electrostatic filtration to remove insolubles from the oil and to reduce the levels of varnish in the system. Alternatively draining a percentage of the oil and topping up with fresh oil (sweetening the oil) may provide a reduction in the varnish potential level. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please submit a sample of the new (unused) oil to establish a baseline.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	NORMAL	---
Particles >4µm	ASTM D7647	>20000	▲ 134235	---	---
Particles >6µm	ASTM D7647	>5000	▲ 44139	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 24/23/17	---	---
MPC Varnish Potential	Scale	ASTM D7843(m)*	>15	▲ 45	---

Customer Id: TERHAM
 Sample No.: PC0080294
 Lab Number: 02619452
 Test Package: AOM 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	Resample in 30-45 days to monitor this situation. Please submit a sample of the new (unused) oil to establish a baseline.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Seals	---	---	?	Check seals and/or filters for points of contaminant entry.
Filter Fluid	---	---	?	We recommend that you use electrostatic filtration to remove insolubles from the oil and to reduce the levels of varnish in the system. Alternatively draining a percentage of the oil and topping up with fresh oil (sweetening the oil) may provide a reduction in the varnish potential level.

HISTORICAL DIAGNOSIS

26 Feb 2023 Diag: Kevin Marson

NORMAL




Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report





Area
[WO 450327061]
Machine Id
Gearbox Fire Water Pump B (S/N Sample Tag CG-71001B)
Component
Gearbox
Fluid
PETRO CANADA PREMIUM R&O 220 (--- LTR)

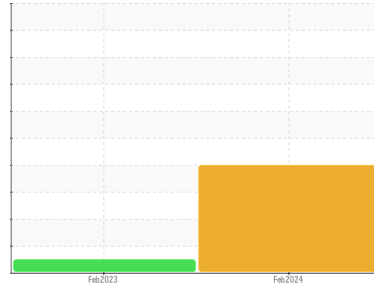

DIAGNOSIS

▲ Recommendation
Check seals and/or filters for points of contaminant entry. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. We recommend you service the filters on this component. We recommend that you use electrostatic filtration to remove insolubles from the oil and to reduce the levels of varnish in the system. Alternatively draining a percentage of the oil and topping up with fresh oil (sweetening the oil) may provide a reduction in the varnish potential level. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please submit a sample of the new (unused) oil to establish a baseline.

Wear
All component wear rates are normal. The ferrography results are normal indicating no abnormal wear in the system.

▲ Contaminants
There is a high amount of silt (particulates < 14 microns in size) present in the oil. MPC (Membrane Patch Colorimetry) test indicates a moderate concentration of varnish present.

Oil Condition
The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PC0080294	PC	---
Sample Date	Client Info	20 Feb 2024	26 Feb 2023	---
Machine Age	hrs	0	0	---
Oil Age	hrs	0	0	---
Oil Changed	Client Info	N/A	N/A	---
Sample Status		SEVERE	NORMAL	---

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	0	---
Iron	ppm ASTM D5185(m) >150	6	5	---
Chromium	ppm ASTM D5185(m) >10	0	0	---
Nickel	ppm ASTM D5185(m) >10	<1	<1	---
Titanium	ppm ASTM D5185(m)	0	0	---
Silver	ppm ASTM D5185(m)	0	0	---
Aluminum	ppm ASTM D5185(m) >5	1	<1	---
Lead	ppm ASTM D5185(m) >65	<1	0	---
Copper	ppm ASTM D5185(m) >80	<1	<1	---
Tin	ppm ASTM D5185(m) >8	0	0	---
Antimony	ppm ASTM D5185(m) >5	0	0	---
Vanadium	ppm ASTM D5185(m)	0	0	---
Beryllium	ppm ASTM D5185(m)	0	0	---
Cadmium	ppm ASTM D5185(m)	0	0	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185(m)	3	7	---
Barium	ppm ASTM D5185(m)	0	0	---
Molybdenum	ppm ASTM D5185(m)	0	0	---
Manganese	ppm ASTM D5185(m)	0	<1	---
Magnesium	ppm ASTM D5185(m) 0	<1	<1	---
Calcium	ppm ASTM D5185(m)	7	4	---
Phosphorus	ppm ASTM D5185(m) 0	31	45	---
Zinc	ppm ASTM D5185(m)	4	4	---
Sulfur	ppm ASTM D5185(m) 500	3374	3772	---
Lithium	ppm ASTM D5185(m)	<1	<1	---






CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185(m) >20	1	2	---
Sodium	ppm ASTM D5185(m)	0	<1	---
Potassium	ppm ASTM D5185(m) >20	1	0	---
Water	% ASTM D6304* >0.2	0.002	---	---
ppm Water	ppm ASTM D6304* >2000	18	---	---

INFRA-RED

method	limit/base	current	history1	history2
Soot %	% ASTM D7844*	0	---	---
Nitration	Abs/cm ASTM D7624*	2.4	---	---
Sulfation	Abs/.1mm ASTM D7415*	12.0	---	---

OIL ANALYSIS REPORT

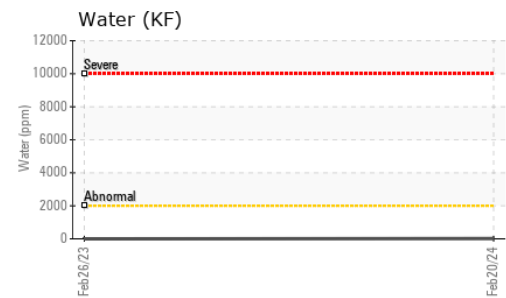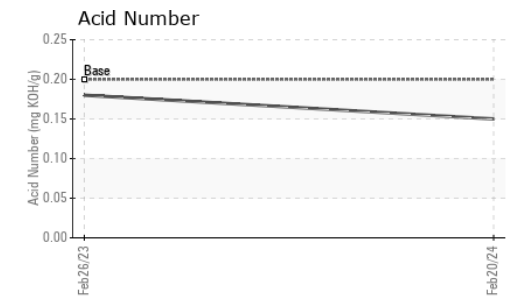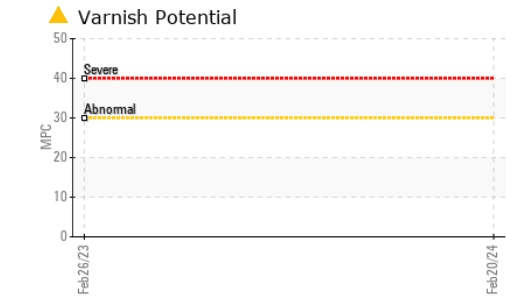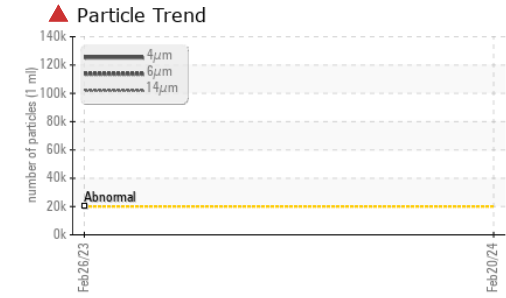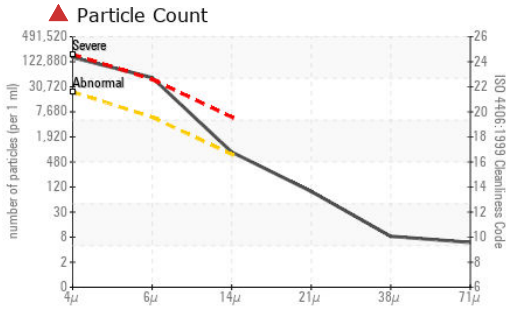

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0080294
Lab Number : 02619452
Unique Number : 5736562
Test Package : AOM 2
Received : 02 Mar 2024
Tested : 02 Mar 2024
Diagnosed : 02 Mar 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 134235	---	---
Particles >6µm	ASTM D7647	>5000	▲ 44139	---	---
Particles >14µm	ASTM D7647	>640	● 729	---	---
Particles >21µm	ASTM D7647	>160	83	---	---
Particles >38µm	ASTM D7647	>40	7	---	---
Particles >71µm	ASTM D7647	>10	5	---	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 24/23/17	---	---

FLUID DEGRADATION	method	limit/base	current	history1	history2
Oxidation	Abs./1mm	ASTM D7414*	3.0	---	---
Acid Number (AN)	mg KOH/g	ASTM D974*	0.15	0.18	---
MPC Varnish Potential	Scale	ASTM D7843(m)*	▲ 45	---	---

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	---
Yellow Metal	scalar	Visual*	NONE	NONE	---
Precipitate	scalar	Visual*	NONE	NONE	---
Silt	scalar	Visual*	NONE	NONE	---
Debris	scalar	Visual*	NONE	NONE	---
Sand/Dirt	scalar	Visual*	NONE	NONE	---
Appearance	scalar	Visual*	NORML	NORML	---
Odor	scalar	Visual*	NORML	NORML	---
Emulsified Water	scalar	Visual*	>0.2	NEG	---
Free Water	scalar	Visual*	NEG	NEG	---




FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	206.5	212	---
Visc @ 100°C	cSt	ASTM D7279(m)	18.6	18.7	---
Viscosity Index (VI)	Scale	ASTM D2270*	96	97	98

SAMPLE IMAGES	method	limit/base	current	history1	history2	
Color						no image
Bottom						no image
MPC					no image	no image

Suncor - Terra Nova Projects
 Scotia Centre, 235 Water Street
 St. John's, NL
 CA A1C 1B6
 Contact: Josh Hynes
 joshhynes@suncor.com
 T: (709)778-3575
 F: (709)724-2835

FERROGRAPHY REPORT

Area
[WO 450327061]
 Machine Id
Gearbox Fire Water Pump B (S/N Sample Tag CG-71001B)
 Component
Gearbox
 Fluid
PETRO CANADA PREMIUM R&O 220 (--- LTR)

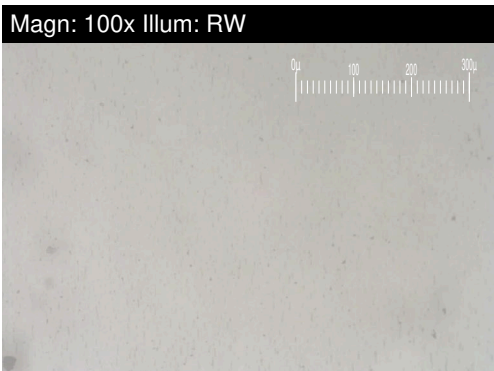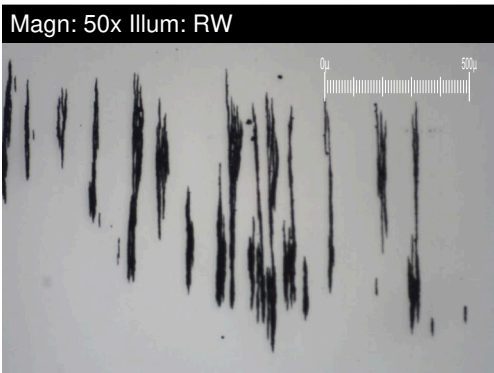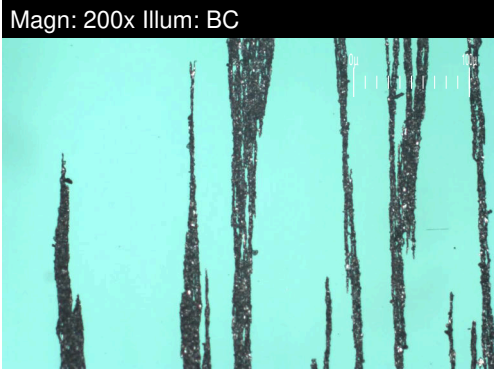


DR-FERROGRAPHY		method	limit/base	current	history1	history2
Large Particles		DR-Ferr*		52.1	---	---
Small Particles		DR-Ferr*		24.7	---	---
Total Particles		DR-Ferr*	>---	76.8	---	---
Large Particles Percentage	%	DR-Ferr*		35.7	---	---
Severity Index		DR-Ferr*		1428	---	---


FERROGRAPHY		method	limit/base	current	history1	history2
Ferrous Rubbing	Scale 0-10	ASTM D7684*		4		
Ferrous Sliding	Scale 0-10	ASTM D7684*				
Ferrous Cutting	Scale 0-10	ASTM D7684*				
Ferrous Rolling	Scale 0-10	ASTM D7684*		2		
Ferrous Break-in	Scale 0-10	ASTM D7684*				
Ferrous Spheres	Scale 0-10	ASTM D7684*				
Ferrous Black Oxides	Scale 0-10	ASTM D7684*		1		
Ferrous Red Oxides	Scale 0-10	ASTM D7684*				
Ferrous Corrosive	Scale 0-10	ASTM D7684*				
Ferrous Other	Scale 0-10	ASTM D7684*				
Nonferrous Rubbing	Scale 0-10	ASTM D7684*				
Nonferrous Sliding	Scale 0-10	ASTM D7684*				
Nonferrous Cutting	Scale 0-10	ASTM D7684*				
Nonferrous Rolling	Scale 0-10	ASTM D7684*				
Nonferrous Other	Scale 0-10	ASTM D7684*				
Carbonaceous Material	Scale 0-10	ASTM D7684*				
Lubricant Degradation	Scale 0-10	ASTM D7684*				
Sand/Dirt	Scale 0-10	ASTM D7684*		1		
Fibres	Scale 0-10	ASTM D7684*				
Spheres	Scale 0-10	ASTM D7684*				
Other	Scale 0-10	ASTM D7684*		1		

WEAR

All component wear rates are normal.
 The ferrography results are normal indicating no abnormal wear in the system.

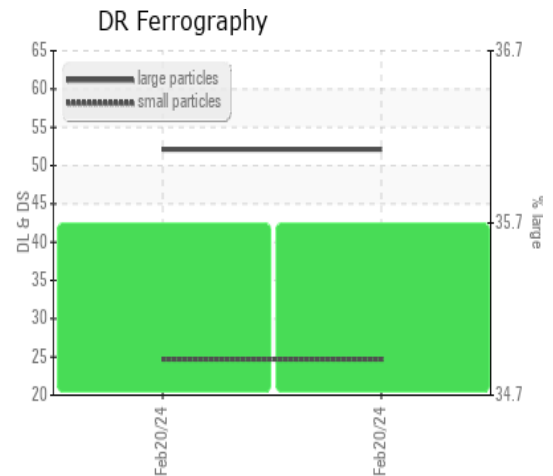

MPC (Varnish Test)

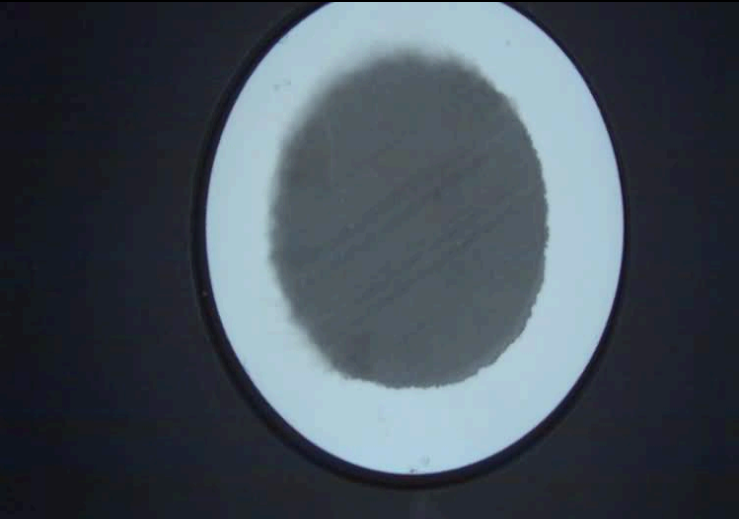

Sample Color & Clarity

