


Area  
**1460**  
Machine Id  
**1460-5666-4004 - TAILINGS THICKENER MECH HPU**  
Component  
**Planetary**  
Fluid  
**PETRO CANADA ENDURATEX EP 100 (100 LTR)**

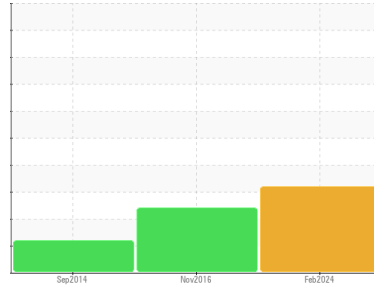

**DIAGNOSIS**

**Recommendation**

We recommend you service the filters on this component. We recommend an early resample to monitor this condition.

**Wear**

Iron ppm levels are abnormal. The low ferrous density (PQ) index indicates the wear metal levels are due to corrosion.

**Contamination**

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

**Fluid Condition**

Viscosity of sample indicates oil is within ISO 150 range, advise investigate. The AN level is acceptable for this fluid. The oil is no longer serviceable as a result of the abnormal and/or severe wear.

**SAMPLE INFORMATION**

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>PC0070689</b>	PC349142	PC353260
Sample Date	Client Info		<b>25 Feb 2024</b>	18 Nov 2016	29 Sep 2014
Machine Age	hrs	Client Info	<b>0</b>	0	0
Oil Age	hrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>ABNORMAL</b>	ABNORMAL	ABNORMAL

**CONTAMINATION**

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

**WEAR METALS**

	method	limit/base	current	history1	history2
PQ	ASTM D8184*		<b>0</b>	14	0
Iron	ppm	ASTM D5185(m) >150	<b>▲ 289</b>	102	140
Chromium	ppm	ASTM D5185(m) >10	<b>3</b>	<1	2
Nickel	ppm	ASTM D5185(m) >10	<b>2</b>	<1	<1
Titanium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Silver	ppm	ASTM D5185(m)	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m) >25	<b>&lt;1</b>	0	<1
Lead	ppm	ASTM D5185(m) >100	<b>1</b>	<1	0
Copper	ppm	ASTM D5185(m) >50	<b>13</b>	9	1
Tin	ppm	ASTM D5185(m) >10	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185(m) >5	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)	<b>0</b>	0	<1






**ADDITIVES**

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 50	<b>13</b>	16	35
Barium	ppm	ASTM D5185(m) 0	<b>&lt;1</b>	<1	5
Molybdenum	ppm	ASTM D5185(m) 0	<b>0</b>	<1	<1
Manganese	ppm	ASTM D5185(m) 0	<b>1</b>	<1	1
Magnesium	ppm	ASTM D5185(m) 0	<b>0</b>	0	<1
Calcium	ppm	ASTM D5185(m) 0	<b>13</b>	17	15
Phosphorus	ppm	ASTM D5185(m) 270	<b>310</b>	309	300
Zinc	ppm	ASTM D5185(m) 0	<b>9</b>	19	9
Sulfur	ppm	ASTM D5185(m) 4500	<b>5672</b>	5376	5972
Lithium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	<1

**CONTAMINANTS**

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >50	<b>2</b>	2	1
Sodium	ppm	ASTM D5185(m)	<b>&lt;1</b>	<1	0
Potassium	ppm	ASTM D5185(m) >20	<b>1</b>	<1	1

# OIL ANALYSIS REPORT

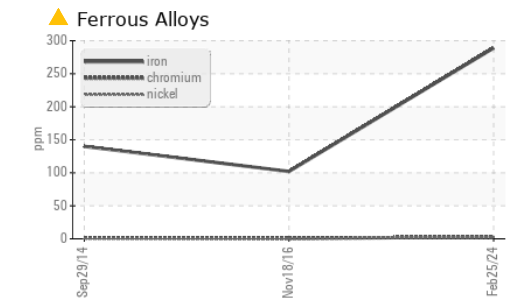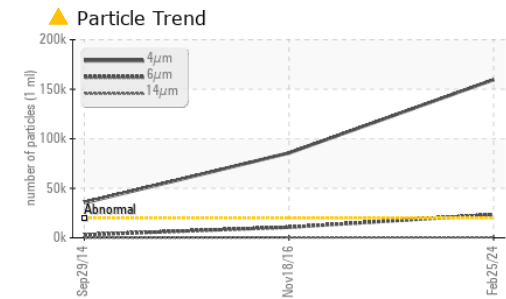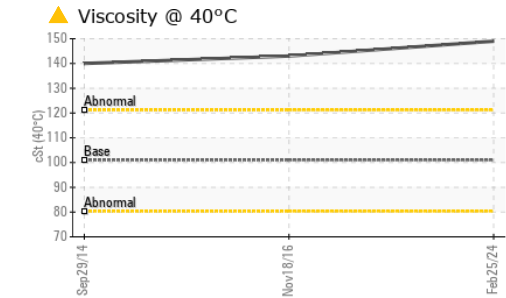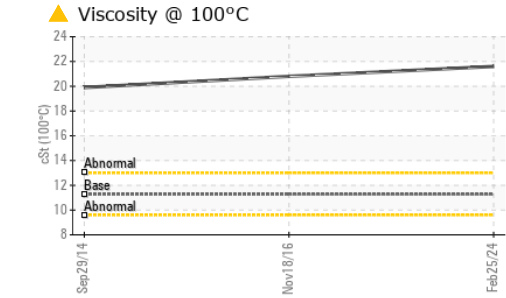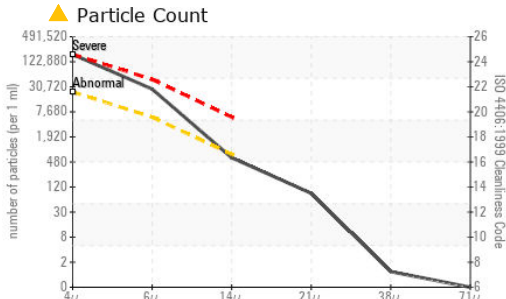

ISO 17025:2017  
Accredited  
Laboratory

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : PC0070689  
**Lab Number** : 02620940  
**Unique Number** : 5746059  
**Test Package** : IND 2 ( Additional Tests: KV100, PQ, PrtCount, TAN Man, VI )

**Received** : 08 Mar 2024  
**Tested** : 11 Mar 2024  
**Diagnosed** : 11 Mar 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.

**Vale - Voisey's Bay**  
 Voisey's Bay Mine Site, P.O. Box 7001, Str. C Happy Valley  
 Goose Bay, NL  
 CA A0P 1C0  
 Contact: Robert Feltham  
 robert.feltham@vale.com

T:  
F: x:

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	▲ 159679	▲ 85664	35369
Particles >6µm	ASTM D7647	>5000	▲ 23473	▲ 10685	3095
Particles >14µm	ASTM D7647	>640	533	397	121
Particles >21µm	ASTM D7647	>160	75	66	30
Particles >38µm	ASTM D7647	>40	1	2	1
Particles >71µm	ASTM D7647	>10	0	0	0
Oil Cleanliness	ISO 4406 (c)	>21/19/16	▲ 24/22/16	▲ 24/21/16	22/19/14


FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D974*	0.4	0.69	0.53	0.621

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	VLITE	NONE	NONE
Yellow Metal	scalar Visual*	NONE	NONE	LIGHT	VLITE
Precipitate	scalar Visual*	NONE	NONE	NONE	NONE
Silt	scalar Visual*	NONE	NONE	NONE	VLITE
Debris	scalar Visual*	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar Visual*	NONE	NONE	NONE	NONE
Appearance	scalar Visual*	NORML	NORML	NORML	NORML
Odor	scalar Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar Visual*		NEG	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt ASTM D7279(m)	101	▲ 149	▲ 143	▲ 140
Visc @ 100°C	cSt ASTM D7279(m)	11.27	▲ 21.6	▲ 20.8	▲ 19.9
Viscosity Index (VI)	Scale ASTM D2270*	97	▲ 171	▲ 169	▲ 163

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color



Bottom

