




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL



Machine Id
731052
 Component
Natural Gas Engine
 Fluid
PETRO CANADA DURON GEO LD 15W40 (--- LTR)

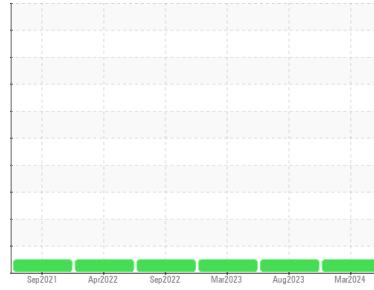

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		GFL0110224	GFL0085873	GFL0064340
Sample Date	Client Info		06 Mar 2024	23 Aug 2023	10 Mar 2023
Machine Age	hrs	Client Info	6600	5498	4462
Oil Age	hrs	Client Info	1200	1200	1200
Oil Changed	Client Info		Changed	Changed	Changed
Sample Status			NORMAL	NORMAL	NORMAL

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	NEG	NEG	NEG

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m) >50	11	10	12
Chromium	ppm	ASTM D5185(m) >4	<1	1	1
Nickel	ppm	ASTM D5185(m) >2	<1	<1	<1
Titanium	ppm	ASTM D5185(m)	0	<1	<1
Silver	ppm	ASTM D5185(m) >3	0	0	0
Aluminum	ppm	ASTM D5185(m) >9	3	2	3
Lead	ppm	ASTM D5185(m) >30	11	12	16
Copper	ppm	ASTM D5185(m) >35	2	2	3
Tin	ppm	ASTM D5185(m) >4	<1	1	1
Antimony	ppm	ASTM D5185(m)	0	0	<1
Vanadium	ppm	ASTM D5185(m)	0	0	0
Beryllium	ppm	ASTM D5185(m)	0	0	0
Cadmium	ppm	ASTM D5185(m)	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m) 50	8	8	8
Barium	ppm	ASTM D5185(m) 5	0	0	0
Molybdenum	ppm	ASTM D5185(m) 50	56	57	56
Manganese	ppm	ASTM D5185(m) 0	0	<1	<1
Magnesium	ppm	ASTM D5185(m) 560	600	617	593
Calcium	ppm	ASTM D5185(m) 1510	1604	1579	1743
Phosphorus	ppm	ASTM D5185(m) 780	727	767	777
Zinc	ppm	ASTM D5185(m) 870	934	942	958
Sulfur	ppm	ASTM D5185(m) 2040	2191	2071	2088
Lithium	ppm	ASTM D5185(m)	<1	<1	<1

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m) >+100	3	4	4
Sodium	ppm	ASTM D5185(m)	9	9	10
Potassium	ppm	ASTM D5185(m) >20	<1	<1	0

INFRA-RED


	method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*	0	0	0
Nitration	Abs/cm	ASTM D7624*	11.5	12.1	7.2
Sulfation	Abs.1mm	ASTM D7415*	25.5	26.9	19.8

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Oxidation	Abs.1mm	ASTM D7414*	20.1	20.3	12.0











OIL ANALYSIS REPORT

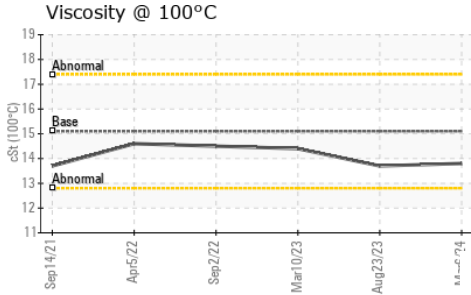

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.1	13.8	13.7

GRAPHS

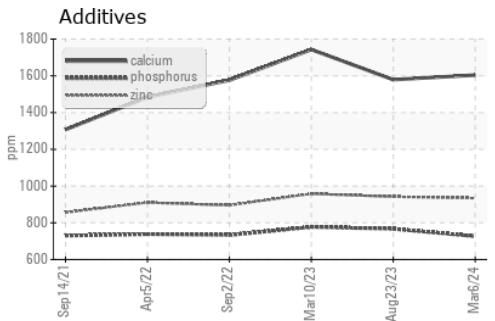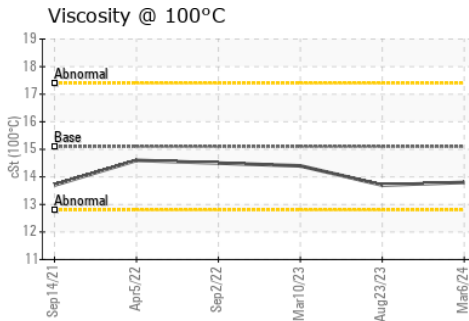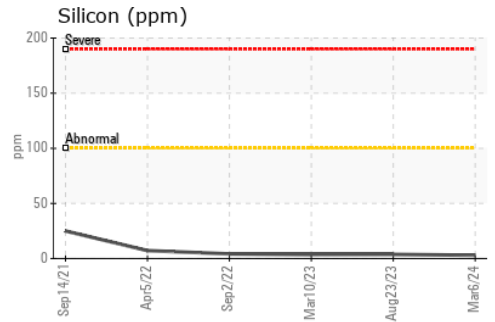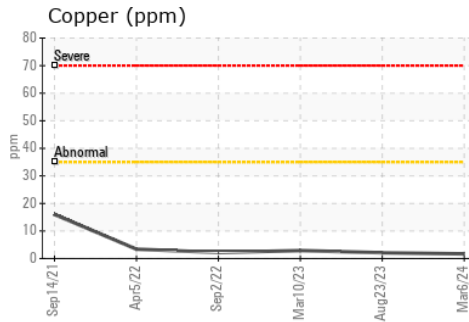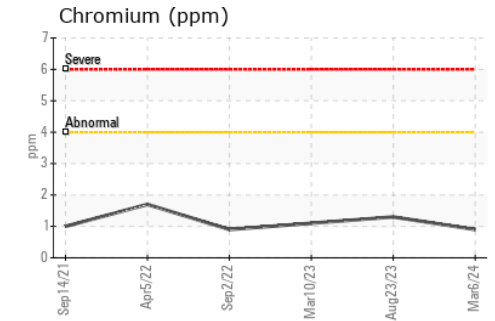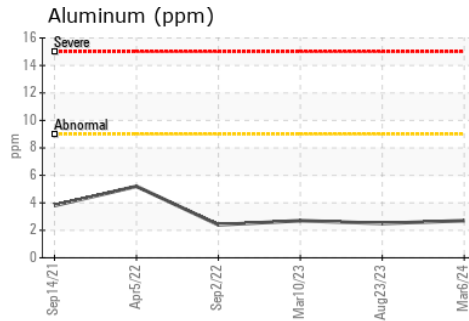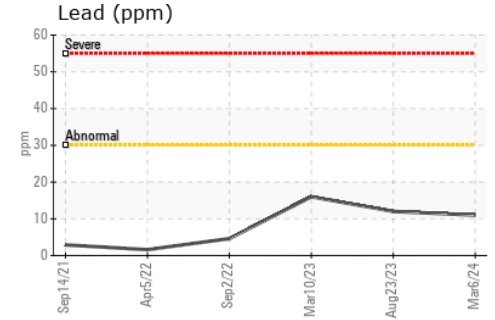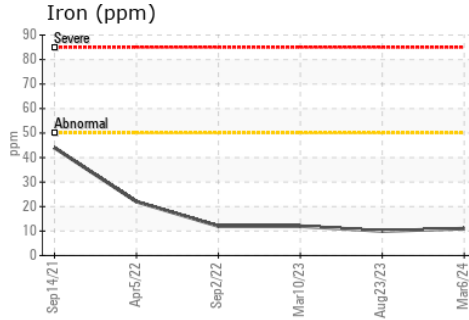

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
 Sample No. : GFL0110224
 Lab Number : 02621073
 Unique Number : 5746192
 Test Package : MOB 1

Received : 11 Mar 2024
 Tested : 11 Mar 2024
 Diagnosed : 11 Mar 2024 - Wes Davis

GFL Environmental - 209 - Hamilton
 560 Seaman Street
 Stoney Creek, ON
 CA L8E 3X7
 Contact: Fred Carleton
 fred.carleton@gflenv.com
 T: (289)925-6693
 F: (905)664-9008

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.