




OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

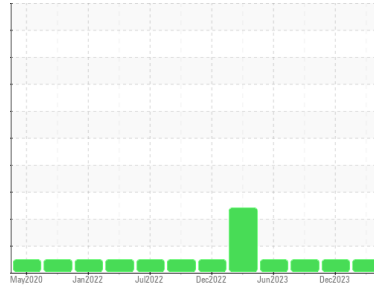

Area
[1239343]
 Machine Id
828013

Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 40 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

| | method | limit/base | current | history1 | history2 |
|---------------|-------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | | GFL0093969 | GFL0093939 | GFL0093933 |
| Sample Date | Client Info | | 08 Mar 2024 | 11 Dec 2023 | 14 Sep 2023 |
| Machine Age | hrs | Client Info | 12728 | 12160 | 11816 |
| Oil Age | hrs | Client Info | 0 | 0 | 0 |
| Oil Changed | Client Info | | N/A | N/A | N/A |
| Sample Status | | | NORMAL | NORMAL | NORMAL |

CONTAMINATION

| | method | limit/base | current | history1 | history2 |
|--------|-----------|------------|----------------|----------|----------|
| Fuel | WC Method | >5 | <1.0 | <1.0 | <1.0 |
| Water | WC Method | >0.2 | NEG | NEG | NEG |
| Glycol | WC Method | | NEG | NEG | NEG |

WEAR METALS

| | method | limit/base | current | history1 | history2 | |
|-----------|--------|---------------|---------|--------------|----------|----|
| Iron | ppm | ASTM D5185(m) | >80 | 17 | 13 | 18 |
| Chromium | ppm | ASTM D5185(m) | >5 | <1 | <1 | <1 |
| Nickel | ppm | ASTM D5185(m) | >2 | 0 | <1 | 0 |
| Titanium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) | >3 | 0 | <1 | 0 |
| Aluminum | ppm | ASTM D5185(m) | >30 | 2 | 2 | 2 |
| Lead | ppm | ASTM D5185(m) | >30 | 0 | 0 | <1 |
| Copper | ppm | ASTM D5185(m) | >150 | 2 | 1 | 2 |
| Tin | ppm | ASTM D5185(m) | >5 | 0 | 0 | 0 |
| Antimony | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | | 0 | 0 | 0 |

ADDITIVES

| | method | limit/base | current | history1 | history2 | |
|------------|--------|---------------|---------|--------------|----------|------|
| Boron | ppm | ASTM D5185(m) | 250 | 6 | 7 | 6 |
| Barium | ppm | ASTM D5185(m) | 10 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185(m) | 100 | 59 | 57 | 57 |
| Manganese | ppm | ASTM D5185(m) | | 0 | 0 | <1 |
| Magnesium | ppm | ASTM D5185(m) | 450 | 907 | 880 | 922 |
| Calcium | ppm | ASTM D5185(m) | 3000 | 1105 | 1038 | 1037 |
| Phosphorus | ppm | ASTM D5185(m) | 1150 | 928 | 917 | 999 |
| Zinc | ppm | ASTM D5185(m) | 1350 | 1151 | 1119 | 1144 |
| Sulfur | ppm | ASTM D5185(m) | 4250 | 2316 | 2374 | 2363 |
| Lithium | ppm | ASTM D5185(m) | | <1 | <1 | <1 |

CONTAMINANTS


| | method | limit/base | current | history1 | history2 | |
|-----------|--------|---------------|---------|----------|----------|---|
| Silicon | ppm | ASTM D5185(m) | >20 | 2 | 3 | 6 |
| Sodium | ppm | ASTM D5185(m) | >216 | 6 | 6 | 7 |
| Potassium | ppm | ASTM D5185(m) | >20 | 1 | <1 | 4 |

INFRA-RED

| | method | limit/base | current | history1 | history2 | |
|-----------|----------|-------------|---------|-------------|----------|------|
| Soot % | % | ASTM D7844* | >3 | 0.3 | 0.2 | 0.4 |
| Nitration | Abs/cm | ASTM D7624* | >20 | 10.1 | 8.7 | 10.2 |
| Sulfation | Abs./1mm | ASTM D7415* | >30 | 20.6 | 19.3 | 21.1 |



OIL ANALYSIS REPORT

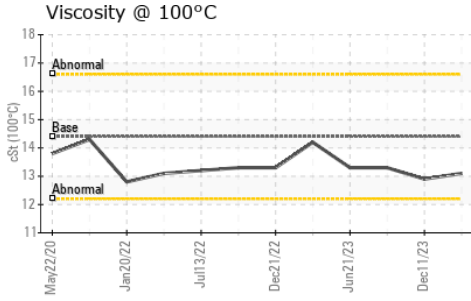

FLUID DEGRADATION

| method | limit/base | current | history1 | history2 | |
|-----------|----------------------|---------|----------|----------|------|
| Oxidation | Abs./1mm ASTM D7414* | >25 | 17.5 | 15.6 | 17.8 |









VISUAL

| method | limit/base | current | history1 | history2 | |
|------------------|----------------|------------|------------|----------|-----|
| Emulsified Water | scalar Visual* | >0.2 | NEG | NEG | NEG |
| Free Water | scalar Visual* | NEG | NEG | NEG | |

FLUID PROPERTIES

| method | limit/base | current | history1 | history2 | |
|--------------|-------------------|---------|-------------|----------|------|
| Visc @ 100°C | cSt ASTM D7279(m) | 14.4 | 13.1 | 12.9 | 13.3 |

GRAPHS

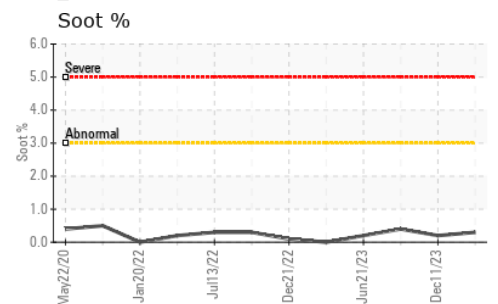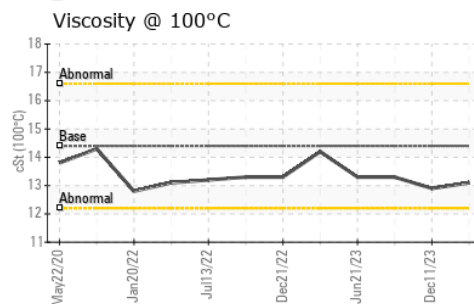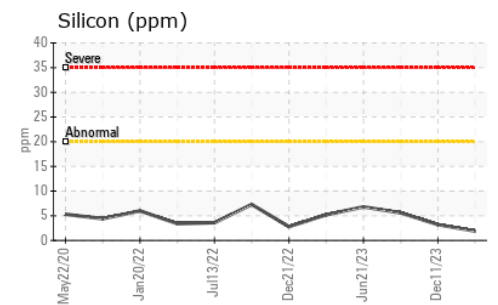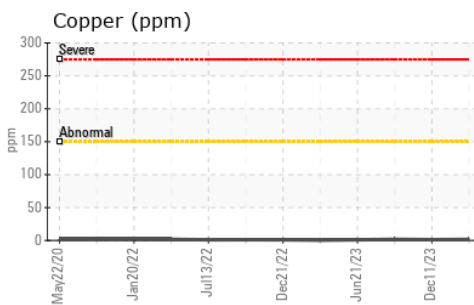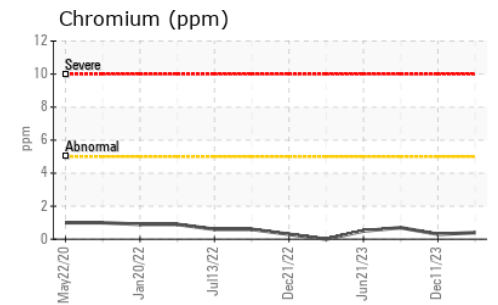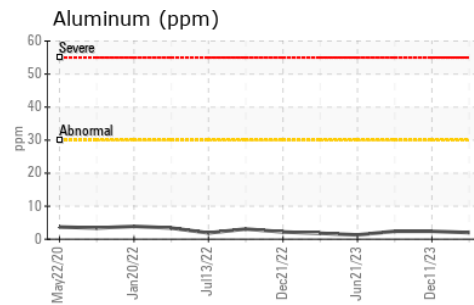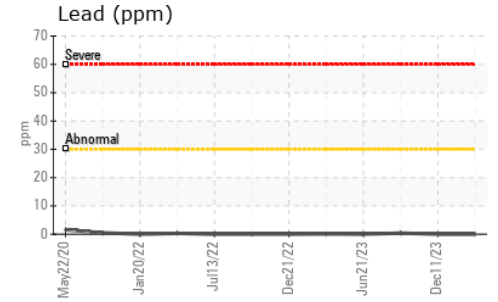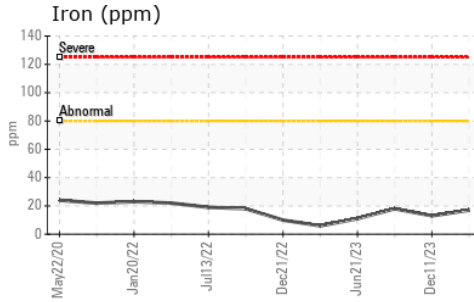

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : GFL0093969
Lab Number : 02624130
Unique Number : 5749249
Test Package : MOB 1

Received : 25 Mar 2024
Tested : 25 Mar 2024
Diagnosed : 25 Mar 2024 - Wes Davis

GFL Environmental - 777 - Belleville-Municipal waste
 197 Putman Industrial Road
 Belleville, ON
 CA K8N 4Z6
 Contact: Andrea Michael
 amichael@gflenv.com
 T: (613)962-7144
 F: (613)962-1994

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.