


Area
Fwd Machinery Space [450277189]
Machine Id
Emergency Generator - Engine Crank Case (S/N Sample Tag CD-84001-S1)
Component
Diesel Engine
Fluid
PETRO CANADA DURON MARINE SAE 40 (145 LTR)

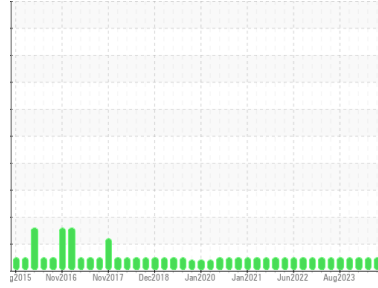

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil.

Fluid Condition
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

| | | | | |
|---------------|-------------|--------------------|-------------|-------------|
| Sample Number | Client Info | PC0076359 | PC | PC |
| Sample Date | Client Info | 10 Mar 2024 | 14 Jan 2024 | 17 Dec 2023 |
| Machine Age | hrs | 0 | 0 | 0 |
| Oil Age | hrs | 0 | 0 | 0 |
| Oil Changed | Client Info | N/A | N/A | N/A |
| Sample Status | | NORMAL | NORMAL | NORMAL |

CONTAMINATION method limit/base current history1 history2

| | | | | | |
|--------|-----------|------|----------------|------|------|
| Fuel | WC Method | >3.0 | <1.0 | <1.0 | <1.0 |
| Water | WC Method | >0.2 | NEG | NEG | NEG |
| Glycol | WC Method | | NEG | NEG | NEG |

WEAR METALS method limit/base current history1 history2

| | | | | | |
|-----------|-------------|---------------|----------|--------------|----|
| PQ | ASTM D8184* | | 0 | 0 | 0 |
| Iron | ppm | ASTM D5185(m) | >200 | 4 | 4 |
| Chromium | ppm | ASTM D5185(m) | >20 | 0 | 0 |
| Nickel | ppm | ASTM D5185(m) | >2 | 0 | <1 |
| Titanium | ppm | ASTM D5185(m) | >2 | 0 | 0 |
| Silver | ppm | ASTM D5185(m) | >2 | 0 | <1 |
| Aluminum | ppm | ASTM D5185(m) | >30 | <1 | <1 |
| Lead | ppm | ASTM D5185(m) | >30 | <1 | <1 |
| Copper | ppm | ASTM D5185(m) | >30 | 11 | 9 |
| Tin | ppm | ASTM D5185(m) | >15 | <1 | <1 |
| Antimony | ppm | ASTM D5185(m) | | 0 | 0 |
| Vanadium | ppm | ASTM D5185(m) | | 0 | 0 |
| Beryllium | ppm | ASTM D5185(m) | | 0 | 0 |
| Cadmium | ppm | ASTM D5185(m) | | 0 | 0 |

ADDITIVES method limit/base current history1 history2





| | | | | | |
|------------|-----|---------------|------|--------------|------|
| Boron | ppm | ASTM D5185(m) | 1.0 | 1 | 1 |
| Barium | ppm | ASTM D5185(m) | 1.0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185(m) | 1.0 | 1 | 2 |
| Manganese | ppm | ASTM D5185(m) | 1 | 0 | 0 |
| Magnesium | ppm | ASTM D5185(m) | 15 | 936 | 925 |
| Calcium | ppm | ASTM D5185(m) | 2540 | 1038 | 1065 |
| Phosphorus | ppm | ASTM D5185(m) | 1000 | 1073 | 1099 |
| Zinc | ppm | ASTM D5185(m) | 1110 | 1221 | 1253 |
| Sulfur | ppm | ASTM D5185(m) | 3700 | 2637 | 2883 |
| Lithium | ppm | ASTM D5185(m) | | <1 | <1 |

CONTAMINANTS method limit/base current history1 history2

| | | | | | |
|-----------|-----|---------------|-----|----------|----|
| Silicon | ppm | ASTM D5185(m) | >30 | 8 | 9 |
| Sodium | ppm | ASTM D5185(m) | | 1 | 1 |
| Potassium | ppm | ASTM D5185(m) | >20 | 0 | <1 |

INFRA-RED method limit/base current history1 history2

| | | | | | |
|-----------|----------|-------------|------|-------------|------|
| Soot % | % | ASTM D7844* | >0.8 | 0 | 0 |
| Nitration | Abs/cm | ASTM D7624* | >20 | 3.3 | 3.3 |
| Sulfation | Abs./1mm | ASTM D7415* | >30 | 12.4 | 12.6 |

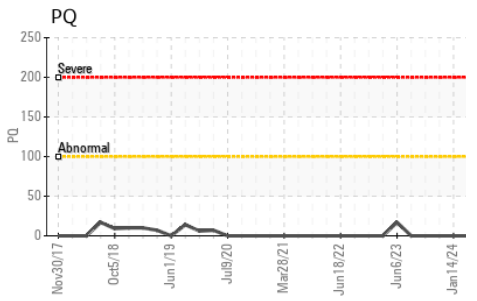
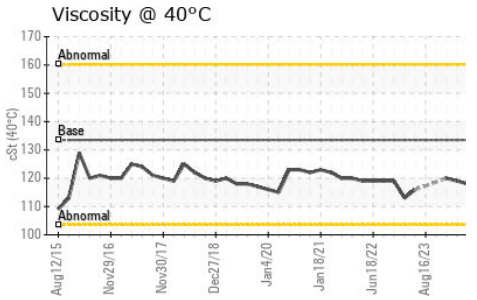
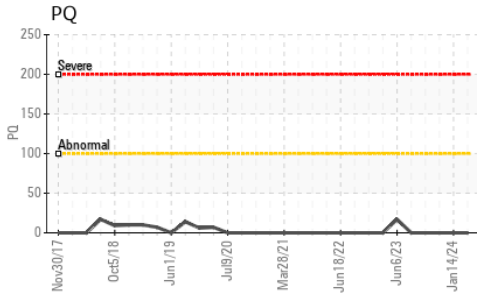
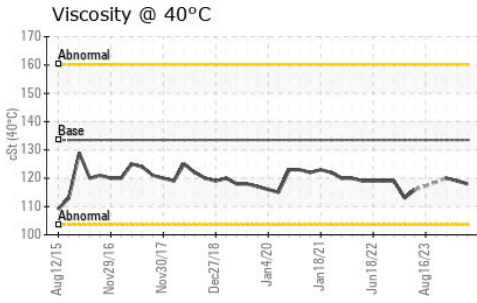


| FLUID DEGRADATION | | method | limit/base | current | history1 | history2 |
|-------------------|----------|-------------|------------|-------------|----------|----------|
| Oxidation | Abs/.1mm | ASTM D7414* | >25 | 6.1 | 6.1 | 6.2 |
| Base Number (BN) | mg KOH/g | ASTM D2896* | 7.9 | 8.86 | 8.17 | 8.31 |

| VISUAL | | method | limit/base | current | history1 | history2 |
|------------------|--------|---------|------------|------------|----------|----------|
| Emulsified Water | scalar | Visual* | >0.2 | NEG | NEG | NEG |
| Free Water | scalar | Visual* | | NEG | NEG | NEG |

| FLUID PROPERTIES | | method | limit/base | current | history1 | history2 |
|----------------------|-------|---------------|------------|-------------|----------|----------|
| Visc @ 40°C | cSt | ASTM D7279(m) | 133.5 | 118 | 119 | 120 |
| Visc @ 100°C | cSt | ASTM D7279(m) | 14.6 | 13.5 | 13.6 | 13.7 |
| Viscosity Index (VI) | Scale | ASTM D2270* | 109 | 110 | 111 | 111 |

GRAPHS

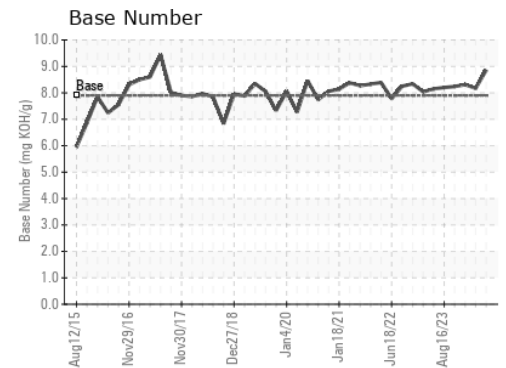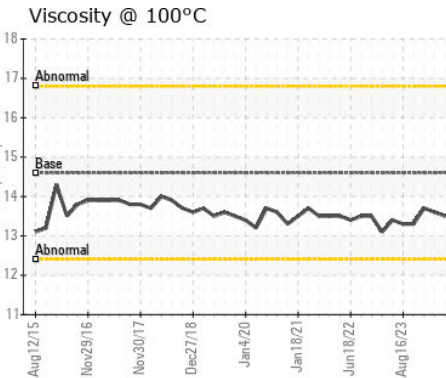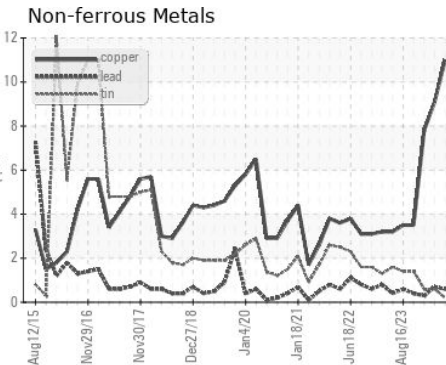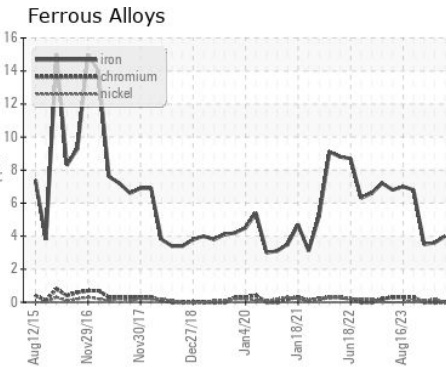

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0076359 **Received** : 01 Apr 2024
Lab Number : **02625581** **Tested** : 01 Apr 2024
Unique Number : 5750700 **Diagnosed** : 02 Apr 2024 - Kevin Marson
Test Package : MOB 2 (Additional Tests: KV40, PQ, PrtCount, VI)

Suncor - Terra Nova Projects
 Scotia Centre, 235 Water Street
 St. John's, NL
 CA A1C 1B6
 Contact: Josh Hynes
 joshhynes@suncor.com
 T: (709)778-3575
 F: (709)724-2835

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.