




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

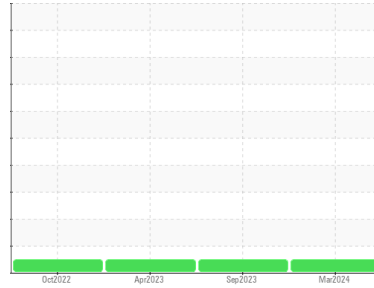

Machine Id  
**731068**  
 Component  
**Natural Gas Engine**  
 Fluid  
**PETRO CANADA DURON GEO LD 15W40 (--- LTR)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>GFL0110239</b>	GFL0085904	GFL0064321
Sample Date	Client Info		<b>28 Mar 2024</b>	01 Sep 2023	11 Apr 2023
Machine Age	hrs	Client Info	<b>6639</b>	5546	4409
Oil Age	hrs	Client Info	<b>0</b>	1200	1200
Oil Changed	Client Info		<b>Changed</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.1	<b>NEG</b>	NEG	NEG

## WEAR METALS

	method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185(m)	>50	<b>14</b>	13	17
Chromium	ppm	ASTM D5185(m)	>4	<b>1</b>	1	1
Nickel	ppm	ASTM D5185(m)	>2	<b>&lt;1</b>	<1	<1
Titanium	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185(m)	>9	<b>2</b>	2	4
Lead	ppm	ASTM D5185(m)	>30	<b>9</b>	11	2
Copper	ppm	ASTM D5185(m)	>35	<b>2</b>	1	1
Tin	ppm	ASTM D5185(m)	>4	<b>&lt;1</b>	<1	<1
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185(m)	50	<b>6</b>	9	12
Barium	ppm	ASTM D5185(m)	5	<b>0</b>	<1	0
Molybdenum	ppm	ASTM D5185(m)	50	<b>58</b>	68	66
Manganese	ppm	ASTM D5185(m)	0	<b>0</b>	<1	<1
Magnesium	ppm	ASTM D5185(m)	560	<b>627</b>	645	573
Calcium	ppm	ASTM D5185(m)	1510	<b>1725</b>	1755	1838
Phosphorus	ppm	ASTM D5185(m)	780	<b>743</b>	763	826
Zinc	ppm	ASTM D5185(m)	870	<b>970</b>	995	1017
Sulfur	ppm	ASTM D5185(m)	2040	<b>2070</b>	2163	2271
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1

## CONTAMINANTS

	method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185(m)	>+100	<b>2</b>	4	11
Sodium	ppm	ASTM D5185(m)		<b>9</b>	9	9
Potassium	ppm	ASTM D5185(m)	>20	<b>4</b>	5	0

## INFRA-RED


	method	limit/base	current	history1	history2	
Soot %	%	ASTM D7844*		<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>12.8</b>	12.0	8.4
Sulfation	Abs./1mm	ASTM D7415*	>30	<b>26.7</b>	25.2	21.5

## FLUID DEGRADATION

	method	limit/base	current	history1	history2	
Oxidation	Abs./1mm	ASTM D7414*	>25	<b>21.4</b>	20.1	12.5











# OIL ANALYSIS REPORT

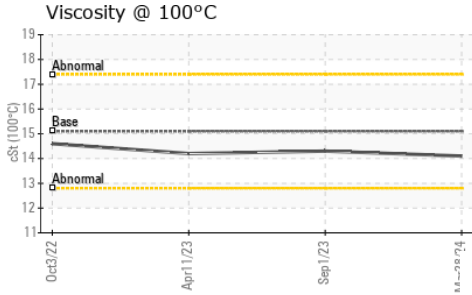

VISUAL	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.1	14.3	14.2

## GRAPHS

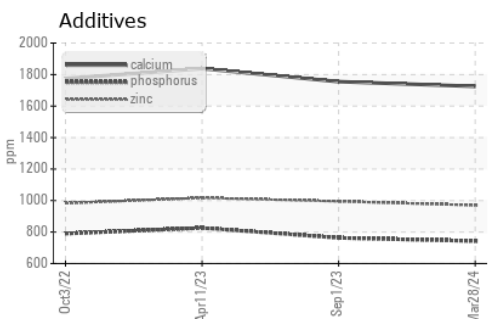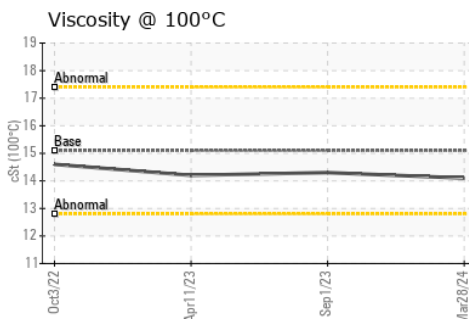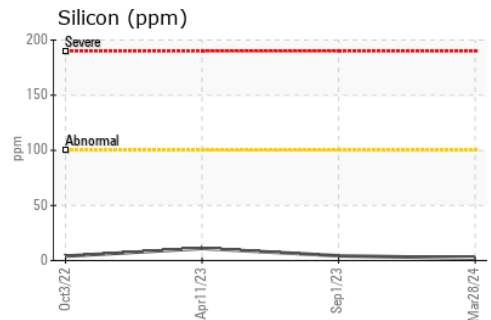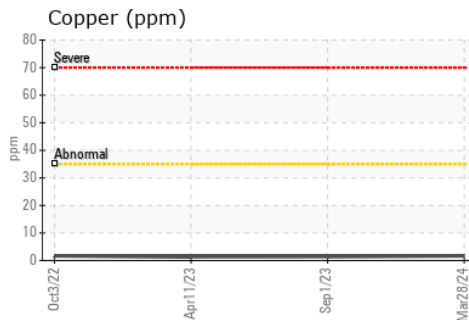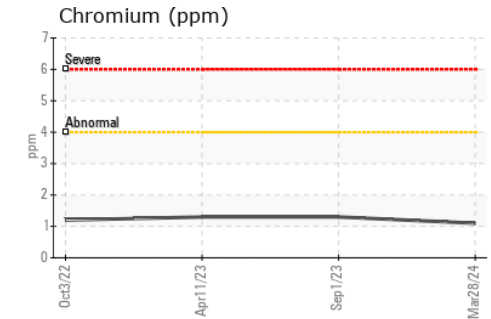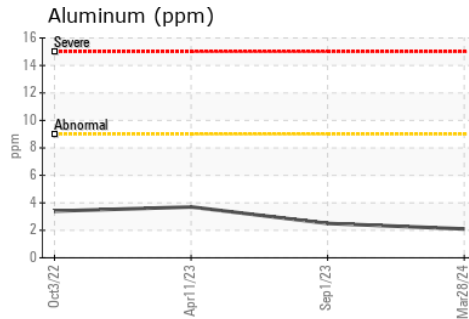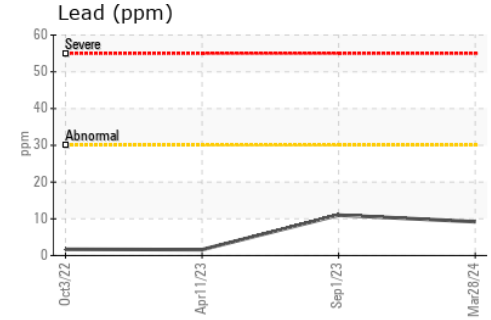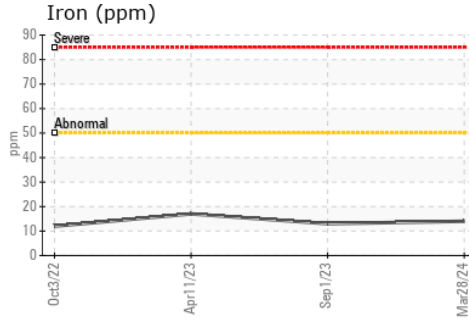

ISO 17025:2017  
Accredited  
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
 Sample No. : GFL0110239  
 Lab Number : 02625658  
 Unique Number : 5750777  
 Test Package : MOB 1

Received : 01 Apr 2024  
 Tested : 01 Apr 2024  
 Diagnosed : 01 Apr 2024 - Wes Davis

**GFL Environmental - 209 - Hamilton**  
 560 Seaman Street  
 Stoney Creek, ON  
 CA L8E 3X7  
 Contact: Fred Carleton  
 fred.carleton@gflenv.com  
 T: (289)925-6693  
 F: (905)664-9008

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.