


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL

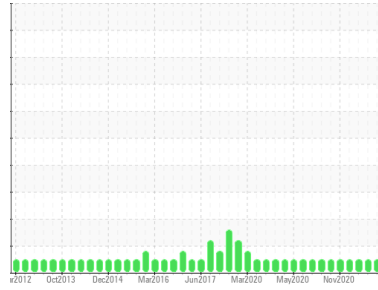

Area

Fwd Machinery Space [450341071]

Machine Id

Pump Fire Water (Port) - Engine Crank Case (S/N Sample Tag PA-71001A-S1)

Component

Diesel Engine

Fluid

PETRO CANADA DURON HP 15W40 (806 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil.

Fluid Condition

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	PC0076352	PC	PC
Sample Date	Client Info	20 Mar 2024	15 Dec 2023	08 Sep 2023
Machine Age	hrs	0	0	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	NORMAL

CONTAMINATION

method	limit/base	current	history1	history2
Fuel	WC Method >6	<1.0	<1.0	<1.0
Water	WC Method >0.2	NEG	NEG	NEG
Glycol	WC Method	NEG	NEG	NEG

WEAR METALS

method	limit/base	current	history1	history2
PQ	ASTM D8184*	0	0	0
Iron	ppm	4	3	3
Chromium	ppm	0	0	0
Nickel	ppm	0	0	0
Titanium	ppm	0	0	0
Silver	ppm	0	0	0
Aluminum	ppm	1	2	1
Lead	ppm	2	2	2
Copper	ppm	10	8	6
Tin	ppm	<1	<1	<1
Antimony	ppm	0	0	0
Vanadium	ppm	0	0	0
Beryllium	ppm	0	0	0
Cadmium	ppm	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	<1	<1	<1
Barium	ppm	<1	0	0
Molybdenum	ppm	54	54	53
Manganese	ppm	0	0	<1
Magnesium	ppm	906	901	881
Calcium	ppm	971	965	935
Phosphorus	ppm	929	965	972
Zinc	ppm	1091	1081	1069
Sulfur	ppm	2405	2629	2446
Lithium	ppm	<1	<1	<1

CONTAMINANTS


method	limit/base	current	history1	history2
Silicon	ppm	2	3	4
Sodium	ppm	1	1	2
Potassium	ppm	<1	0	0

INFRA-RED


method	limit/base	current	history1	history2
Soot %	%	0	0	0
Nitration	Abs/cm	4.9	4.7	4.3
Sulfation	Abs./1mm	17.6	17.7	17.1

OIL ANALYSIS REPORT


FT-IR (Direct Trend)

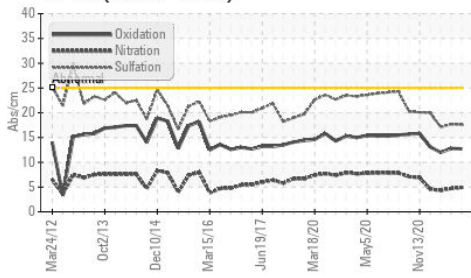


Viscosity @ 40°C

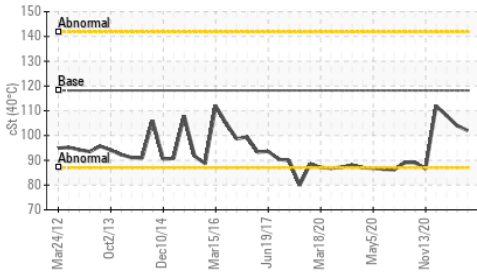


PQ

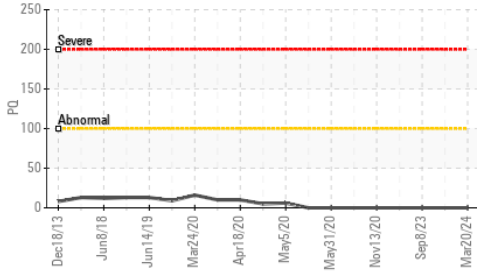

Viscosity @ 40°C

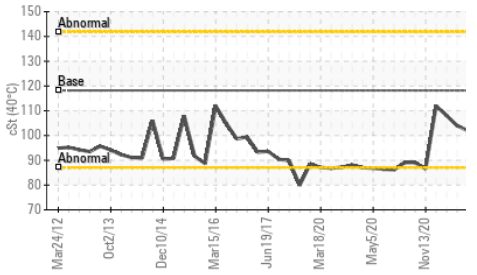

PQ

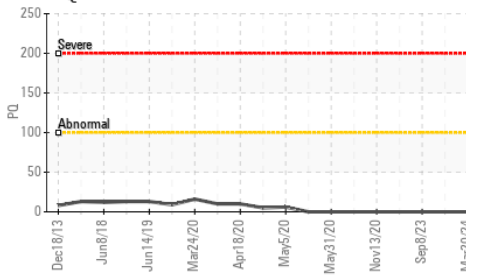


FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	12.7	12.8	12.0
Base Number (BN)	mg KOH/g	ASTM D2896*	9.8	9.30	9.18	8.77

VISUAL		method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.2	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	118.2	102	104	108
Visc @ 100°C	cSt	ASTM D7279(m)	15.6	14.0	14.3	14.5
Viscosity Index (VI)	Scale	ASTM D2270*	139	139	140	137

GRAPHS


Ferrous Alloys

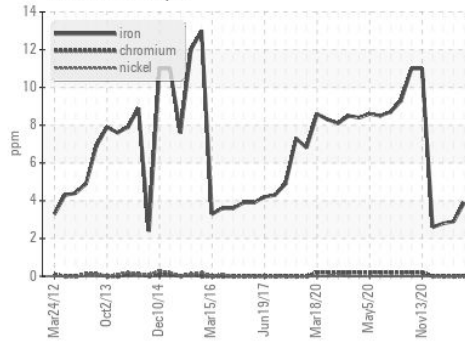


Non-ferrous Metals

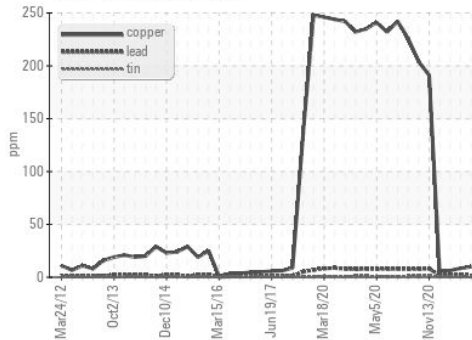

Viscosity @ 100°C

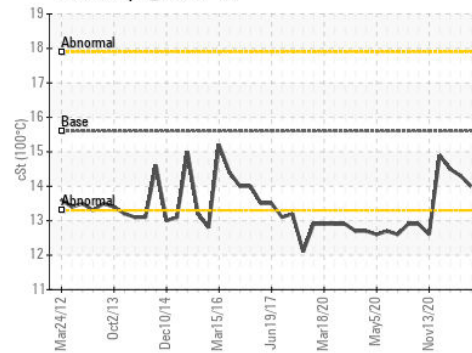

Base Number

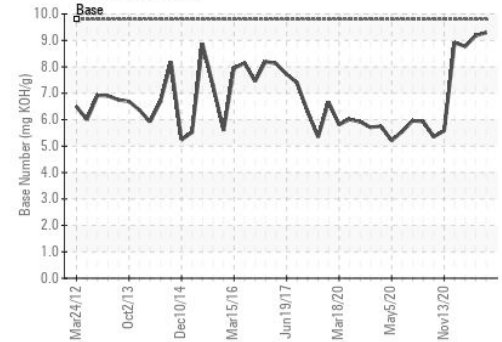

ISO 17025:2017
Accredited
Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0076352
Lab Number : **02625946**
Unique Number : 5759078
Test Package : MAR 2 (Additional Tests: KV40, PQ, PrtCount, VI)

Received : 02 Apr 2024
Tested : 04 Apr 2024
Diagnosed : 04 Apr 2024 - Kevin Marson

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Suncor - Terra Nova Projects
 Scotia Centre, 235 Water Street
 St. John's, NL
 CA A1C 1B6
 Contact: Josh Hynes
 joshhynes@suncor.com
 T: (709)778-3575
 F: (709)724-2835