


PROBLEM SUMMARY


Area
Gas Compression [450296476]
 Machine Id
Compressor (HP2) - Lubrication System (S/N Sample Tag XX-23004-S1)
 Component
Lube System
 Fluid
PETRO CANADA TURBOFLO XL32 (10350 LTR)

Sample Rating Trend

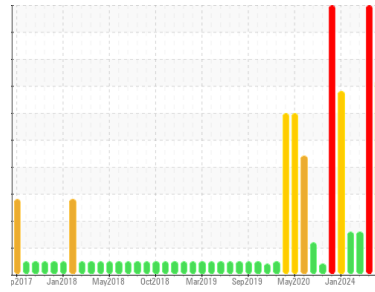

COMPONENT CONDITION SUMMARY

▲ Particle Trend

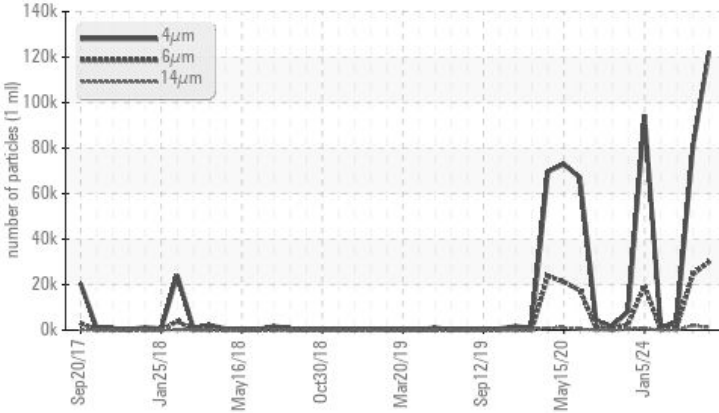

RECOMMENDATION

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MAR 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

PROBLEMATIC TEST RESULTS

Sample Status			SEVERE	SEVERE	ABNORMAL
Particles >6µm	ASTM D7647	>320	▲ 30044	▲ 24570	▲ 1147
Particles >14µm	ASTM D7647	>40	▲ 1148	▲ 1988	▲ 103
Particles >21µm	ASTM D7647	>10	▲ 278	▲ 620	▲ 24
Particles >38µm	ASTM D7647	>3	▲ 11	▲ 57	3
Oil Cleanliness	ISO 4406 (c)	>--/15/12	▲ 24/22/17	▲ 24/22/18	▲ 19/17/14

Customer Id: TERHAM
 Sample No.: PC0081649
 Lab Number: 02631164
 Test Package: MAR 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
 Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Contact Required	---	---	?	Please contact your representative for information regarding the proper sampling kits for your service.
Alert	---	---	?	NOTE: We recommend using MAR 3 test kits,
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Dirt Access	---	---	?	We advise that you check all areas where contaminants can enter the system.
Filter Fluid	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.

HISTORICAL DIAGNOSIS

ISO



01 Mar 2024 Diag: Bill Quesnel

We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. No other corrective action is recommended at this time. Diagnostician's Note: The debris on the bottom of the sample combined with the ferrous red & black oxides present in the ferrogram indicate this was an improperly taken sample (dead pipe line, or low on the bottom of the reservoir). There was a very light amount of insoluble material present. Suggest taking a resample from a suitable sampling port to validate the results before taking any serious maintenance actions. Wear particle analysis indicates that the ferrous black oxides and ferrous red oxides particles are marginal. All other component wear rates are normal. There is a high amount of particulates (2 to 100 microns in size) present in the oil. MPC (Membrane Patch Colorimetry) test indicates a light concentration of varnish present. The water content is negligible. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



ISO



08 Feb 2024 Diag: Kevin Marson

We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. We recommend an early resample to monitor this condition. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MAR 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid. Component wear rates appear to be normal (unconfirmed). There is a moderate amount of particulates (2 to 100 microns in size) present in the oil. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code. The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

view report



ISO



29 Jan 2024 Diag: Kevin Marson


We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a light amount of silt (particulates < 14 microns in size) present in the oil. The water content is negligible. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report





Area
Gas Compression [450296476]
Machine Id
Compressor (HP2) - Lubrication System (S/N Sample Tag XX-23004-S1)
Component
Lube System
Fluid
PETRO CANADA TURBOFLO XL32 (10350 LTR)

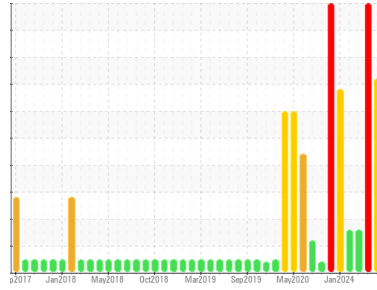

DIAGNOSIS

▲ Recommendation
We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. Please contact your representative for information regarding the proper sampling kits for your service. NOTE: We recommend using MAR 3 test kits, this testkit includes Analytical Ferrography which provides a detailed morphological analysis of wear particles present in the fluid.

Wear
Component wear rates appear to be normal (unconfirmed).

▲ Contamination
There is a high amount of particulates (2 to 100 microns in size) present in the oil. The system cleanliness code is much higher than the acceptable limit for the target ISO 4406 cleanliness code.

Fluid Condition
The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PC0081649	PC0082750	PC
Sample Date	Client Info			29 Mar 2024	01 Mar 2024	08 Feb 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				SEVERE	SEVERE	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method		>0.05	NEG	NEG	NEG






WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	<1	<1	0
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)	>10	0	<1	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>10	0	<1	<1
Lead	ppm	ASTM D5185(m)	>20	0	0	0
Copper	ppm	ASTM D5185(m)	>20	0	0	<1
Tin	ppm	ASTM D5185(m)	>10	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	0	0	0
Barium	ppm	ASTM D5185(m)	0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	0	<1	<1
Calcium	ppm	ASTM D5185(m)	0	0	<1	8
Phosphorus	ppm	ASTM D5185(m)	5	3	2	3
Zinc	ppm	ASTM D5185(m)	0	2	<1	2
Sulfur	ppm	ASTM D5185(m)	750	607	667	692
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	0	<1	0
Sodium	ppm	ASTM D5185(m)		0	0	0
Potassium	ppm	ASTM D5185(m)	>20	0	<1	<1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		122408	80490	3526
Particles >6µm		ASTM D7647	>320	▲ 30044	▲ 24570	▲ 1147
Particles >14µm		ASTM D7647	>40	▲ 1148	▲ 1988	▲ 103
Particles >21µm		ASTM D7647	>10	▲ 278	▲ 620	▲ 24
Particles >38µm		ASTM D7647	>3	▲ 11	▲ 57	3
Particles >71µm		ASTM D7647	>3	1	▲ 6	1
Oil Cleanliness		ISO 4406 (c)	>--/15/12	▲ 24/22/17	▲ 24/22/18	▲ 19/17/14

OIL ANALYSIS REPORT

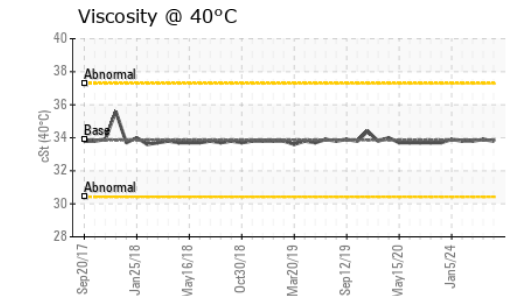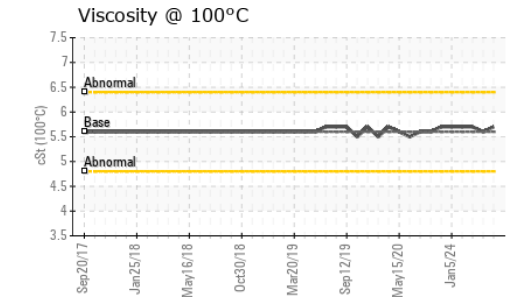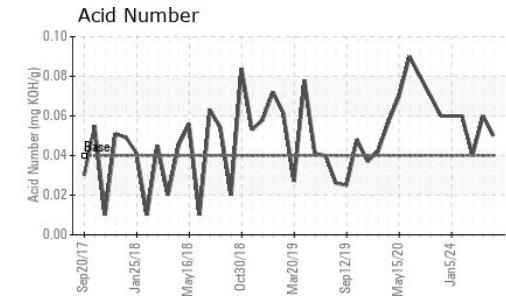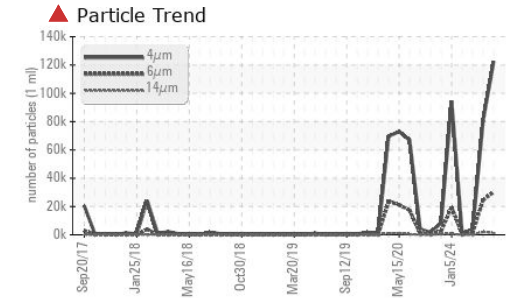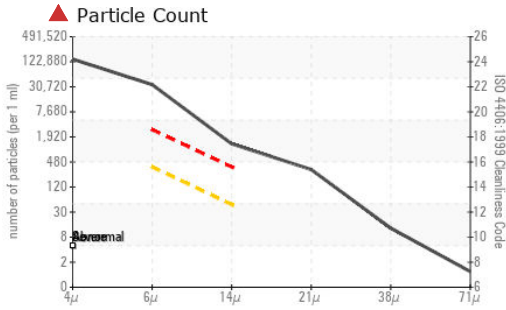

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0081649
Lab Number : **02631164**
Unique Number : 5772317
Test Package : MAR 2 (Additional Tests: KV100, TAN Man, VI)
Received : 24 Apr 2024
Tested : 25 Apr 2024
Diagnosed : 25 Apr 2024 - Kevin Marson

Suncor - Terra Nova Projects
 Scotia Centre, 235 Water Street
 St. John's, NL
 CA A1C 1B6
 Contact: Josh Hynes
 joshynes@suncor.com
 T: (709)778-3575
 F: (709)724-2835

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.04	0.05	0.06	0.04

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	LIGHT	NONE
Sand/Dirt	scalar	Visual*	NONE	VLITE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.05	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	33.86	33.8	33.9	33.8
Visc @ 100°C	cSt	ASTM D7279(m)	5.60	5.7	5.6	5.7
Viscosity Index (VI)	Scale	ASTM D2270*	101	108	102	108

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						
MPC						