

Area

Fwd Machinery Space [450296497]

Machine Id


Compressor No. 1 - Start Up Air Crank Case (S/N Sample Tag KB-63205A-S1)

Component

Air Compressor

Fluid

COMPRO 100 (4 LTR)

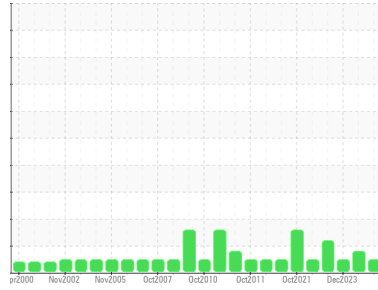

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	PC	PC	PC0076270
Sample Date	Client Info	28 Mar 2024	20 Mar 2024	05 Dec 2023
Machine Age	hrs Client Info	0	0	0
Oil Age	hrs Client Info	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	ABNORMAL	NORMAL

WEAR METALS method limit/base current history1 history2

PQ	ASTM D8184*		0	0	0
Iron	ppm ASTM D5185(m)	>50	2	2	2
Chromium	ppm ASTM D5185(m)	>4	0	0	0
Nickel	ppm ASTM D5185(m)	>4	0	0	<1
Titanium	ppm ASTM D5185(m)		0	0	0
Silver	ppm ASTM D5185(m)		0	0	0
Aluminum	ppm ASTM D5185(m)	>10	0	0	<1
Lead	ppm ASTM D5185(m)	>20	0	0	<1
Copper	ppm ASTM D5185(m)	>40	<1	<1	<1
Tin	ppm ASTM D5185(m)	>5	0	0	0
Antimony	ppm ASTM D5185(m)		0	0	0
Vanadium	ppm ASTM D5185(m)		0	0	0
Beryllium	ppm ASTM D5185(m)		0	0	0
Cadmium	ppm ASTM D5185(m)		0	0	0

ADDITIVES method limit/base current history1 history2

Boron	ppm ASTM D5185(m)	0	<1	<1	0
Barium	ppm ASTM D5185(m)	0	<1	0	<1
Molybdenum	ppm ASTM D5185(m)	0	0	0	0
Manganese	ppm ASTM D5185(m)		0	0	0
Magnesium	ppm ASTM D5185(m)	0	0	<1	0
Calcium	ppm ASTM D5185(m)	0	0	2	<1
Phosphorus	ppm ASTM D5185(m)	50	11	16	11
Zinc	ppm ASTM D5185(m)	0	<1	4	<1
Sulfur	ppm ASTM D5185(m)	1500	2584	601	2880
Lithium	ppm ASTM D5185(m)		<1	<1	<1






CONTAMINANTS method limit/base current history1 history2

Silicon	ppm ASTM D5185(m)	>25	0	0	0
Sodium	ppm ASTM D5185(m)		0	<1	0
Potassium	ppm ASTM D5185(m)	>20	<1	0	0
Water	% ASTM D6304*	>0.6	0.002	0.001	0.002
ppm Water	ppm ASTM D6304*	>6000	18	15	25

FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g ASTM D974*	0.3	0.17	0.12	0.12
------------------	---------------------	-----	-------------	------	------


OIL ANALYSIS REPORT

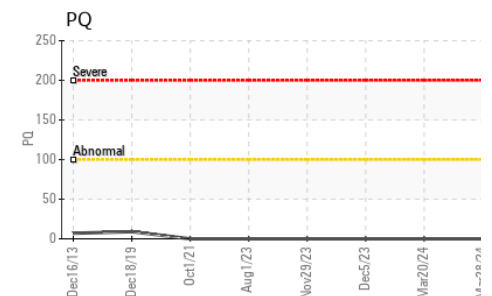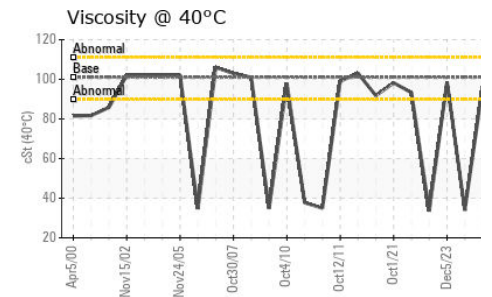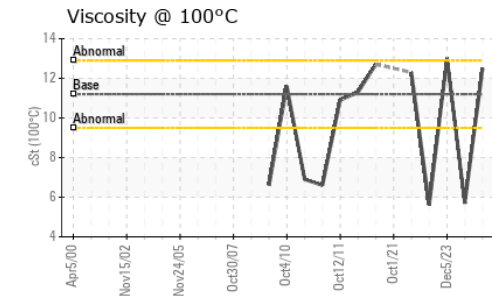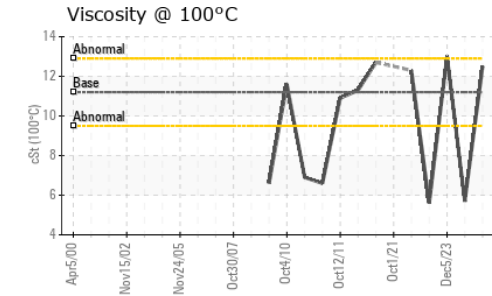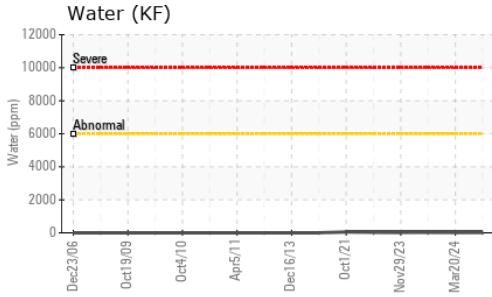






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.6	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	101.0	▲ 34.0	98.7
Visc @ 100°C	cSt	ASTM D7279(m)	11.2	▲ 5.7	13.0
Viscosity Index (VI)	Scale	ASTM D2270*	97	107	128

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

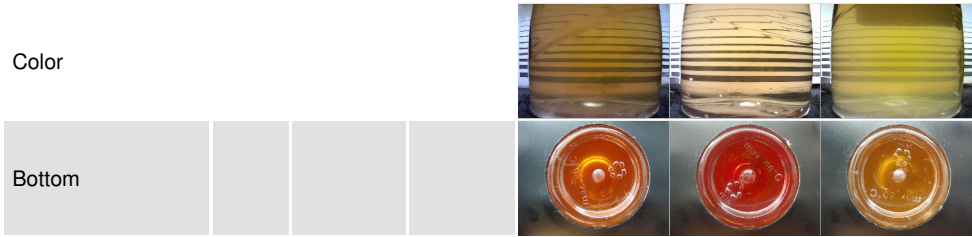

GRAPHS

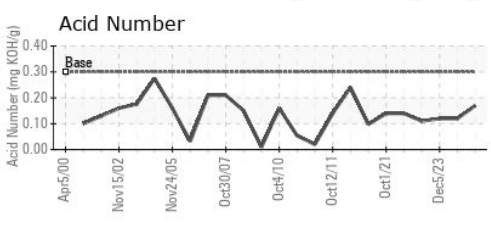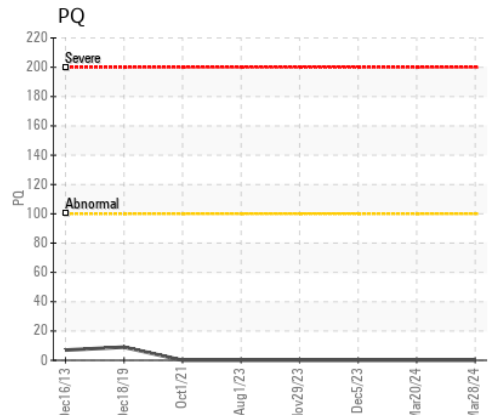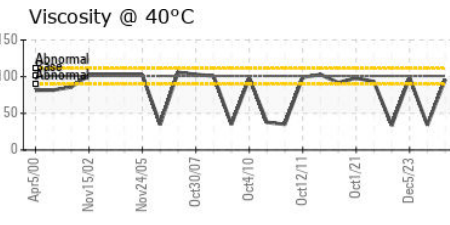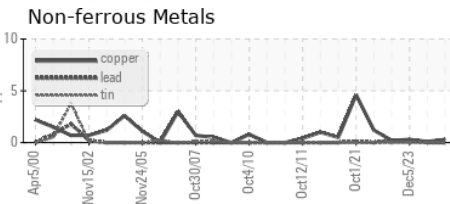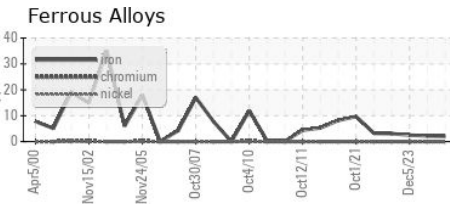

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC
Lab Number : 02631165
Unique Number : 5772318
Test Package : MAR 2 (Additional Tests: KF, KV100, TAN Man, VI)
Received : 24 Apr 2024
Tested : 24 Apr 2024
Diagnosed : 24 Apr 2024 - Kevin Marson

Suncor - Terra Nova Projects
 Scotia Centre, 235 Water Street
 St. John's, NL
 CA A1C 1B6
 Contact: Josh Hynes
 joshynes@suncor.com
 T: (709)778-3575
 F: (709)724-2835

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.