PROBLEM SUMMARY

Area
[450296514]
Machine Id
EG-80201 EQ MPG
Component
Port Turbine
Fluid
TURBINE OIL ISO 32 (--- GAL)

Sample Rating Trend

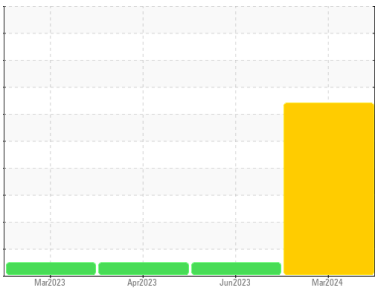

ISO

COMPONENT CONDITION SUMMARY

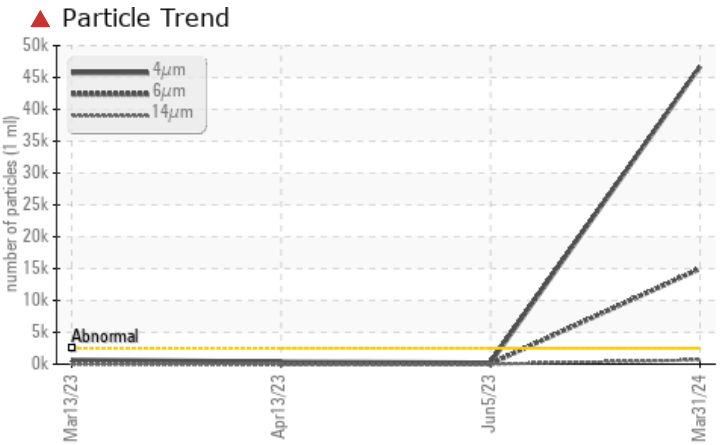

RECOMMENDATION

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

PROBLEMATIC TEST RESULTS

Sample Status				SEVERE	NORMAL	NORMAL
Particles >4µm		ASTM D7647	>2500	▲ **46712**	223	383
Particles >6µm		ASTM D7647	>640	▲ **14966**	57	76
Particles >14µm		ASTM D7647	>80	▲ **654**	6	5
Particles >21µm		ASTM D7647	>20	▲ **115**	2	2
Oil Cleanliness		ISO 4406 (c)	>18/16/13	▲ **23/21/17**	15/13/10	16/13/10

Customer Id: TERHAM
Sample No.: PC0080236
Lab Number: 02631968
Test Package: MAR 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.
Resample	---	---	?	Resample in 30-45 days to monitor this situation.
Alert	---	---	?	Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment.
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Breathers	---	---	?	The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather.
Check Dirt Access	---	---	?	We advise that you check all areas where contaminants can enter the system.
Filter Fluid	---	---	?	We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid.

HISTORICAL DIAGNOSIS

NORMAL

05 Jun 2023 Diag: Kevin Marson

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

NORMAL

13 Apr 2023 Diag: Kevin Marson

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

NORMAL

13 Mar 2023 Diag: Kevin Marson

Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. Resample at the next service interval to monitor. The fluid was not specified, however, a fluid match indicates that this fluid is (GENERIC) TURBINE OIL ISO 32. Please confirm. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.All component wear rates are normal. The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The system and fluid cleanliness is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

OIL ANALYSIS REPORT

Area
[450296514]
Machine Id
EG-80201 EQ MPG
Component
Port Turbine
Fluid
TURBINE OIL ISO 32 (--- GAL)

Sample Rating Trend

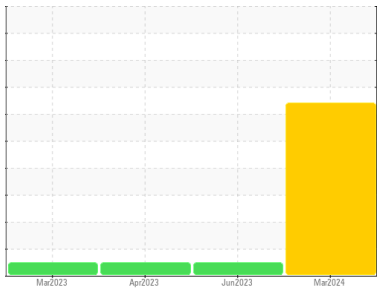

ISO

DIAGNOSIS

Recommendation
Little or no information is provided as to the component and lubricant being tested. Recommendations are therefore generic in nature and may not apply to the current application. Please forward information as to equipment type, reservoir capacity, lubricant type and any pertinent information to allow for a more accurate assessment. We advise that you check all areas where contaminants can enter the system. We advise that you perform a filter service, and use off-line filtration to improve the cleanliness of the system fluid. The air breather requires service. If unrated, we recommend that you replace with a suitable micron rated and/or desiccant air breather. If rated, we recommend that you service/replace the breather. Resample in 30-45 days to monitor this situation. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Wear
All component wear rates are normal.

Contamination
There is a high amount of particulates (2 to 100 microns in size) present in the oil. The water content is negligible.

Fluid Condition
The AN level is acceptable for this fluid. The oil is still serviceable provided that the contaminant(s) can be reduced to acceptable levels.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**PC0080236**	PC	PC
Sample Date		Client Info		**31 Mar 2024**	05 Jun 2023	13 Apr 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**SEVERE**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>15	**0**	<1	<1
Chromium	ppm	ASTM D5185(m)	>4	**0**	0	0
Nickel	ppm	ASTM D5185(m)	>2	**0**	0	0
Titanium	ppm	ASTM D5185(m)		**0**	0	0
Silver	ppm	ASTM D5185(m)		**0**	0	0
Aluminum	ppm	ASTM D5185(m)	>10	**0**	<1	<1
Lead	ppm	ASTM D5185(m)		**0**	0	0
Copper	ppm	ASTM D5185(m)	>5	**<1**	<1	<1
Tin	ppm	ASTM D5185(m)	>5	**0**	1	1
Antimony	ppm	ASTM D5185(m)		**0**	0	<1
Vanadium	ppm	ASTM D5185(m)		**0**	0	0
Beryllium	ppm	ASTM D5185(m)		**0**	0	0
Cadmium	ppm	ASTM D5185(m)		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	5	**0**	<1	<1
Barium	ppm	ASTM D5185(m)	5	**0**	0	0
Molybdenum	ppm	ASTM D5185(m)	5	**0**	0	0
Manganese	ppm	ASTM D5185(m)		**0**	0	0
Magnesium	ppm	ASTM D5185(m)	5	**<1**	<1	<1
Calcium	ppm	ASTM D5185(m)	10	**0**	<1	3
Phosphorus	ppm	ASTM D5185(m)	275	**268**	268	275
Zinc	ppm	ASTM D5185(m)	7	**1**	2	2
Sulfur	ppm	ASTM D5185(m)	400	**690**	506	505
Lithium	ppm	ASTM D5185(m)		**<1**	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	**0**	<1	<1
Sodium	ppm	ASTM D5185(m)		**0**	0	<1
Potassium	ppm	ASTM D5185(m)	>20	**<1**	0	0
Water	%	ASTM D6304*	>0.03	**0.001**	---	---
ppm Water	ppm	ASTM D6304*	>300	**7**	---	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>2500	▲ **46712**	223	383
Particles >6µm		ASTM D7647	>640	▲ **14966**	57	76
Particles >14µm		ASTM D7647	>80	▲ **654**	6	5
Particles >21µm		ASTM D7647	>20	▲ **115**	2	2
Particles >38µm		ASTM D7647	>4	● **8**	0	0
Particles >71µm		ASTM D7647	>3	**0**	0	0
Oil Cleanliness		ISO 4406 (c)	>18/16/13	▲ **23/21/17**	15/13/10	16/13/10

OIL ANALYSIS REPORT

Particle Count

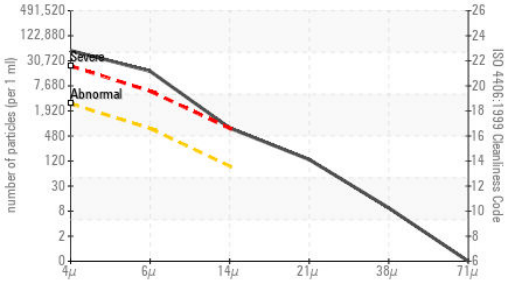

Particle Trend

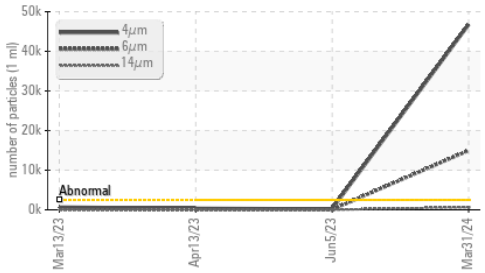

Acid Number

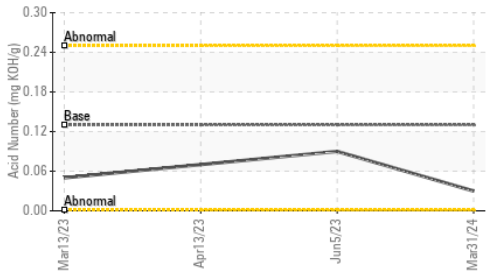

Water (KF)

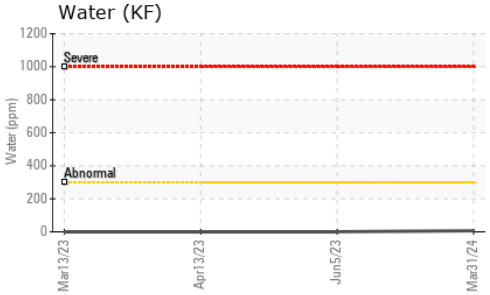

Viscosity @ 100°C

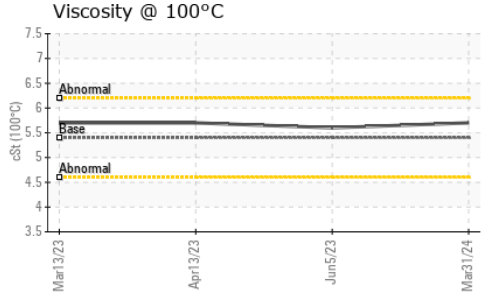

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.13	**0.03**	0.09	0.07

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	**NONE**	NONE	NONE
Precipitate	scalar	Visual*	NONE	**NONE**	NONE	NONE
Silt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Debris	scalar	Visual*	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	**NONE**	NONE	NONE
Appearance	scalar	Visual*	NORML	**NORML**	NORML	NORML
Odor	scalar	Visual*	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	Visual*	>0.03	**NEG**	NEG	NEG
Free Water	scalar	Visual*		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	32	**33.6**	33.6	33.6
Visc @ 100°C	cSt	ASTM D7279(m)	5.4	**5.7**	5.6	5.7
Viscosity Index (VI)	Scale	ASTM D2270*	102	**109**	103	109

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

ISO 17025:2017 Accredited Laboratory

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC0080236 **Received** : 29 Apr 2024
Lab Number : 02631968 **Tested** : 01 May 2024
Unique Number : 5773121 **Diagnosed** : 01 May 2024 - Kevin Marson
Test Package : MAR 2 (Additional Tests: KF, KV100, PrtCount, TAN Man, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
Validity of results and interpretation are based on the sample and information as supplied.

Suncor - Terra Nova Projects
Scotia Centre, 235 Water Strret
St. John`s, NL
CA A1C 1B6
Contact: Josh Hynes
joshynes@suncor.com
T: (709)778-3575
F: (709)724-2835