




# OIL ANALYSIS REPORT

Sample Rating Trend

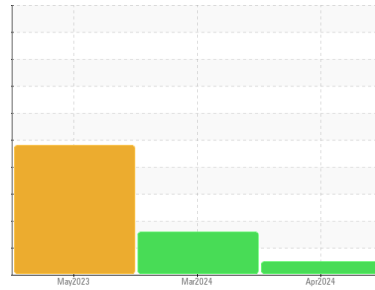

**NORMAL**



Machine Id  
**931008**  
 Component  
**Natural Gas Engine**  
 Fluid  
**RDL-3647 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>GFL0112704</b>	GFL0112686	GFL0079537
Sample Date	Client Info			<b>24 Apr 2024</b>	27 Mar 2024	02 May 2023
Machine Age	hrs	Client Info		<b>3137</b>	2954	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>Not Changed</b>	Changed	N/A
Sample Status				<b>NORMAL</b>	ABNORMAL	ABNORMAL

CONTAMINATION		method	limit/base	current	history1	history2
Water	WC Method	>0.1		<b>NEG</b>	NEG	NEG
Glycol	WC Method			<b>---</b>	0.0	0.0

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>50	<b>8</b>	20	▲ 86
Chromium	ppm	ASTM D5185(m)	>5	<b>0</b>	<1	2
Nickel	ppm	ASTM D5185(m)	>4	<b>&lt;1</b>	<1	2
Titanium	ppm	ASTM D5185(m)	>5	<b>0</b>	<1	15
Silver	ppm	ASTM D5185(m)	>3	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185(m)	>25	<b>2</b>	4	● 6
Lead	ppm	ASTM D5185(m)	>40	<b>0</b>	5	3
Copper	ppm	ASTM D5185(m)	>150	<b>&lt;1</b>	2	14
Tin	ppm	ASTM D5185(m)	>4	<b>0</b>	<1	2
Antimony	ppm	ASTM D5185(m)		<b>0</b>	0	0
Vanadium	ppm	ASTM D5185(m)		<b>0</b>	0	<1
Beryllium	ppm	ASTM D5185(m)		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185(m)		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	50	<b>30</b>	6	7
Barium	ppm	ASTM D5185(m)	5	<b>0</b>	<1	2
Molybdenum	ppm	ASTM D5185(m)	50	<b>48</b>	54	54
Manganese	ppm	ASTM D5185(m)	0	<b>&lt;1</b>	<1	8
Magnesium	ppm	ASTM D5185(m)	560	<b>547</b>	584	535
Calcium	ppm	ASTM D5185(m)	1510	<b>1582</b>	1671	1466
Phosphorus	ppm	ASTM D5185(m)	780	<b>698</b>	728	723
Zinc	ppm	ASTM D5185(m)	870	<b>840</b>	939	885
Sulfur	ppm	ASTM D5185(m)	2040	<b>1965</b>	1951	1951
Lithium	ppm	ASTM D5185(m)		<b>&lt;1</b>	<1	<1



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	<b>3</b>	4	▲ 25
Sodium	ppm	ASTM D5185(m)		<b>5</b>	9	7
Potassium	ppm	ASTM D5185(m)	>20	<b>3</b>	9	10

INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*		<b>0</b>	0	0
Nitration	Abs/cm	ASTM D7624*	>20	<b>8.4</b>	13.1	11.6
Sulfation	Abs/.1mm	ASTM D7415*	>30	<b>19.2</b>	25.8	25.2

FLUID DEGRADATION		method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	<b>15.8</b>	21.7	19.4











# OIL ANALYSIS REPORT

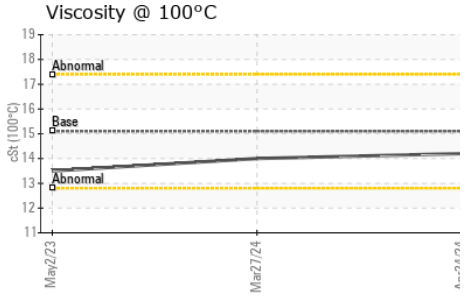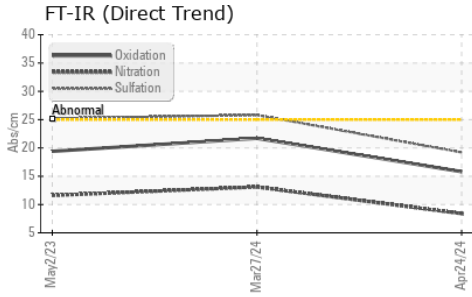

PARAMETER	method	limit/base	current	history1	history2
Emulsified Water	scalar	Visual*	>0.1	NEG	▲ .2%
Free Water	scalar	Visual*		NEG	NEG

PARAMETER	method	limit/base	current	history1	history2
Visc @ 100°C	cSt	ASTM D7279(m)	15.1	14.2	14.0

## GRAPHS

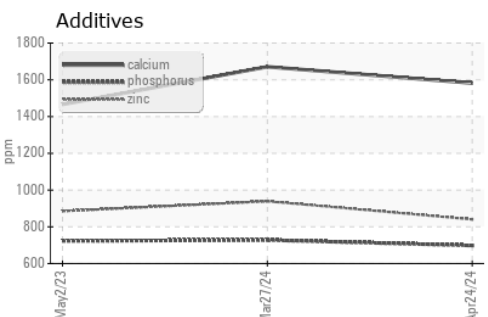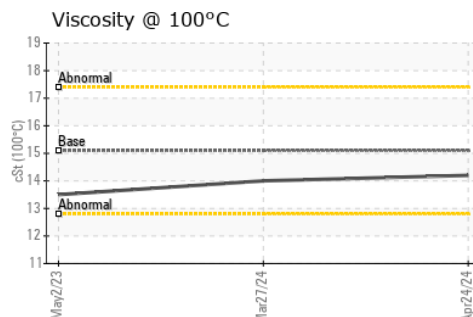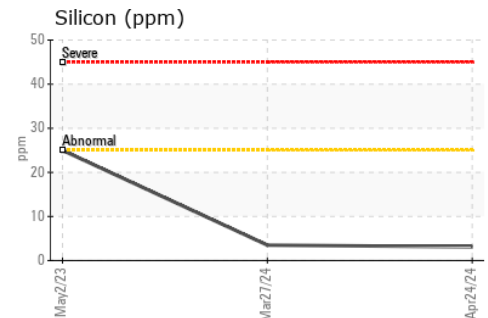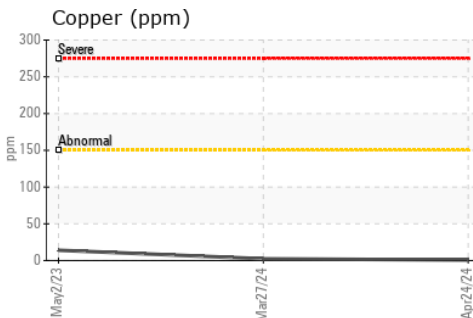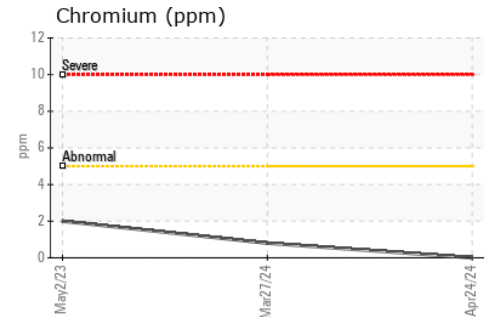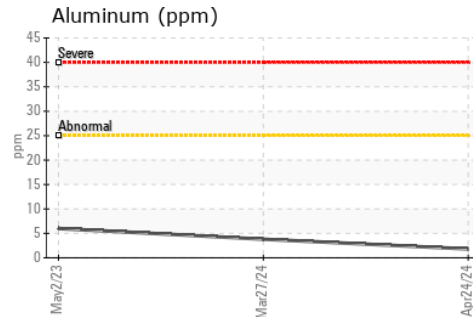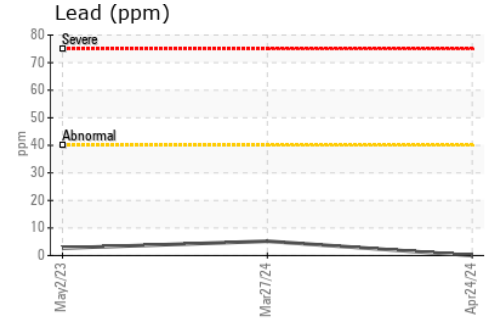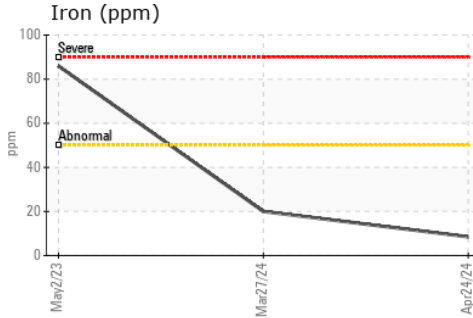

**Laboratory** : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9  
**Sample No.** : GFL0112704  
**Lab Number** : 02633991  
**Unique Number** : 5775144  
**Test Package** : MOB 1

**GFL Environmental - 253 - TOR APT**  
 15 Bermondsey Road - Building B  
 Toronto, ON  
 CA M4B 1Y9  
 Contact: Natalia Stalynska  
 nstalynska@gflenv.com

To discuss this sample report, contact Customer Service at 1-800-268-2131.  
 Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab.  
 Validity of results and interpretation are based on the sample and information as supplied.