


# **OIL ANALYSIS REPORT**





Machine Id 833062 Natural Gas Engine PETRO CANADA DURON

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the


### **Fluid Condition**


The condition of the oil is acceptable for the time in service.

I GEO LD 15W40 (	(24 LTR)		Apr2024	May2024		
SAMPLE INFOF	RMATION	method	limit/base	current	history1	history2
Sample Number		Client Info		GFL0118913	GFL0094404	
Sample Date		Client Info		07 May 2024	17 Apr 2024	
Machine Age	hrs	Client Info		1200	1200	
Oil Age	hrs	Client Info		0	1200	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	NORMAL	
CONTAMINA	ΓΙΟΝ	method	limit/base	current	history1	history2
Water		WC Method	>0.1	NEG	NEG	
WEAR METAI	_S	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>50	7	41	
Chromium	ppm	ASTM D5185(m)	>4	0	<1	
Nickel	ppm	ASTM D5185(m)	>2	0	<1	
Titanium	ppm	ASTM D5185(m)		0	0	
Silver	ppm	ASTM D5185(m)	>3	0	0	
Aluminum	ppm	ASTM D5185(m)	>9	1	4	
Lead	ppm	ASTM D5185(m)	>30	0	2	
Copper	ppm	ASTM D5185(m)	>35	2	13	
Tin	ppm	ASTM D5185(m)	>4	0	1	
Antimony	ppm	ASTM D5185(m)		0	0	
Vanadium	ppm	ASTM D5185(m)		0	0	
Beryllium	ppm	ASTM D5185(m)		0	0	
Cadmium	ppm	ASTM D5185(m)		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	50	34	10	
Barium	ppm	ASTM D5185(m)	5	<1	2	
Molybdenum	ppm	ASTM D5185(m)	50	53	92	
Manganese	ppm	ASTM D5185(m)		1	9	
Magnesium	ppm	ASTM D5185(m)	560	578	681	
Calcium	ppm	ASTM D5185(m)	1510	1481	1455	
Phosphorus	ppm	ASTM D5185(m)	780	745	715	
Zinc	ppm	ASTM D5185(m)	870	886	873	
Sulfur	ppm	ASTM D5185(m)	2040	2051	2091	
Lithium	ppm	ASTM D5185(m)		<1	<1	
CONTAMINA	NTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>+100	3	19	
Sodium	ppm	ASTM D5185(m)		2	4	
Potassium	ppm	ASTM D5185(m)	>20	0	2	
INFRA-RED		method	limit/base	current	history1	history2
Soot %	%	ASTM D7844*		0	0	
Nitration	Abs/cm	ASTM D7624*	>20	7.1	11.4	
Sulfation	Abs/.1mm	ASTM D7415*	>30	19.6	24.5	
FLUID DEGRA	NOITAD.	method	limit/base	current	history1	history2
Oxidation	Abs/.1mm	ASTM D7414*	>25	15.6	19.8	



# **OIL ANALYSIS REPORT**

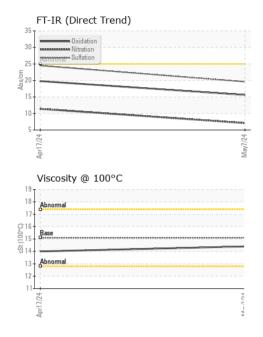

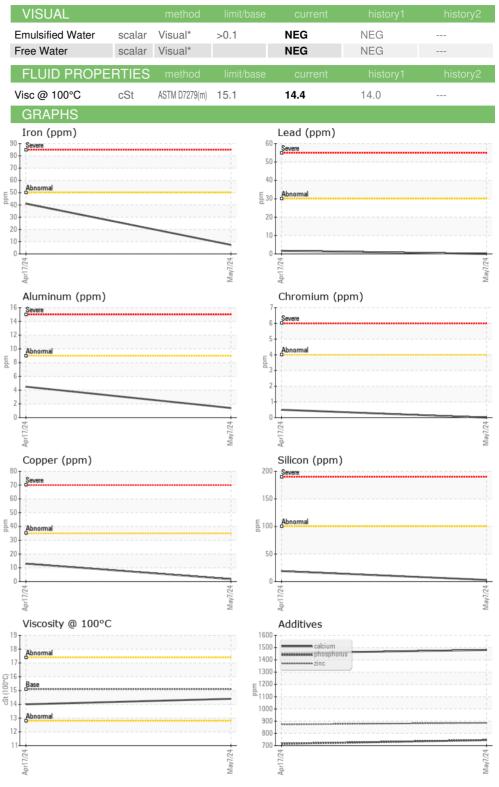



CALA ISO 17025:2017 Accredited Laboratory

Laboratory Sample No. Lab Number : 02634045

: WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 : GFL0118913

Unique Number : 5775198 Test Package : MOB 1

Received : 08 May 2024 **Tested** Diagnosed

: 08 May 2024

: 08 May 2024 - Wes Davis

GFL Environmental - 222 - Sandhill SANDHILL DISPOSAL & RECYCLING DIVIS, 19 COMMERCE ROAD ORANGEVILLE, ON CA L9W 3X5 Contact: GLENN COOK gcook@gflenv.com

T: (519)940-4167

To discuss this sample report, contact Customer Service at 1-800-268-2131. Test denoted (\*) outside scope of accreditation, (m) method modified, (e) tested at external lab. Validity of results and interpretation are based on the sample and information as supplied.