

NORMAL



Area
Aft Machinery Space
Machine ID
Compressor Service Air (B) - Crank Case (S/N Sample Tag KA-63201B-S1)
Component
Centrifugal Compressor
Fluid
PETRO CANADA TURBOFLO XL32 (189 LTR)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The system cleanliness is acceptable for your target ISO 4406 cleanliness code. The water content is negligible. The system and fluid cleanliness is acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			PC	PC	PC0080545
Sample Date	Client Info			14 Apr 2024	24 Feb 2024	23 Jan 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
PQ		ASTM D8184*		0	0	0
Iron	ppm	ASTM D5185(m)	>50	<1	<1	<1
Chromium	ppm	ASTM D5185(m)	>10	0	0	0
Nickel	ppm	ASTM D5185(m)		0	0	0
Titanium	ppm	ASTM D5185(m)		0	0	0
Silver	ppm	ASTM D5185(m)		0	0	0
Aluminum	ppm	ASTM D5185(m)	>25	0	<1	<1
Lead	ppm	ASTM D5185(m)	>25	0	0	0
Copper	ppm	ASTM D5185(m)	>50	<1	<1	<1
Tin	ppm	ASTM D5185(m)	>15	0	0	0
Antimony	ppm	ASTM D5185(m)		0	0	0
Vanadium	ppm	ASTM D5185(m)		0	0	0
Beryllium	ppm	ASTM D5185(m)		0	0	0
Cadmium	ppm	ASTM D5185(m)		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)	0	0	0	0
Barium	ppm	ASTM D5185(m)	0	0	0	0
Molybdenum	ppm	ASTM D5185(m)	0	0	0	0
Manganese	ppm	ASTM D5185(m)	0	0	0	0
Magnesium	ppm	ASTM D5185(m)	0	<1	0	<1
Calcium	ppm	ASTM D5185(m)	0	0	<1	<1
Phosphorus	ppm	ASTM D5185(m)	5	31	35	33
Zinc	ppm	ASTM D5185(m)	0	1	2	1
Sulfur	ppm	ASTM D5185(m)	750	648	688	678
Lithium	ppm	ASTM D5185(m)		<1	<1	<1

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>25	0	<1	<1
Sodium	ppm	ASTM D5185(m)		<1	<1	0
Potassium	ppm	ASTM D5185(m)	>20	<1	<1	<1
Water	%	ASTM D6304*	>0.1	0.003	0.001	0.001
ppm Water	ppm	ASTM D6304*	>1000	26	14	7

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	130	968	155
Particles >6µm		ASTM D7647	>2500	38	236	62
Particles >14µm		ASTM D7647	>320	4	19	8
Particles >21µm		ASTM D7647	>80	1	6	3
Particles >38µm		ASTM D7647	>20	0	1	0
Particles >71µm		ASTM D7647	>4	0	1	0

Oil Cleanliness	ISO 4406 (c)	>20/18/15	14/12/9	17/15/11	14/13/10
-----------------	--------------	-----------	----------------	----------	----------

OIL ANALYSIS REPORT

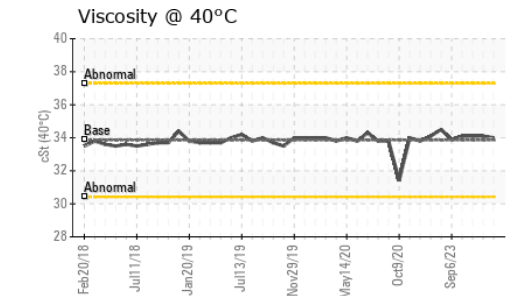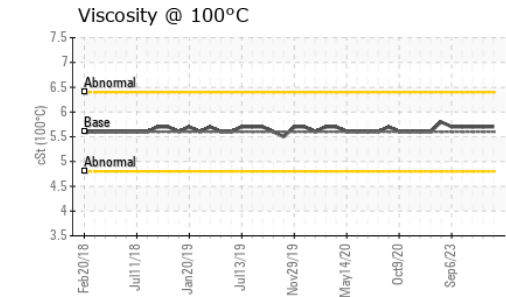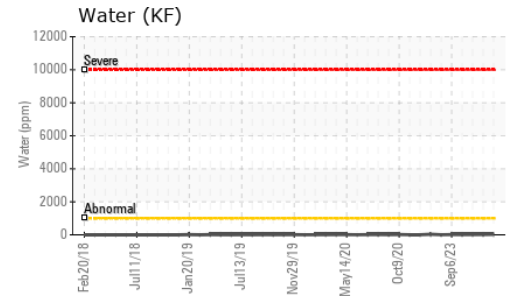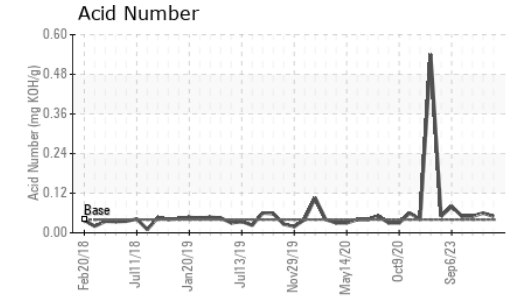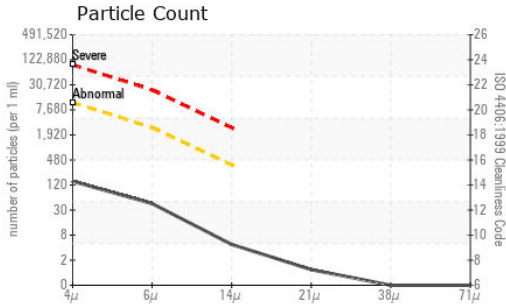

Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9
Sample No. : PC
Lab Number : 02634609
Unique Number : 5775762
Test Package : MAR 2 (Additional Tests: KF, KV100, PQ, PrtCount, TAN Man, VI)

Received : 10 May 2024
Tested : 13 May 2024
Diagnosed : 13 May 2024 - Kevin Marson

Suncor - Terra Nova Projects
 Scotia Centre, 235 Water Street
 St. John's, NL
 CA A1C 1B6
 Contact: Josh Hynes
 joshynes@suncor.com
 T: (709)778-3575
 F: (709)724-2835

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974*	0.04	0.05	0.06	0.05

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Yellow Metal	scalar	Visual*	NONE	NONE	NONE	NONE
Precipitate	scalar	Visual*	NONE	NONE	NONE	NONE
Silt	scalar	Visual*	NONE	NONE	NONE	NONE
Debris	scalar	Visual*	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	Visual*	NONE	NONE	NONE	NONE
Appearance	scalar	Visual*	NORML	NORML	NORML	NORML
Odor	scalar	Visual*	NORML	NORML	NORML	NORML
Emulsified Water	scalar	Visual*	>0.1	NEG	NEG	NEG
Free Water	scalar	Visual*		NEG	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D7279(m)	33.86	34.0	34.1	34.1
Visc @ 100°C	cSt	ASTM D7279(m)	5.60	5.7	5.7	5.7
Viscosity Index (VI)	Scale	ASTM D2270*	101	107	106	106

SAMPLE IMAGES		method	limit/base	current	history1	history2
Color						
Bottom						