


PROBLEM SUMMARY

Sample Rating Trend



DEGRADATION

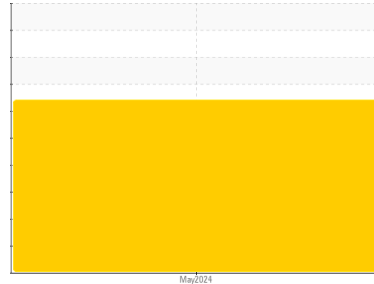


Machine Id
SKIMM P-12

Component
Hydraulic System

Fluid
PETRO CANADA TURBOFLO R&O 46 (--- GAL)

COMPONENT CONDITION SUMMARY

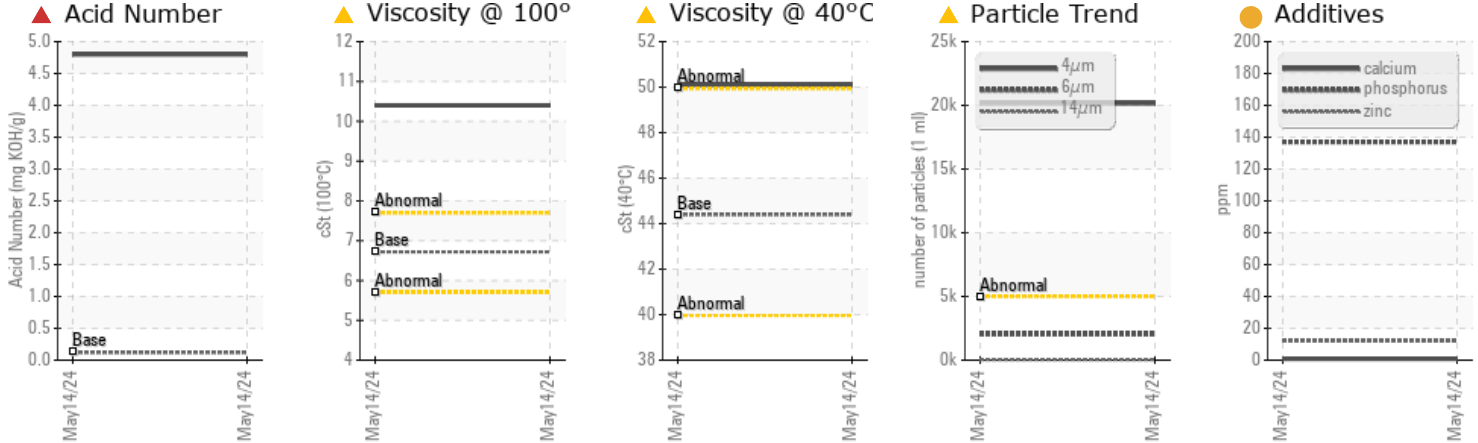

RECOMMENDATION

We recommend that you drain the oil from the component if this has not already been done. We recommend you service the filters on this component. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

PROBLEMATIC TEST RESULTS

Sample Status	SEVERE	---	---
Particles >4µm	ASTM D7647 >5000 ▲ 20157	---	---
Oil Cleanliness	ISO 4406 (c) >19/17/14 ▲ 22/18/12	---	---
Acid Number (AN)	mg KOH/g ASTM D974* 0.12 ▲ 4.80	---	---
Visc @ 40°C	cSt ASTM D7279(m) 44.4 ▲ 50.1	---	---
Visc @ 100°C	cSt ASTM D7279(m) 6.72 ▲ 10.4	---	---
Viscosity Index (VI)	Scale ASTM D2270* 104 ▲ 202	---	---

Customer Id: PCA_129713
Sample No.: PC
Lab Number: 02635709
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Kevin Marson +1 (289)291-4644 x4644
Kevin.Marson@wearcheck.com

To change component or sample information:
Gloria Gonzalez +1 (289)291-4643 x4643
gloria.gonzalez@wearcheck.com

RECOMMENDED ACTIONS


Action	Status	Date	Done By	Description
Change Fluid	---	---	?	We recommend that you drain the oil from the component if this has not already been done.
Change Filter	---	---	?	We recommend you service the filters on this component.
Resample	---	---	?	We recommend an early resample to monitor this condition.
Information Required	---	---	?	NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.
Check Fluid Source	---	---	?	Confirm the source of the lubricant being utilized for top-up/fill.

HISTORICAL DIAGNOSIS

Machine Id
SKIMM P-12

Component
Hydraulic System

Fluid
PETRO CANADA TURBOFLO R&O 46 (--- GAL)

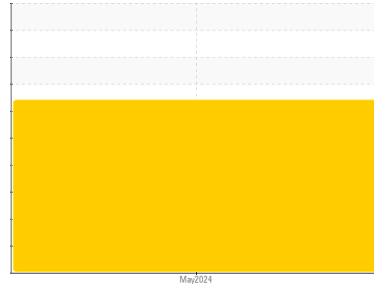

DIAGNOSIS

▲ Recommendation

We recommend that you drain the oil from the component if this has not already been done. We recommend you service the filters on this component. Confirm the source of the lubricant being utilized for top-up/fill. We recommend an early resample to monitor this condition. NOTE: Please provide information regarding reservoir capacity, filter type and micron rating with next sample.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

▲ Fluid Condition

The oil viscosity is higher than normal. The high AN level of the oil indicates the presence of oxipolymerized products. The AN level is much higher than the recommended limit. The viscosity of the oil is higher than normal, possibly indicating the addition of a heavier grade of oil. This plus the additive levels indicates that this is not the same brand, or type of oil as reported. The oil is no longer serviceable.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		PC	---	---
Sample Date	Client Info		14 May 2024	---	---
Machine Age	hrs	Client Info	0	---	---
Oil Age	hrs	Client Info	0	---	---
Oil Changed	Client Info		N/A	---	---
Sample Status			SEVERE	---	---

CONTAMINATION

	method	limit/base	current	history1	history2
Water	WC Method	>0.05	NEG	---	---

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185(m)	>20	4	---
Chromium	ppm	ASTM D5185(m)	>20	0	---
Nickel	ppm	ASTM D5185(m)	>20	0	---
Titanium	ppm	ASTM D5185(m)		0	---
Silver	ppm	ASTM D5185(m)		0	---
Aluminum	ppm	ASTM D5185(m)	>20	0	---
Lead	ppm	ASTM D5185(m)	>20	0	---
Copper	ppm	ASTM D5185(m)	>20	<1	---
Tin	ppm	ASTM D5185(m)	>20	0	---
Antimony	ppm	ASTM D5185(m)		0	---
Vanadium	ppm	ASTM D5185(m)		0	---
Beryllium	ppm	ASTM D5185(m)		0	---
Cadmium	ppm	ASTM D5185(m)		0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185(m)		<1	---
Barium	ppm	ASTM D5185(m)		0	---
Molybdenum	ppm	ASTM D5185(m)		0	---
Manganese	ppm	ASTM D5185(m)		0	---
Magnesium	ppm	ASTM D5185(m)		<1	---
Calcium	ppm	ASTM D5185(m)	0	<1	---
Phosphorus	ppm	ASTM D5185(m)	3	137	---
Zinc	ppm	ASTM D5185(m)	0	12	---
Sulfur	ppm	ASTM D5185(m)		1016	---
Lithium	ppm	ASTM D5185(m)		<1	---

CONTAMINANTS


	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185(m)	>15	0	---
Sodium	ppm	ASTM D5185(m)		<1	---
Potassium	ppm	ASTM D5185(m)	>20	1	---

FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>5000	20157	---	---
Particles >6µm	ASTM D7647	>1300	2044	---	---
Particles >14µm	ASTM D7647	>160	40	---	---
Particles >21µm	ASTM D7647	>40	11	---	---
Particles >38µm	ASTM D7647	>10	2	---	---
Particles >71µm	ASTM D7647	>3	1	---	---
Oil Cleanliness	ISO 4406 (c)	>19/17/14	22/18/12	---	---

OIL ANALYSIS REPORT

▲ Viscosity @ 100°C

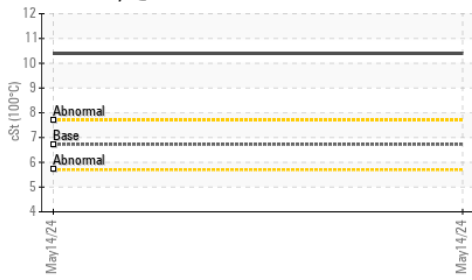


▲ Particle Trend




● Additives



▲ Viscosity @ 40°C

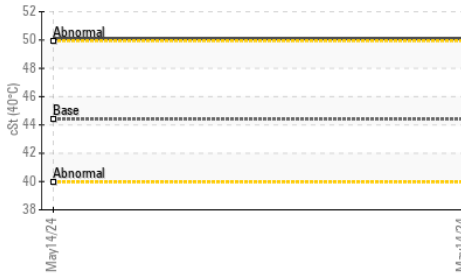

▲ Particle Trend

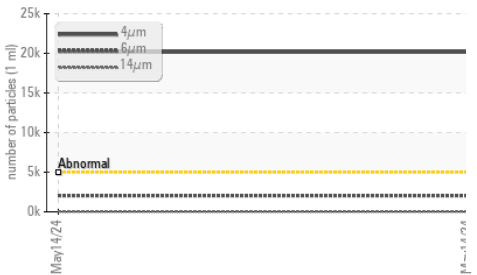

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g	ASTM D974*	0.12 ▲ 4.80	---	---

VISUAL

method	limit/base	current	history1	history2
White Metal	scalar Visual*	NONE	NONE	---
Yellow Metal	scalar Visual*	NONE	NONE	---
Precipitate	scalar Visual*	NONE	NONE	---
Silt	scalar Visual*	NONE	NONE	---
Debris	scalar Visual*	NONE	VLITE	---
Sand/Dirt	scalar Visual*	NONE	NONE	---
Appearance	scalar Visual*	NORML	NORML	---
Odor	scalar Visual*	NORML	NORML	---
Emulsified Water	scalar Visual*	>0.05	NEG	---
Free Water	scalar Visual*		NEG	---

FLUID PROPERTIES

method	limit/base	current	history1	history2
Visc @ 40°C cSt	ASTM D7279(m)	44.4 ▲ 50.1	---	---
Visc @ 100°C cSt	ASTM D7279(m)	6.72 ▲ 10.4	---	---
Viscosity Index (VI) Scale	ASTM D2270*	104 ▲ 202	---	---

SAMPLE IMAGES


method	limit/base	current	history1	history2
Color			no image	no image
Bottom			no image	no image

GRAPHS

Ferrous Alloys




Non-ferrous Metals

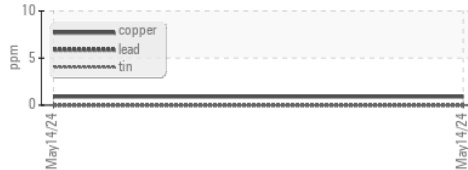

▲ Viscosity @ 40°C



▲ Particle Count

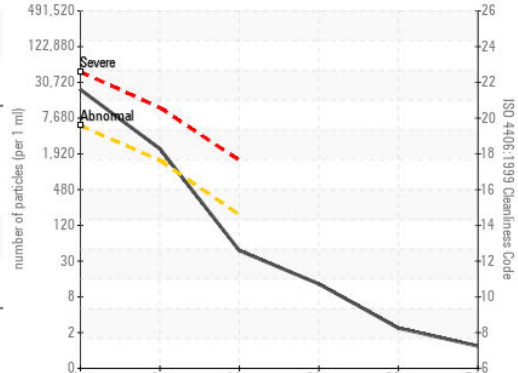

▲ Acid Number



Laboratory : WearCheck - C8-1175 Appleby Line, Burlington, ON L7L 5H9 **Petro-Canada Technical/Behshad Sabah**
Sample No. : PC **Received** : 15 May 2024
Lab Number : 02635709 **Tested** : 21 May 2024
Unique Number : 5776862 **Diagnosed** : 21 May 2024 - Kevin Marson
Test Package : IND 2 (Additional Tests: KV100, TAN Man, VI)

To discuss this sample report, contact Customer Service at 1-800-268-2131.
 Test denoted (*) outside scope of accreditation, (m) method modified, (e) tested at external lab.
 Validity of results and interpretation are based on the sample and information as supplied.

Mississauga, ON
 CA L5J 1K2
 Contact: Behshad Sabah
 Behshad.Sabah@hfsinclair.com
 T: (905)716-2158
 F: (905)403-6740